


# **OIL ANALYSIS REPORT**

[] WC-9800C-0105-5 Chiller #5

Component Chiller

YORK TYPE K (--- GAL)





### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the


### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	NOITAN	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0836545	WC0836532	WC0784770
Sample Date		Client Info		18 Mar 2024	13 Aug 2023	28 Mar 2023
Machine Age	hrs	Client Info		27576	26684	25978
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	nnm	ASTM D5185m		0	0	0
Caumum	ppm	AO INI DO IOSIII		U	U	O
ADDITIVES	ррш	method	limit/base	current	history1	history2
	ppm		limit/base			
ADDITIVES		method ASTM D5185m		current	history1	history2
ADDITIVES Boron	ppm	method ASTM D5185m	0	current 0	history1	history2
ADDITIVES Boron Barium	ppm	method ASTM D5185m ASTM D5185m	0 0 0	current 0 0	history1 0 0 0 0	history2 0 0
ADDITIVES Boron Barium Molybdenum	ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m	0 0 0	current 0 0 0	history1 0 0 0 0 0 3	history2 0 0 <1
ADDITIVES  Boron  Barium  Molybdenum  Manganese	ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 0 0	Current 0 0 0 0 0 0 0 0 0	history1 0 0 0 0 0 3	history2 0 0 0 <1 <1
ADDITIVES  Boron  Barium  Molybdenum  Manganese  Magnesium	ppm ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 0 0	0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0	history1 0 0 0 0 0 3	history2  0 0 <1 <1 0
ADDITIVES  Boron  Barium  Molybdenum  Manganese  Magnesium  Calcium	ppm ppm ppm ppm ppm	method ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	0 0 0 0 0	Current 0 0 0 0 0 0 0 0 0	history1 0 0 0 0 0 3	history2  0 0 <1 <1 0 0 0
ADDITIVES  Boron  Barium  Molybdenum  Manganese  Magnesium  Calcium  Phosphorus	ppm ppm ppm ppm ppm ppm	method ASTM D5185m	0 0 0 0 0 0 0 5	Current 0 0 0 0 0 0 0 0 0 0 0	history1 0 0 0 0 0 3 0 2	history2  0 0 <1 <1 0 4
ADDITIVES  Boron  Barium  Molybdenum  Manganese  Magnesium  Calcium  Phosphorus  Zinc	ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m	0 0 0 0 0 0 0 5	Current 0 0 0 0 0 0 0 0 0 0 0	history1 0 0 0 0 0 3 0 2	history2  0 0 <1 <1 0 0 4 0
ADDITIVES  Boron  Barium  Molybdenum  Manganese  Magnesium  Calcium  Phosphorus  Zinc  Sulfur	ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m	0 0 0 0 0 0 0 5 0	Current 0 0 0 0 0 0 0 0 0 0 0 0 0	history1 0 0 0 0 0 3 0 2 0 4	history2  0 0 <1 <1 0 0 4 0 0
ADDITIVES  Boron  Barium  Molybdenum  Manganese  Magnesium  Calcium  Phosphorus  Zinc  Sulfur  CONTAMINANTS	ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m	0 0 0 0 0 0 0 5 0 10	current  0 0 0 0 0 0 0 0 0 current	history1  0 0 0 0 3 0 2 0 4 history1	history2  0 0 <1 <1 0 0 4 0 history2
ADDITIVES  Boron  Barium  Molybdenum  Manganese  Magnesium  Calcium  Phosphorus  Zinc  Sulfur  CONTAMINANTS  Silicon	ppm ppm ppm ppm ppm ppm ppm ppm ppm	method  ASTM D5185m	0 0 0 0 0 0 0 5 0 10	Current  0 0 0 0 0 0 0 0 0 current 5	history1  0 0 0 0 3 0 2 0 4 history1 7	history2  0 0 <1 <1 0 0 4 0 history2 7
ADDITIVES  Boron  Barium  Molybdenum  Manganese  Magnesium  Calcium  Phosphorus  Zinc  Sulfur  CONTAMINANTS  Silicon  Sodium	ppm ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m	0 0 0 0 0 0 5 0 10 limit/base >15	current 0 0 0 0 0 0 0 0 0 0 current 5	history1  0 0 0 0 3 0 2 0 4 history1 7	history2  0 0 <1 <1 0 0 4 0 history2 7 0
ADDITIVES  Boron  Barium  Molybdenum  Manganese  Magnesium  Calcium  Phosphorus  Zinc  Sulfur  CONTAMINANTS  Silicon  Sodium  Potassium	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	method ASTM D5185m	0 0 0 0 0 0 5 0 10 limit/base >15	Current  0 0 0 0 0 0 0 0 0 0 0 current 5 0 0	history1  0  0  0  0  3  0  2  0  4  history1  7  0  <1	history2  0 0 <1 <1 <1 0 0 4 0 0 history2 7 0 1
ADDITIVES  Boron  Barium  Molybdenum  Manganese  Magnesium  Calcium  Phosphorus  Zinc  Sulfur  CONTAMINANTS  Silicon  Sodium  Potassium  Water	ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm	method  ASTM D5185m	0 0 0 0 0 0 5 0 10 limit/base >15 >20 >0.03	Current  0 0 0 0 0 0 0 0 0 0 current 5 0 0 0 0 0.015	history1  0  0  0  0  3  0  2  0  4  history1  7  0  <1  0.049	history2  0 0 <1 <1 <1 0 0 4 0 0 history2 7 0 1 0.037



# **OIL ANALYSIS REPORT**







VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.03	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
ELLIID DDODEDI	method	limit/base	ourrent	hiotony1	hiotory?	
FLUID PROPERTIES		method				history2

Visc @ 40°C	cSt	ASTM D445	32.0	29.5	26.9	33.74


Color



SAMPLE IMAGES





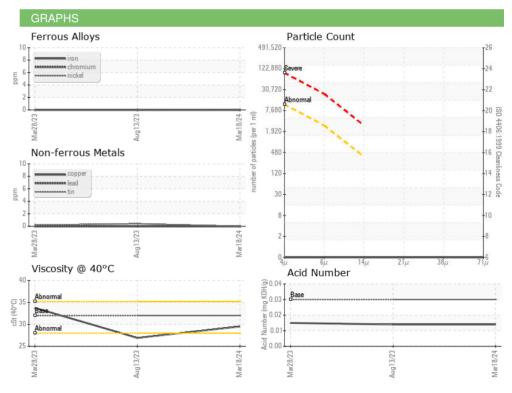





Laboratory Sample No. Lab Number : 06123736 Unique Number: 10937887

: WC0836545

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received

: 20 Mar 2024 : 21 Mar 2024 **Tested** Diagnosed

: 25 Mar 2024 - Jonathan Hester

**Chugach Consolidated Solutions - NSA** 

10840 Guilford Road, Suites 406-407 Annapolis Junction, MD

US 20701 Contact: Susan Nord

Test Package : PLANT Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

susan.nord@chugachgov.com T: (301)688-6363

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (443)479-5666 Contact/Location: Susan Nord - CHUANN