


OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

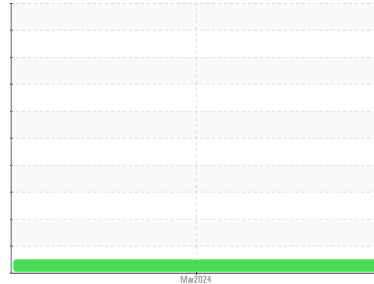

Area
{UNASSIGNED} [2]
 Machine Id
GARDNER DENVER Gardner Denver (S/N M62151)
 Component
2 Air Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

| | | | | |
|---------------|-----------------|--------------------|-----|-----|
| Sample Number | Client Info | UCH0000431 | --- | --- |
| Sample Date | Client Info | 12 Mar 2024 | --- | --- |
| Machine Age | hrs Client Info | 20582 | --- | --- |
| Oil Age | hrs Client Info | 0 | --- | --- |
| Oil Changed | Client Info | Not Chngd | --- | --- |
| Sample Status | | NORMAL | --- | --- |

CONTAMINATION method limit/base current history1 history2

| | | | | | |
|-------|-----------|------|------------|-----|-----|
| Water | WC Method | >0.6 | NEG | --- | --- |
|-------|-----------|------|------------|-----|-----|

WEAR METALS method limit/base current history1 history2

| | | | | | | |
|----------|-----|-------------|-----|----------|-----|-----|
| Iron | ppm | ASTM D5185m | >50 | 0 | --- | --- |
| Chromium | ppm | ASTM D5185m | >4 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | >4 | 0 | --- | --- |
| Titanium | ppm | ASTM D5185m | | 0 | --- | --- |
| Silver | ppm | ASTM D5185m | | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m | >10 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m | >20 | 0 | --- | --- |
| Copper | ppm | ASTM D5185m | >40 | 0 | --- | --- |
| Tin | ppm | ASTM D5185m | >5 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | | 0 | --- | --- |
| Cadmium | ppm | ASTM D5185m | | 0 | --- | --- |

ADDITIVES method limit/base current history1 history2

| | | | | | | |
|------------|-----|-------------|-----|-----------|-----|-----|
| Boron | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Barium | ppm | ASTM D5185m | 500 | 8 | --- | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Manganese | ppm | ASTM D5185m | | 0 | --- | --- |
| Magnesium | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Calcium | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | 20 | 23 | --- | --- |
| Zinc | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Sulfur | ppm | ASTM D5185m | 200 | 0 | --- | --- |



CONTAMINANTS method limit/base current history1 history2

| | | | | | | |
|-----------|-----|-------------|-----|----------|-----|-----|
| Silicon | ppm | ASTM D5185m | >25 | 1 | --- | --- |
| Sodium | ppm | ASTM D5185m | | 3 | --- | --- |
| Potassium | ppm | ASTM D5185m | >20 | 0 | --- | --- |

FLUID DEGRADATION method limit/base current history1 history2

| | | | | | | |
|------------------|----------|------------|--|-------------|-----|-----|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.55 | --- | --- |
|------------------|----------|------------|--|-------------|-----|-----|

OIL ANALYSIS REPORT

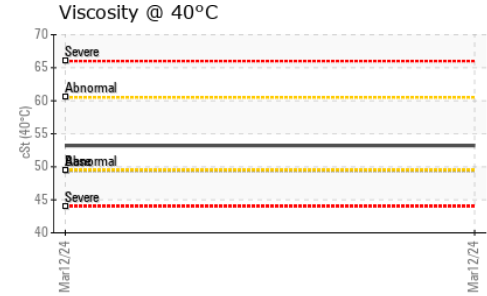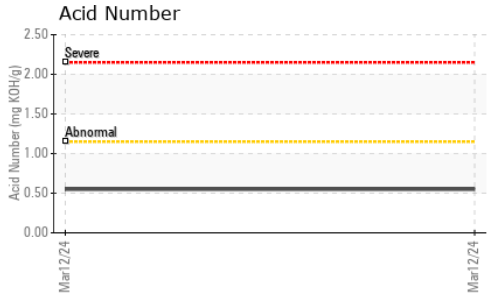





| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.6 | NEG | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 49.4 | 53.2 | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | | | |
|--------|--|--|--|----------|----------|
| Color | | | | no image | no image |
| Bottom | | | | no image | no image |

GRAPHS

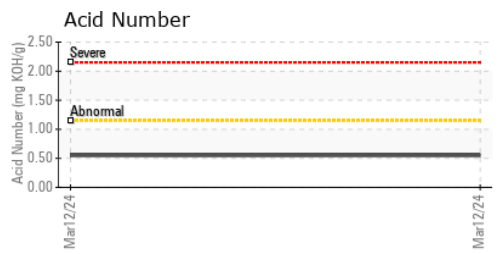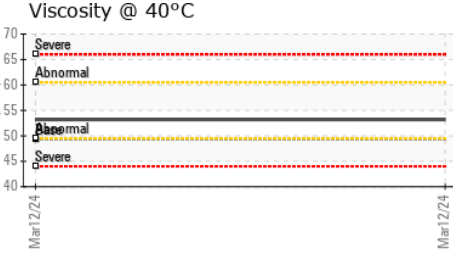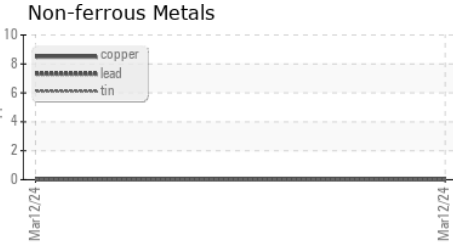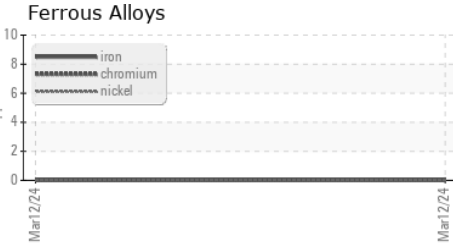

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH0000431
Lab Number : 06123763
Unique Number : 10937914
Test Package : IND 2
Received : 20 Mar 2024
Tested : 21 Mar 2024
Diagnosed : 22 Mar 2024 - Don Baldrige

JOHN HENRY FOSTER COMPANY
 4700 LEBOURGET STREET
 SAINT LOUIS, MO
 US 63134
 Contact: RACHEL VON HATTEN
 rvonhatten@jhfc.com
 T: (314)593-1267
 F: (314)874-0965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)