




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

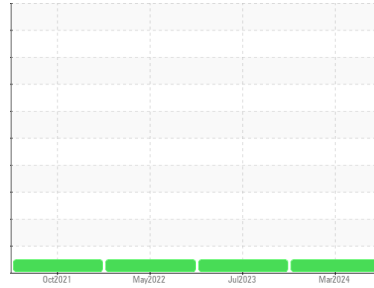

Area  
**S-460 [9003]**  
 Machine Id  
**KAESER 1188 - AMAZON**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (3 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC06123786</b>	UCH05934436	UCH05568208
Sample Date	Client Info		<b>13 Mar 2024</b>	17 Jul 2023	04 May 2022
Machine Age	hrs	Client Info	<b>41200</b>	36267	29791
Oil Age	hrs	Client Info	<b>8461</b>	3509	2000
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Not Changd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>12</b>	10	9
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	7	14
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>20</b>	36	50
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	2	<1
Zinc	ppm	ASTM D5185m	<b>75</b>	16	6
Sulfur	ppm	ASTM D5185m	<b>21239</b>	19612	17338

## CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>5</b>	8	14
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	0

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.42</b>	0.42	0.39




# OIL ANALYSIS REPORT

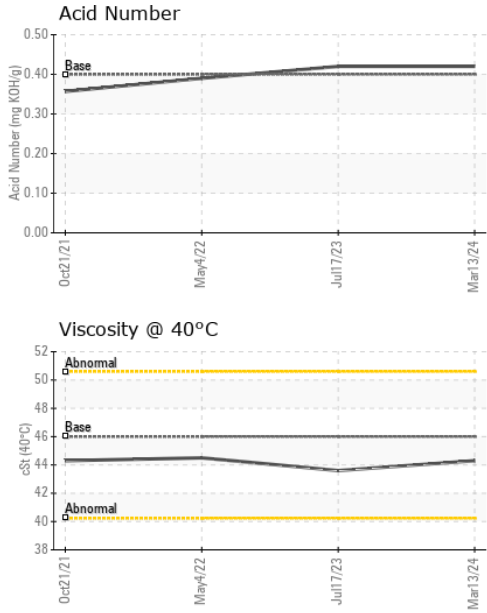



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	<b>44.3</b>	43.6	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

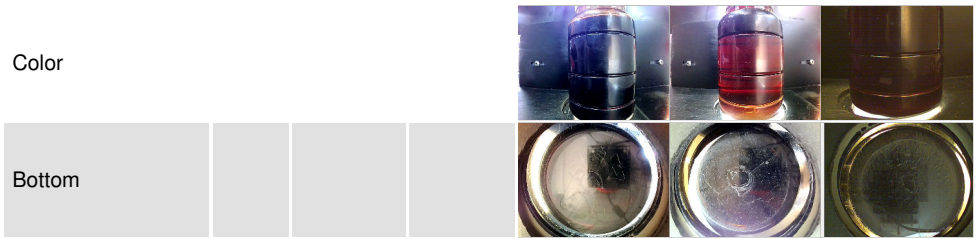

## GRAPHS

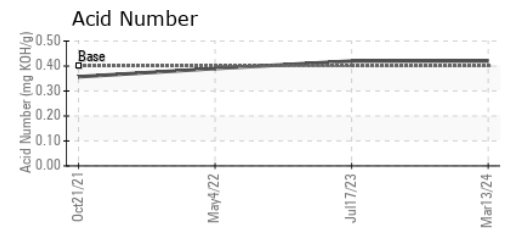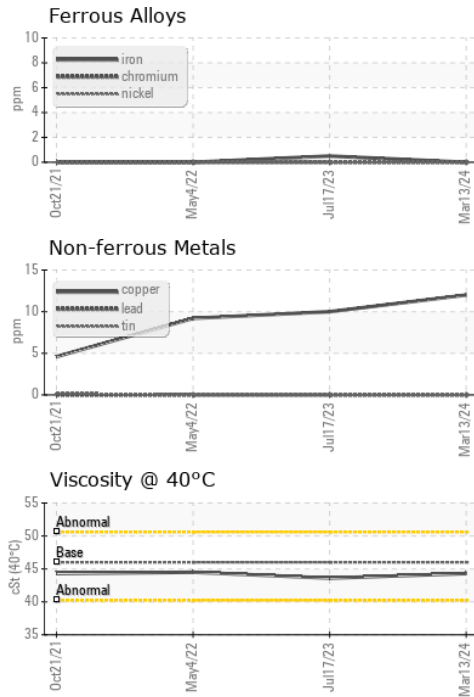

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC06123786      **Received** : 20 Mar 2024  
**Lab Number** : **06123786**      **Tested** : 21 Mar 2024  
**Unique Number** : 10937937      **Diagnosed** : 22 Mar 2024 - Don Baldrige  
**Test Package** : IND 2

**DELTA INDUSTRIES - DOWNERS GROVE**  
 2201 CURTISS STREET  
 DOWNERS GROVE, IL  
 US 60515  
 Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)      T: (630)960-3931