


OIL ANALYSIS REPORT

SMART OIL Machine Id HERTZ VD032177

Component

Compressor Fluid

SMARTOIL 6000 (--- GAL)





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Moor

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	/ATION	method	limit/base	current	history1	history2
	////1011		IIIIII Dasc			,
Sample Number		Client Info		UHK06123830	UHK06068564	
Sample Date		Client Info		29 Feb 2024	12 Dec 2023	
Machine Age	hrs	Client Info		516	170	
Oil Age	hrs	Client Info		346	170	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	0	<1	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	<1	2	
Tin	ppm	ASTM D5185m	>15	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m		0	<1	
Calcium	ppm	ASTM D5185m	20	0	1	
Phosphorus	ppm	ASTM D5185m		75	41	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		594	404	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		0	<1	
Potassium	ppm	ASTM D5185m	>20	0	0	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.13	0.13	




OIL ANALYSIS REPORT

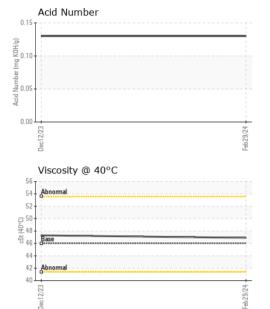


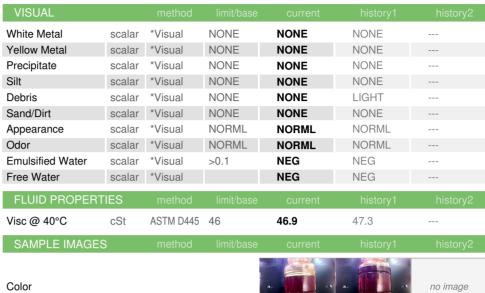



GRAPHS

Bottom













Certificate L2367

Laboratory Sample No.

Lab Number : 06123830

Unique Number : 10937981 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UHK06123830 Received : 20 Mar 2024 **Tested** : 21 Mar 2024

Diagnosed

: 22 Mar 2024 - Don Baldridge

ATLANTA AIR COMPRESSOR - HERTZ

123 MERCHANTS PARK DR HOSCHTON, GA US 30548

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F:

no image