


# OIL ANALYSIS REPORT

Area  
**46S**  
 Machine Id  
**4473X52 - FT LORAMIE**  
 Component  
**Compressor**

Sample Rating Trend

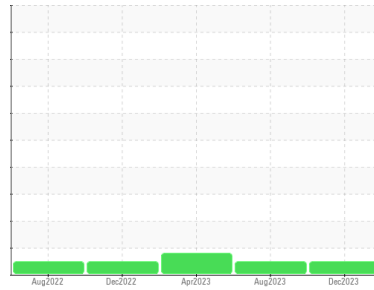

**NORMAL**



## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH06123862</b>	UCS05952859	UCS05849834
Sample Date	Client Info			<b>19 Dec 2023</b>	10 Aug 2023	18 Apr 2023
Machine Age	hrs	Client Info		<b>53128</b>	52703	52330
Oil Age	hrs	Client Info		<b>5128</b>	4703	4330
Oil Changed	Client Info			<b>Changed</b>	N/A	Changed
Sample Status				<b>NORMAL</b>	NORMAL	ATTENTION

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.9	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0.1	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0.2	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	0.9	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	224	<b>283</b>	291	289
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	273	<b>303</b>	348	357

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	2	2
Sodium	ppm	ASTM D5185m		<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	1	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.103	<b>0.085</b>	0.082	0.142

# OIL ANALYSIS REPORT




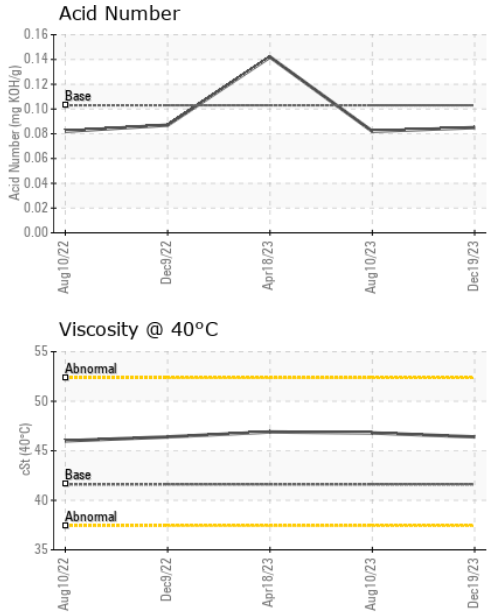


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	41.61	<b>46.4</b>	46.8	46.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

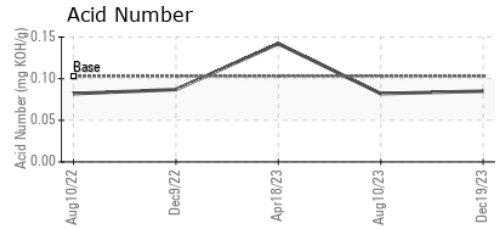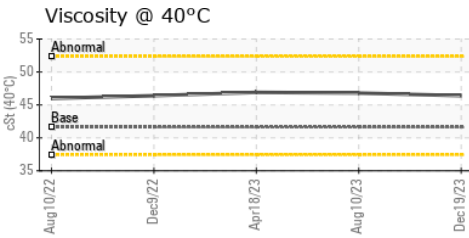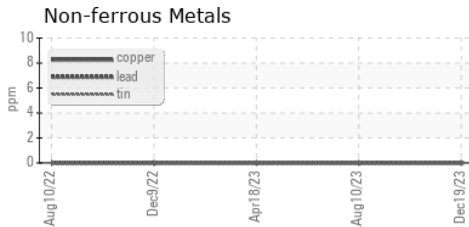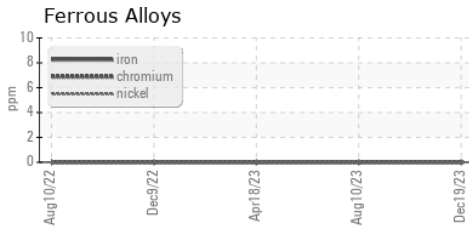

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06123862 **Received** : 20 Mar 2024  
**Lab Number** : **06123862** **Tested** : 21 Mar 2024  
**Unique Number** : 10938013 **Diagnosed** : 22 Mar 2024 - Don Baldrige  
**Test Package** : IND 2

**CROWN BATTERY MFG**  
 1445 MAJESTIC DR  
 FREMONT, OH  
 US 43420  
 Contact: DOUG CRABILL  
 DCRABILL@CROWNBATTER.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)