




# OIL ANALYSIS REPORT

Sample Rating Trend

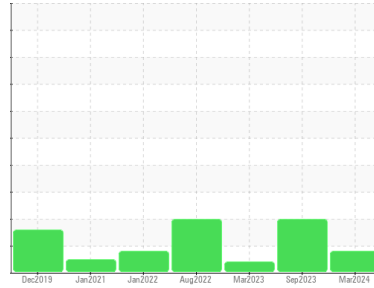

ISO



Machine Id  
**KAESER AIRCENTER SM 15 5685877 (S/N 1647)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA015294</b>	KCPA006175	KCPA000316
Sample Date	Client Info			<b>06 Mar 2024</b>	29 Sep 2023	27 Mar 2023
Machine Age	hrs	Client Info		<b>15967</b>	14511	12930
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>Changed</b>	N/A	N/A
Sample Status				<b>ATTENTION</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	4
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>3</b>	4	9
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>36</b>	26	14
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	100	<b>61</b>	64	48
Calcium	ppm	ASTM D5185m	0	<b>4</b>	2	2
Phosphorus	ppm	ASTM D5185m	0	<b>5</b>	2	2
Zinc	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	8
Sulfur	ppm	ASTM D5185m	23500	<b>20085</b>	17100	19527

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>33</b>	28	28
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	4	2
Water	%	ASTM D6304	>0.05	<b>0.016</b>	0.021	0.013
ppm Water	ppm	ASTM D6304	>500	<b>167</b>	216.3	135.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>9075</b>	63407	---
Particles >6µm		ASTM D7647	>1300	<b>1369</b>	▲ 20447	---
Particles >14µm		ASTM D7647	>80	<b>79</b>	▲ 1850	---
Particles >21µm		ASTM D7647	>20	<b>22</b>	▲ 588	---
Particles >38µm		ASTM D7647	>4	<b>1</b>	▲ 33	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	2	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/18/13</b>	▲ 23/22/18	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.32</b>	0.29	0.27

# OIL ANALYSIS REPORT

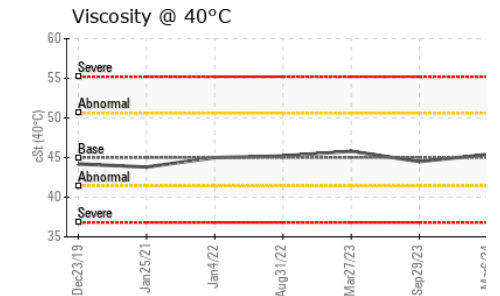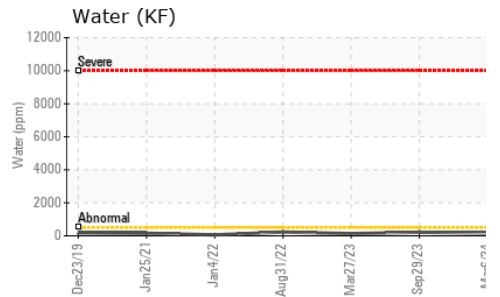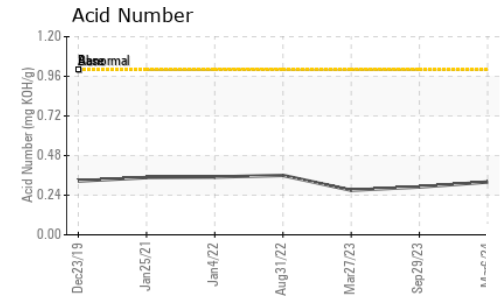
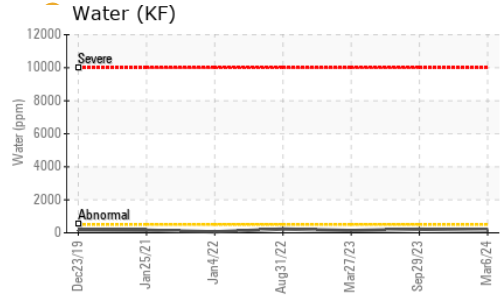
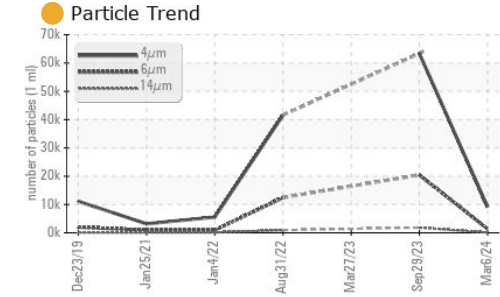


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	LIGHT	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	45.4	44.5	45.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

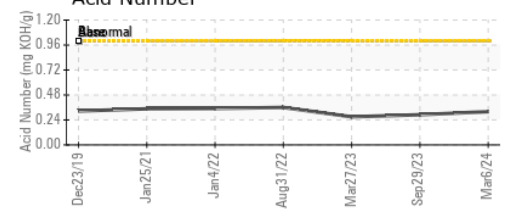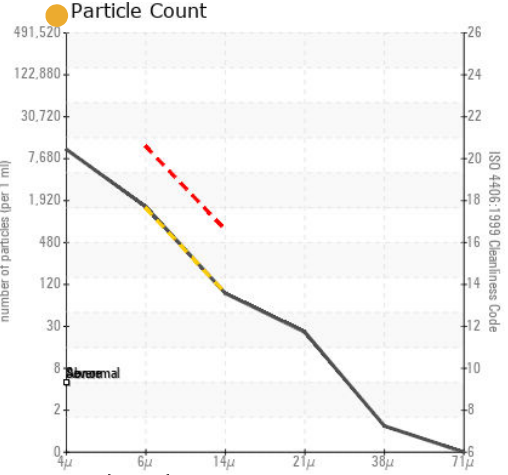

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA015294 **Received** : 20 Mar 2024  
**Lab Number** : 06124284 **Tested** : 21 Mar 2024  
**Unique Number** : 10938435 **Diagnosed** : 23 Mar 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PritCount )

**SOFT ROBOTICS INC**  
 32 CROSBY DR  
 BEDFORD, MA  
 US 01730  
 Contact: M. ELLIS  
 mellis@softrobotics.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)