



# OIL ANALYSIS REPORT

Sample Rating Trend



**WATER**



Machine Id  
**KAESER 8748892**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

The filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

### Wear

All component wear rates are normal.

### ▲ Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA013962</b>	---	---
Sample Date	Client Info		<b>12 Mar 2024</b>	---	---
Machine Age	hrs	Client Info	<b>708</b>	---	---
Oil Age	hrs	Client Info	<b>708</b>	---	---
Oil Changed	Client Info		<b>Not Chngd</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	---	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>2</b>	---	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 100	<b>37</b>	---	---
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m 0	<b>5</b>	---	---
Zinc	ppm	ASTM D5185m 0	<b>6</b>	---	---
Sulfur	ppm	ASTM D5185m 23500	<b>20073</b>	---	---




## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<b>8</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>6</b>	---	---
Water	%	ASTM D6304 >0.05	<b>▲ 0.181</b>	---	---
ppm Water	ppm	ASTM D6304 >500	<b>▲ 1810</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.38</b>	---	---

# OIL ANALYSIS REPORT

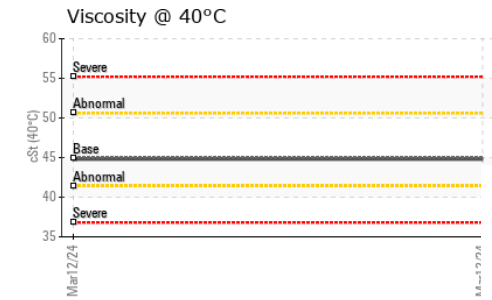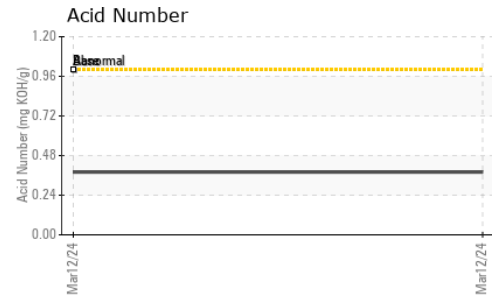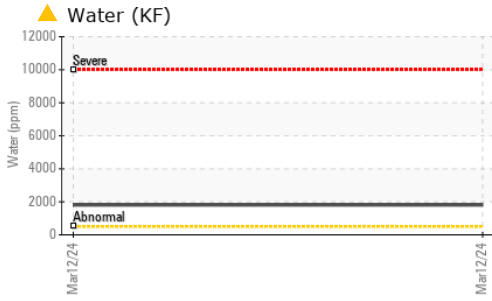





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---
Debris	scalar	*Visual	NONE	<b>▲ MODER</b>	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---
Emulsified Water	scalar	*Visual	>0.05	<b>▲ 0.2%</b>	---
Free Water	scalar	*Visual		<b>NEG</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	<b>44.8</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

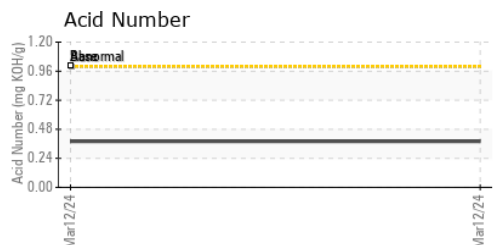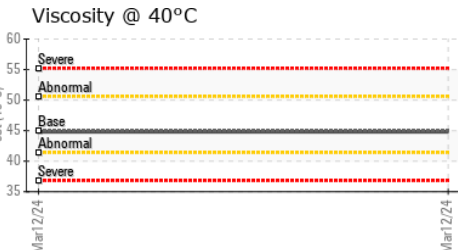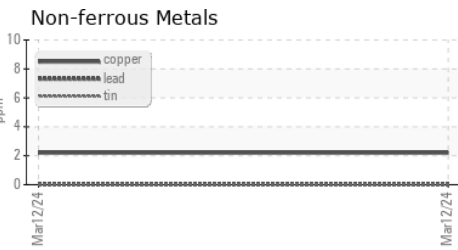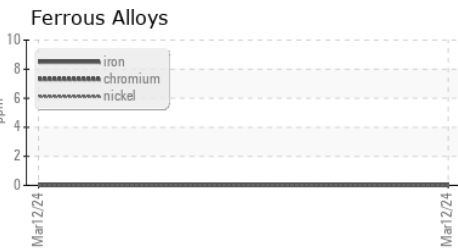

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA013962 **Received** : 20 Mar 2024  
**Lab Number** : 06124288 **Tested** : 23 Mar 2024  
**Unique Number** : 10938439 **Diagnosed** : 23 Mar 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**FEDEX GROUND**  
 135 COLEMAN BLVD  
 SAVANNAH, GA  
 US 31408  
 Contact: RAMI MESMER  
 RAMI.MESMER@FEDEX.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: