




OIL ANALYSIS REPORT

Sample Rating Trend

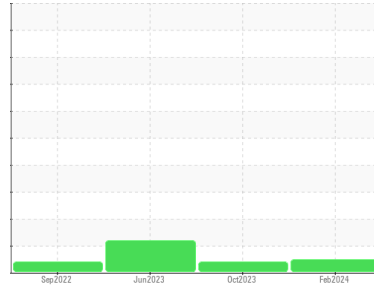

NORMAL



Machine Id
KAESER BSV 100 6341326 (S/N 1081)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA013460	KCP000790	KCPA003957
Sample Date	Client Info			27 Feb 2024	06 Oct 2023	05 Jun 2023
Machine Age	hrs	Client Info		22212	19386	14237
Oil Age	hrs	Client Info		6000	0	0
Oil Changed	Client Info			Changed	N/A	N/A
Sample Status				NORMAL	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	2	4
Tin	ppm	ASTM D5185m	>10	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m	90	100	91	47
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	90	92	121
Calcium	ppm	ASTM D5185m	2	2	5	3
Phosphorus	ppm	ASTM D5185m		0	<1	<1
Zinc	ppm	ASTM D5185m		0	0	<1
Sulfur	ppm	ASTM D5185m		20346	16161	19929

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m		10	13	16
Potassium	ppm	ASTM D5185m	>20	0	1	2
Water	%	ASTM D6304	>0.05	0.022	0.020	0.028
ppm Water	ppm	ASTM D6304	>500	230	204.0	281.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2728	---	2593
Particles >6µm		ASTM D7647	>1300	697	---	928
Particles >14µm		ASTM D7647	>80	52	---	97
Particles >21µm		ASTM D7647	>20	16	---	21
Particles >38µm		ASTM D7647	>4	1	---	1
Particles >71µm		ASTM D7647	>3	0	---	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	19/17/13	---	19/17/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.43	0.39	0.45


OIL ANALYSIS REPORT

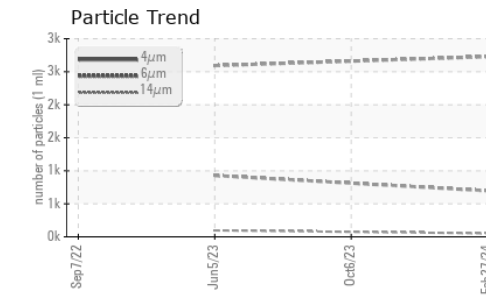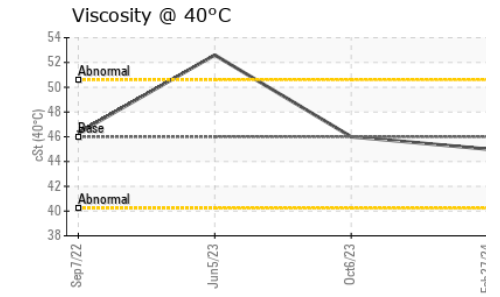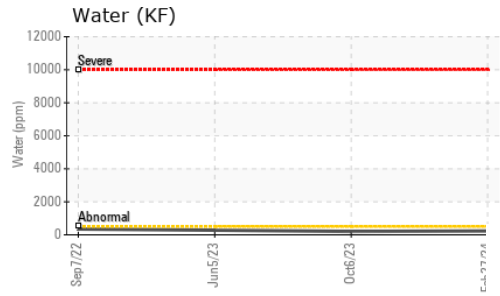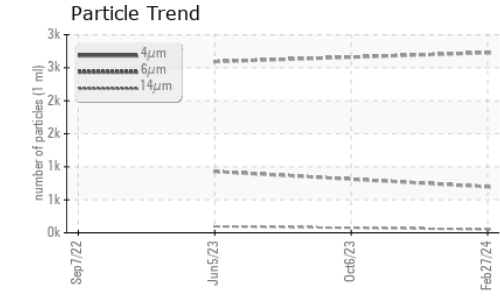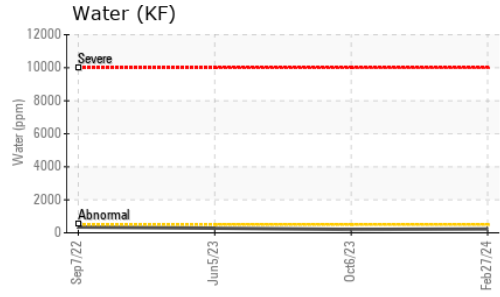







VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.0	46.0	52.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

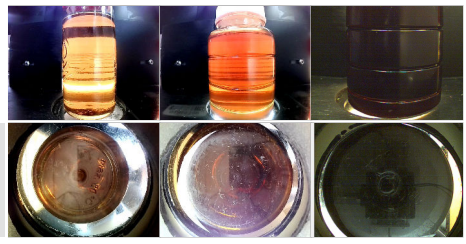

GRAPHS

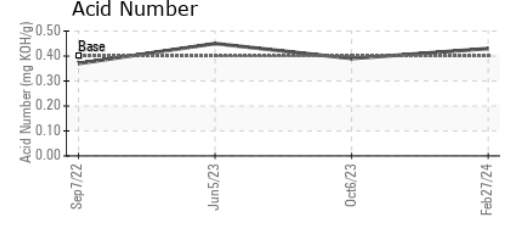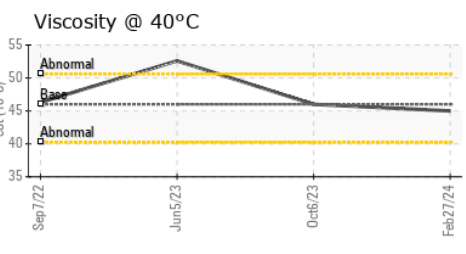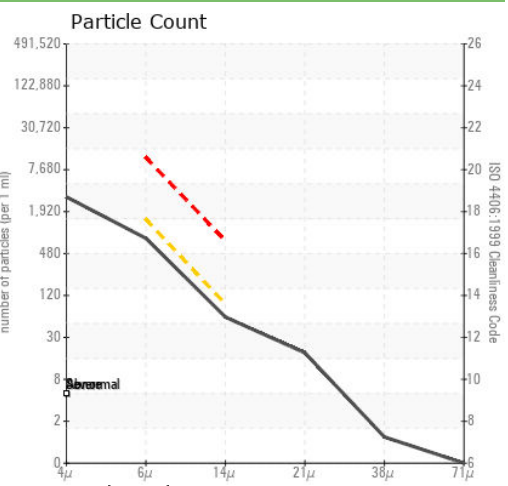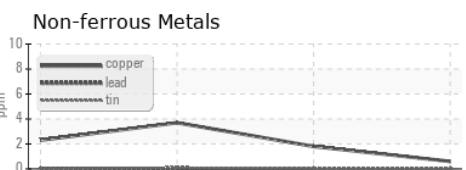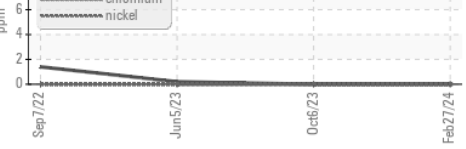

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA013460 **Received** : 20 Mar 2024
Lab Number : 06124320 **Tested** : 21 Mar 2024
Unique Number : 10938471 **Diagnosed** : 23 Mar 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

GREINER BIO-ONE
 4238 CAPITOL DR.
 MONROE, NC
 US 28112
 Contact: CHRISTOPHER BYRNE
 christopher.byrne@gbo.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)