




FUEL REPORT

Sample Rating Trend

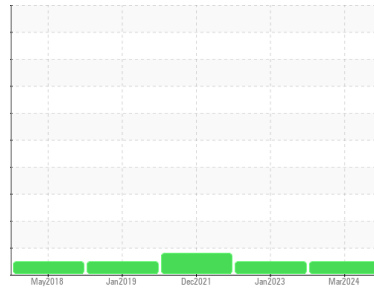

NORMAL



Area

[PB-PMOAS2747306]

Machine Id

6D24-302687 20A02330-5 (S/N 2057502)

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (LOW-SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is no Bacteria, Yeast and/or Fungus indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	DC0029140	DC0019312	DC0014086
Sample Date	Client Info	11 Mar 2024	18 Jan 2023	15 Dec 2021
Machine Age	hrs	857	818	790
Sample Status		NORMAL	NORMAL	ATTENTION

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2	
ASTM Color	scalar	*ASTM D1500	L4.5	L4.5	L4.5
Visc @ 40°C	cSt	ASTM D445	3.0	2.42	2.44

SULFUR CONTENT

method	limit/base	current	history1	history2		
Sulfur	ppm	ASTM D5185m	250	49	168	169
Sulfur (UVF)	ppm	ASTM D5453		94	136	169

IGNITION QUALITY

method	limit/base	current	history1	history2		
API Gravity		ASTM D7777	37.7	38.5	36.4	---

CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	<1.0	0	0	0
Sodium	ppm	ASTM D5185m	<0.1	0	0	<1
Potassium	ppm	ASTM D5185m	<0.1	<1	0	0
Water	%	ASTM D6304	<0.05	0.003	0.003	0.003
ppm Water	ppm	ASTM D6304	<500	32	36.4	34.8
% Gasoline	%	*In-House	<0.50	0.0	0.0	0.0
% Biodiesel	%	*In-House	<20.0	0.0	0.0	0.0

FLUID CLEANLINESS



method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647	>2500	---	302	● 4385
Particles >6µm		ASTM D7647	>640	---	111	● 1138
Particles >14µm		ASTM D7647	>80	---	18	66
Particles >21µm		ASTM D7647	>20	---	5	14
Particles >38µm		ASTM D7647	>4	---	1	1
Particles >71µm		ASTM D7647	>3	---	0	0
Oil Cleanliness		ISO 4406 (c)	>18/16/13	---	15/14/11	● 19/17/13

HEAVY METALS

method	limit/base	current	history1	history2		
Aluminum	ppm	ASTM D5185m	<0.1	2	0	0
Nickel	ppm	ASTM D5185m	<0.1	<1	0	0
Lead	ppm	ASTM D5185m	<0.1	<1	0	0
Vanadium	ppm	ASTM D5185m	<0.1	<1	0	0
Iron	ppm	ASTM D5185m	<0.1	0	0	0
Calcium	ppm	ASTM D5185m	<0.1	3	0	0
Magnesium	ppm	ASTM D5185m	<0.1	0	0	0
Phosphorus	ppm	ASTM D5185m	<0.1	0	0	<1
Zinc	ppm	ASTM D5185m	<0.1	0	0	0




FUEL REPORT

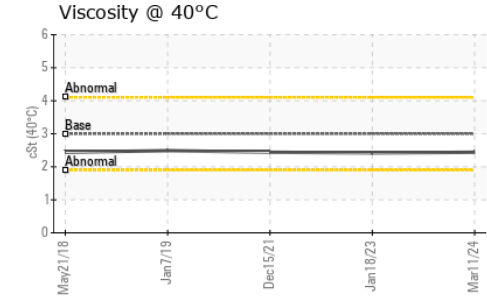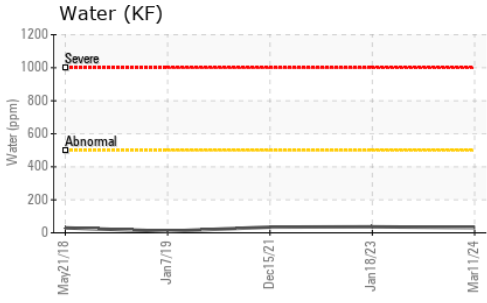

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

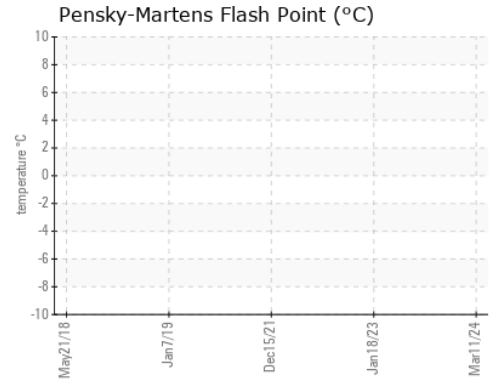

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0029140 **Received** : 20 Mar 2024
Lab Number : 06124466 **Tested** : 07 Apr 2024
Unique Number : 10938617 **Diagnosed** : 07 Apr 2024 - Doug Bogart
Test Package : DF-5 (Additional Tests: API, Cetane, Fuel, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227