




OIL ANALYSIS REPORT

Sample Rating Trend

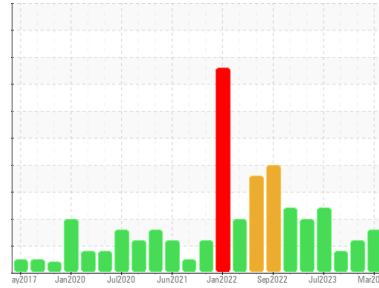

VISCOSITY



Area
WH-100
Machine Id
B25970 - STORK GEARBOX #4 (2ND ON STERILE SECTION)
Component
Gearbox
Fluid
PETRO CANADA ENDURATEX WG 680 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0894850	WC0880588	WC0856018
Sample Date	Client Info		06 Mar 2024	10 Jan 2024	29 Nov 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	12	15	6
Chromium	ppm	ASTM D5185m	>15	<1	<1	0
Nickel	ppm	ASTM D5185m	>15	0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	2	0
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>200	9	10	8
Tin	ppm	ASTM D5185m	>25	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	1	0	0	0
Barium	ppm	ASTM D5185m	1	0	3	0
Molybdenum	ppm	ASTM D5185m	1	<1	0	0
Manganese	ppm	ASTM D5185m	1	<1	0	<1
Magnesium	ppm	ASTM D5185m	1	0	0	0
Calcium	ppm	ASTM D5185m	1	0	1	2
Phosphorus	ppm	ASTM D5185m	1	7	51	<1
Zinc	ppm	ASTM D5185m	1	0	0	6
Sulfur	ppm	ASTM D5185m	3114	3075	3048	2429

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	1	1	1
Sodium	ppm	ASTM D5185m		<1	0	1
Potassium	ppm	ASTM D5185m	>20	0	<1	0

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 393896	● 14425	---
Particles >6µm	ASTM D7647	>2500	▲ 50943	1905	---
Particles >14µm	ASTM D7647	>320	68	59	---
Particles >21µm	ASTM D7647	>80	11	13	---
Particles >38µm	ASTM D7647	>20	0	1	---
Particles >71µm	ASTM D7647	>4	0	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 26/23/13	● 21/18/13	---


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.43	1.37	1.17	1.24




OIL ANALYSIS REPORT


▲ Particle Trend

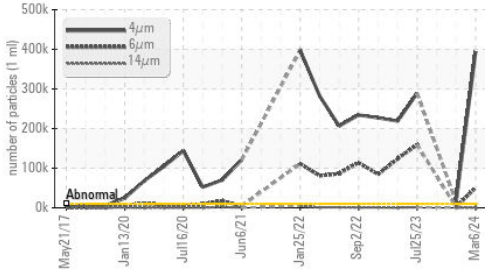


▲ Particle Trend

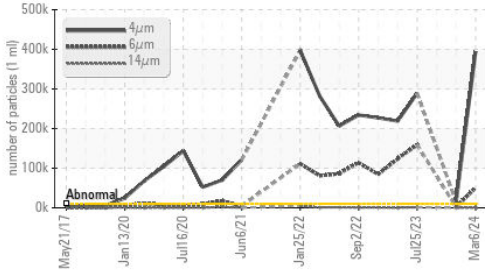

● Viscosity @ 40°C

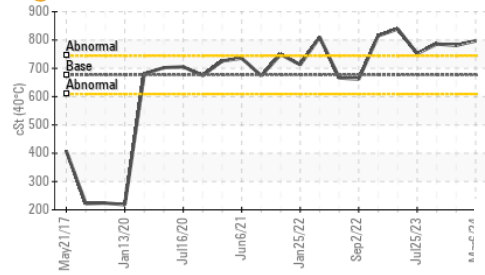


Acid Number

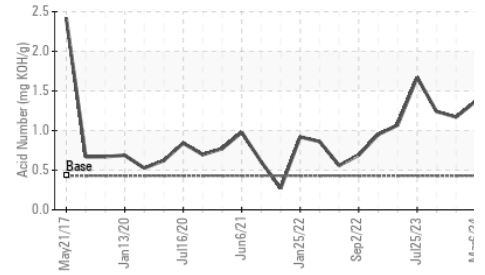

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	676.7 ● 797	781.2	786

SAMPLE IMAGES

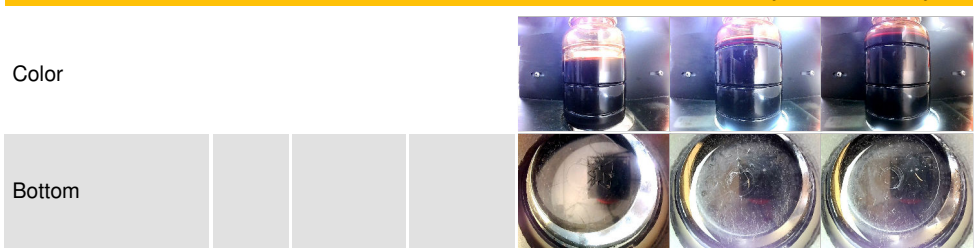


GRAPHS


Ferrous Alloys

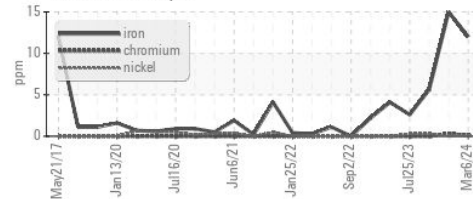


Non-ferrous Metals

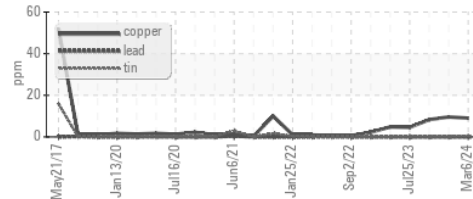


● Viscosity @ 40°C

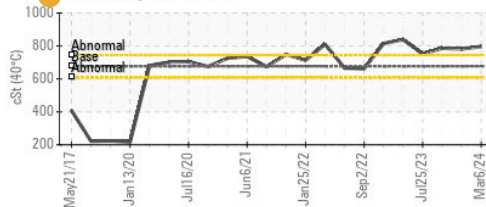

▲ Particle Count

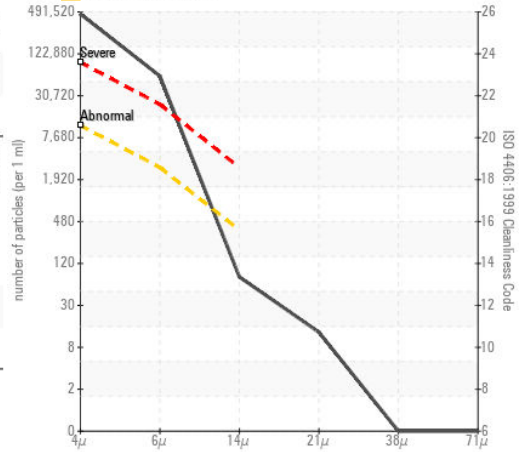

Acid Number

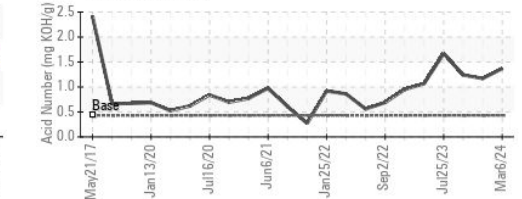

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0894850 Received : 21 Mar 2024
 Lab Number : 06124878 Tested : 22 Mar 2024
 Unique Number : 10939029 Diagnosed : 24 Mar 2024 - Don Baldrige
 Test Package : IND 2 (Additional Tests: PrtCount)

HORMEL FOODS - AUSTIN
 1101 NORTH MAIN ST
 AUSTIN, MN
 US 55912
 Contact: RYAN LOWE
 rslowe@hormel.com
 T: (507)437-5674
 F: (507)437-9805

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)