

# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**PALASYN 45 [1469]**  
 Machine Id  
**SULLIVAN PALATEK 1812060012 - LKQ BEST AUTOMOTIVE**  
 Component  
**Compressor**

**DIAGNOSIS**

**Recommendation**

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

Moderate concentration of visible dirt/debris present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH06124990</b>	---	---
Sample Date	Client Info			<b>05 Feb 2024</b>	---	---
Machine Age	hrs	Client Info		<b>16571</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>Not Chngd</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	---	---


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>3</b>	---	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>1</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.0	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	0.0	<b>1</b>	---	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	0.0	<b>4</b>	---	---
Phosphorus	ppm	ASTM D5185m	966	<b>424</b>	---	---
Zinc	ppm	ASTM D5185m	0	<b>2</b>	---	---
Sulfur	ppm	ASTM D5185m	1309	<b>1045</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.24</b>	---	---

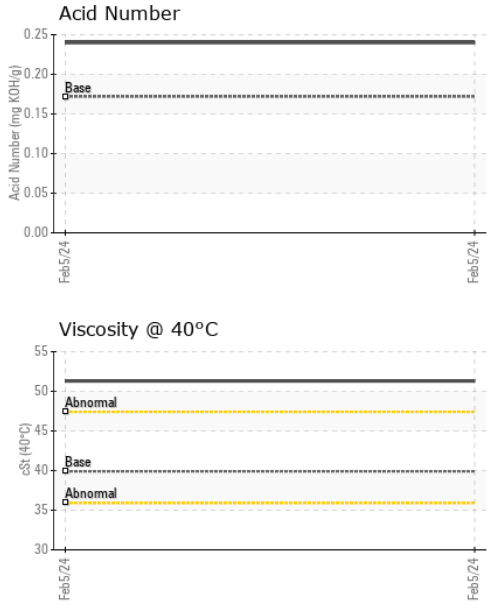

# OIL ANALYSIS REPORT







VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	MODER	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	39.9	<b>51.3</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

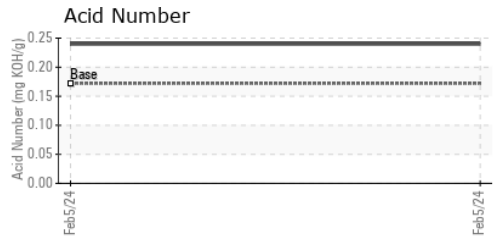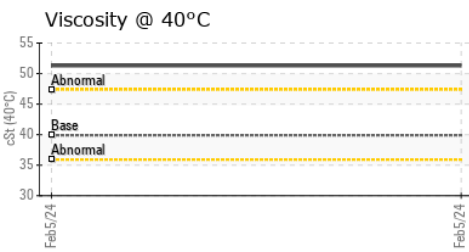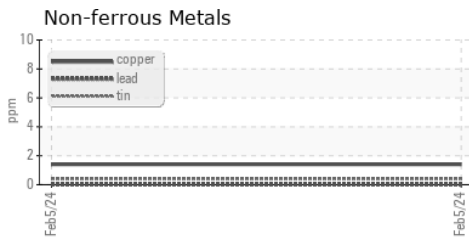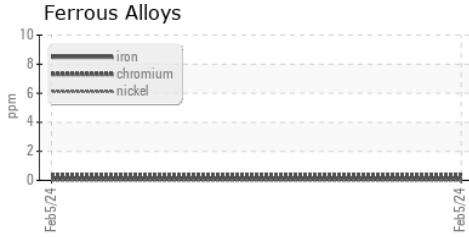

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06124990  
**Lab Number** : 06124990  
**Unique Number** : 10939141  
**Test Package** : IND 2

**Received** : 21 Mar 2024  
**Tested** : 22 Mar 2024  
**Diagnosed** : 24 Mar 2024 - Don Baldrige

**AIR SPECIALTY & EQUIPMENT COMPANY**  
 2814 EAST P ST  
 DEER PARK, TX  
 US 77536  
 Contact: AARON RIOS  
 oilsamples@airspecialty.com  
 T: (281)884-2335  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)