


OIL ANALYSIS REPORT

CN-3000 [1245] Machine Id SCHULTZ 0004093266

Component

Compressor





DIAGNOSIS

Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of visible silt present in the sample.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06124994		
Sample Date		Client Info		22 Feb 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	22		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	3		
Lead	ppm	ASTM D5185m	>25	20		
Copper	ppm	ASTM D5185m	>50	6		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		4		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		2		
Calcium	ppm	ASTM D5185m		25		
Phosphorus	ppm	ASTM D5185m		279		
Zinc	ppm	ASTM D5185m		286		
Sulfur	ppm	ASTM D5185m		1488		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.67		




OIL ANALYSIS REPORT

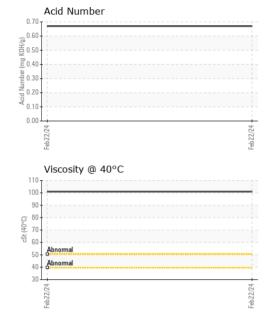


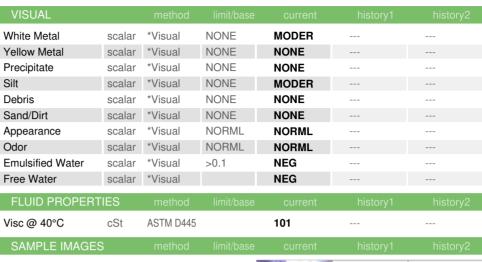


Color no image no image **Bottom** no image no image **GRAPHS**

Ferrous Alloys











Certificate L2367

Laboratory Sample No.

Test Package : IND 2

Lab Number : 06124994 Unique Number : 10939145

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06124994 Received **Tested**

Diagnosed

: 21 Mar 2024 : 22 Mar 2024 : 25 Mar 2024 - Don Baldridge

AIR SPECIALTY & EQUIPMENT COMPANY

2814 EAST P ST DEER PARK, TX US 77536

T: (281)884-2335

Contact: AARON RIOS oilsamples@airspecialty.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: