


Area  
**PALLUBE 32**  
Machine Id  
**SULLIVAN PALATEK 20ME001698 - SWIFT E BROOKS**  
Component  
**Compressor**

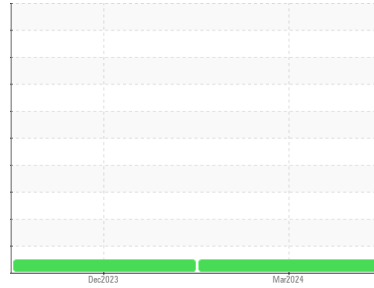

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCS06125009</b>	UCS06032404	---
Sample Date	Client Info			<b>04 Mar 2024</b>	01 Dec 2023	---
Machine Age	hrs	Client Info		<b>13612</b>	12662	---
Oil Age	hrs	Client Info		<b>0</b>	300	---
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	---


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>3</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	730	<b>407</b>	425	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	0.0	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	0	<b>&lt;1</b>	<1	---
Calcium	ppm	ASTM D5185m	0	<b>7</b>	<1	---
Phosphorus	ppm	ASTM D5185m	0	<b>7</b>	6	---
Zinc	ppm	ASTM D5185m	0	<b>7</b>	0	---
Sulfur	ppm	ASTM D5185m	590	<b>624</b>	787	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>116</b>	57	---
Potassium	ppm	ASTM D5185m	>20	<b>7</b>	4	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	<b>0.81</b>	0.185	---


# OIL ANALYSIS REPORT

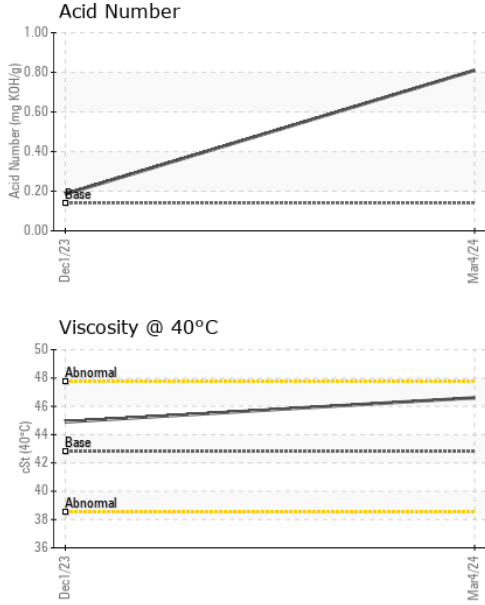





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	42.8	<b>46.6</b>	44.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

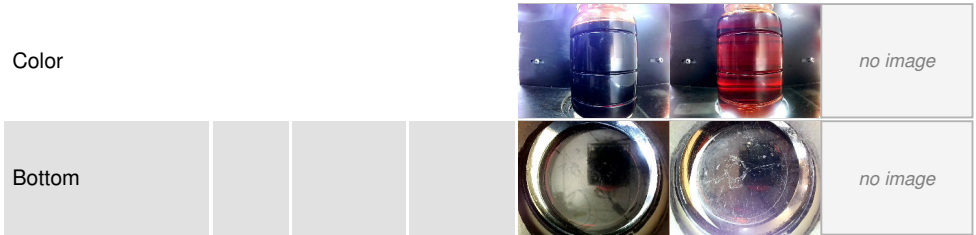

## GRAPHS

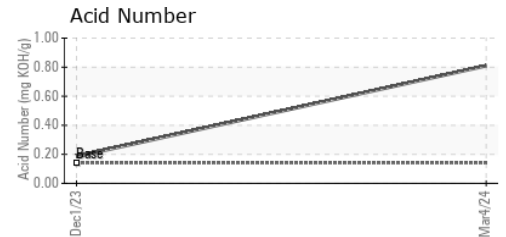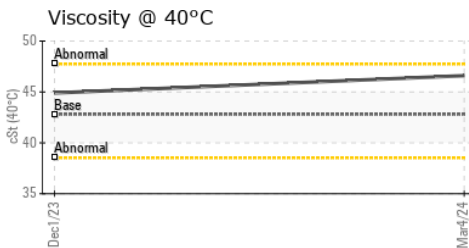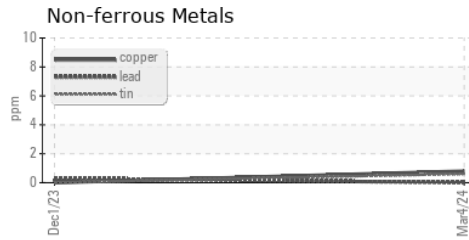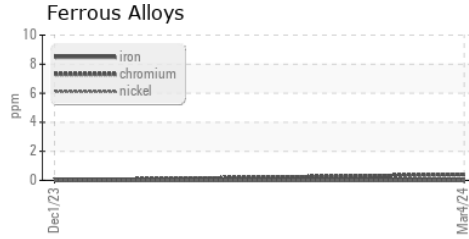

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06125009 **Received** : 21 Mar 2024  
**Lab Number** : **06125009** **Tested** : 25 Mar 2024  
**Unique Number** : 10939160 **Diagnosed** : 25 Mar 2024 - Sean Felton  
**Test Package** : IND 2

**BLAKE AND PENDLETON**

MEMPHIS, TN  
US 38133

Contact: JAY GIANNINI  
JGIANNINI@BLAKEANDPENDLETON.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: