


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id KAESER 5867643 - FITESA (S/N 1057)

Compressor

KAESER SIGMA (OEM) S-460 (30 GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec2021	Feb 2022	Aug2023 Jan2024	Mar2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0915409	WC0887724	WC0825990
Sample Date		Client Info		14 Mar 2024	16 Jan 2024	02 Aug 2023
Machine Age	hrs	Client Info		14419	13746	0
Oil Age	hrs	Client Info		1500	4000	0
Oil Changed		Client Info		Changed	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	3	0	0
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	9	10	7
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	2	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	<1	<1	5
Calcium	ppm	ASTM D5185m	2	3	1	0
Phosphorus	ppm	ASTM D5185m		10	0	3
Zinc	ppm	ASTM D5185m		1	0	0
Sulfur	ppm	ASTM D5185m		16658	15091	18157
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		0	<1	2
Potassium	ppm	ASTM D5185m	>20	1	0	1
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.40

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.36


0.36



OIL ANALYSIS REPORT



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.8	45.0	44.9
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					a	P. C.

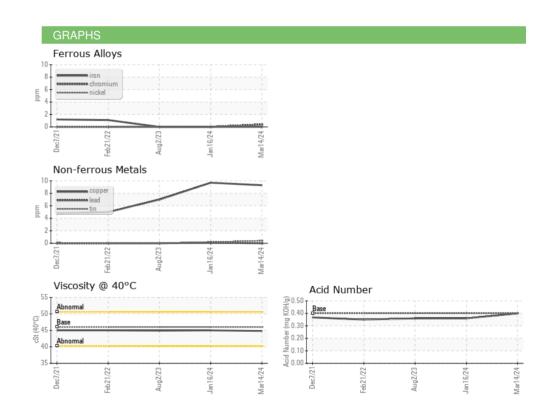





Certificate L2367

Laboratory Sample No.

Test Package : IND 2

: WC0915409 Lab Number : 06125048 Unique Number: 10939199

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 21 Mar 2024

Tested : 22 Mar 2024 Diagnosed : 24 Mar 2024 - Don Baldridge

ELEVATED INDUSTRIAL SOLUTIONS - EIS

302 HUGHES ST FOUNTAIN INN, SC

US 29644

Contact: DARRIN WARD

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Bottom

dward@elevatedindustrial.com T:

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (864)862-7653

Report Id: PALFOU [WUSCAR] 06125048 (Generated: 03/24/2024 12:53:00) Rev: 1

Contact/Location: DARRIN WARD - PALFOU