




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

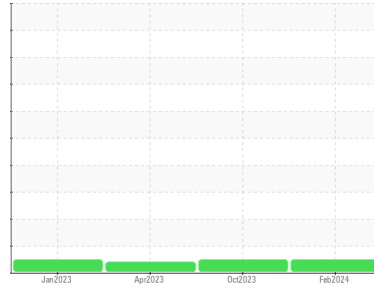

Area

**[2446]**

Machine Id

**KAESER 8458079 - SARGENT METAL PABRICATO (S/N 1949)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) S-460 (4 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0887832</b>	WC0679493	WC0795130
Sample Date	Client Info		<b>12 Feb 2024</b>	17 Oct 2023	06 Apr 2023
Machine Age	hrs	Client Info	<b>7052</b>	5968	3210
Oil Age	hrs	Client Info	<b>7052</b>	850	2433
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	1
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>3</b>	0	0
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>15</b>	11	12
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>2</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 90	<b>2</b>	2	2
Calcium	ppm	ASTM D5185m 2	<b>3</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>5</b>	0	0
Zinc	ppm	ASTM D5185m	<b>2</b>	3	0
Sulfur	ppm	ASTM D5185m	<b>19454</b>	15337	16317

## CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>0</b>	4	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	2	<1

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.28</b>	0.28	0.28




# OIL ANALYSIS REPORT

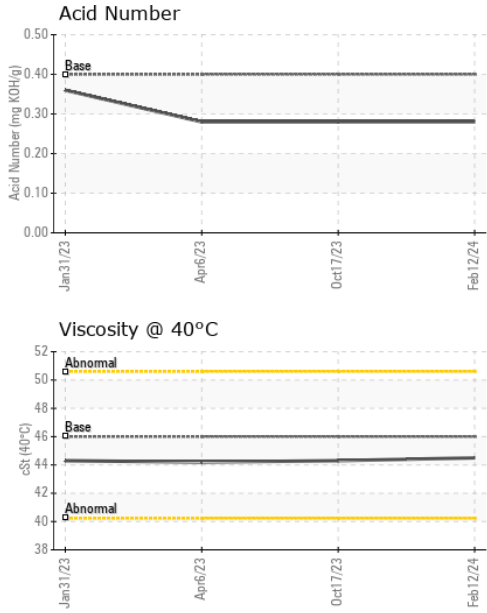



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.3	44.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

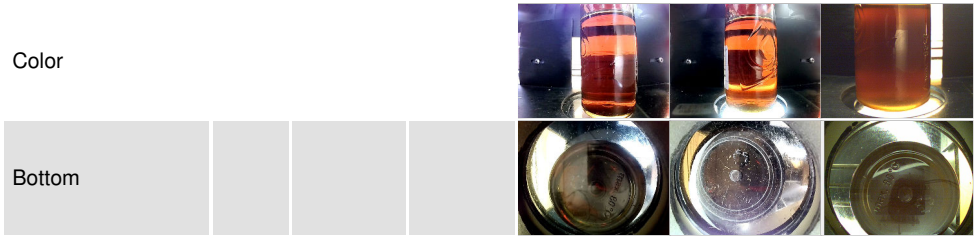

## GRAPHS

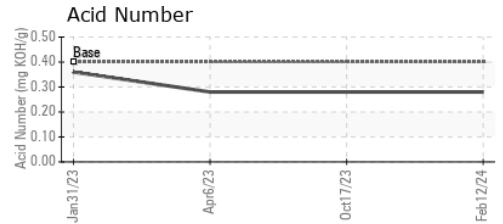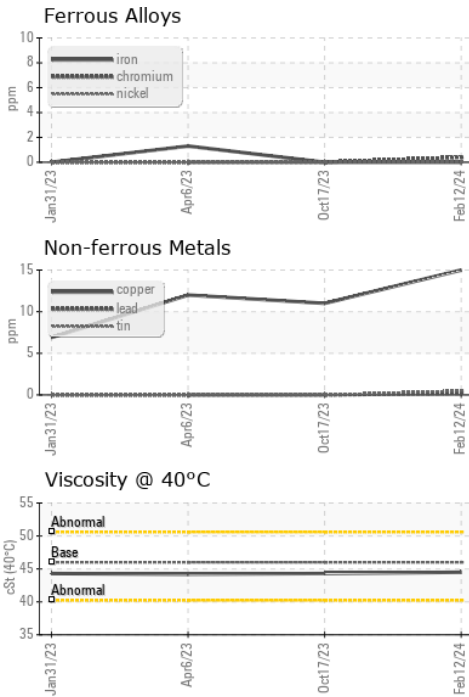

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0887832  
**Lab Number** : 06125053  
**Unique Number** : 10939204  
**Test Package** : IND 2

**Received** : 21 Mar 2024  
**Tested** : 22 Mar 2024  
**Diagnosed** : 24 Mar 2024 - Don Baldrige

**ELEVATED INDUSTRIAL SOLUTIONS - EIS**  
 302 HUGHES ST  
 FOUNTAIN INN, SC  
 US 29644  
 Contact: DARRIN WARD  
 dward@elevatedindustrial.com  
 T:  
 F: (864)862-7653

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)