




# OIL ANALYSIS REPORT

Sample Rating Trend

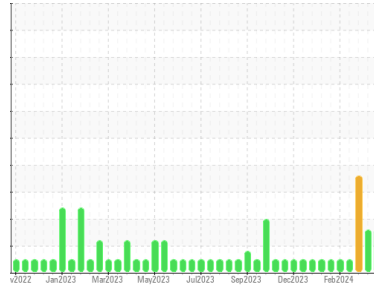

**WEAR**



Machine Id  
**Grand Blanc CAT 3 GBLM03BE**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend an early resample to monitor this condition. ( Customer Sample Comment: 800hr Oil Sample )

### Wear

The iron level is abnormal. The copper level is abnormal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0905729</b>	WC0905732	WC0905683
Sample Date	Client Info		<b>19 Mar 2024</b>	12 Mar 2024	05 Mar 2024
Machine Age	hrs	Client Info	<b>82267</b>	82199	82037
Oil Age	hrs	Client Info	<b>800</b>	839	680
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	0.0

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>15	<b>▲ 16</b>	▲ 16	▲ 17
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>6	<b>3</b>	2	1
Lead	ppm	ASTM D5185m	>9	<b>6</b>	6	▲ 7
Copper	ppm	ASTM D5185m	>14	<b>▲ 17</b>	▲ 16	▲ 12
Tin	ppm	ASTM D5185m	>4	<b>2</b>	2	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>12</b>	13	16
Barium	ppm	ASTM D5185m		<b>1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>9</b>	8	9
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>25</b>	14	10
Calcium	ppm	ASTM D5185m		<b>1878</b>	1698	1513
Phosphorus	ppm	ASTM D5185m		<b>288</b>	274	245
Zinc	ppm	ASTM D5185m		<b>372</b>	343	282
Sulfur	ppm	ASTM D5185m		<b>3901</b>	3499	2639

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>181	<b>112</b>	105	80
Sodium	ppm	ASTM D5185m		<b>64</b>	66	80
Potassium	ppm	ASTM D5185m	>20	<b>5</b>	3	2

## INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.5</b>	6.3	6.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>23.8</b>	23.5	23.1


## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>16.5</b>	16.0	14.3
Acid Number (AN)	mg KOH/g	ASTM D8045	1.1	<b>2.743</b>	1.85	1.56
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	<b>2.83</b>	2.59	3.18




# OIL ANALYSIS REPORT


## ▲ Non-ferrous Metals

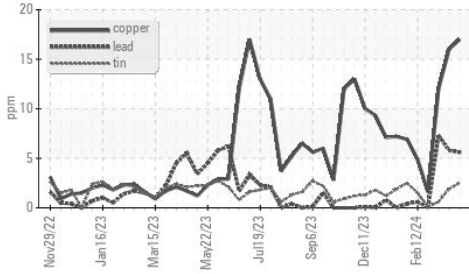


## ▲ Ferrous Alloys

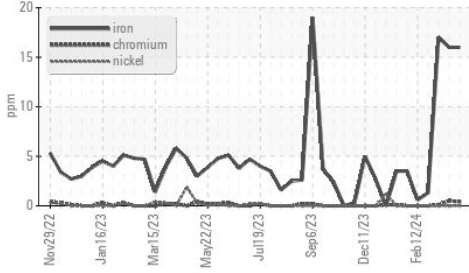


## Acid Number

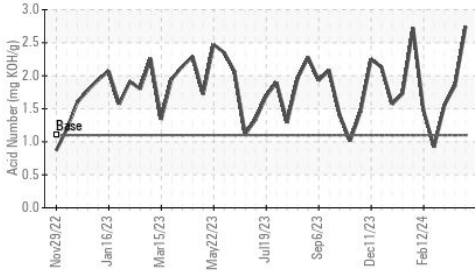

## Base Number

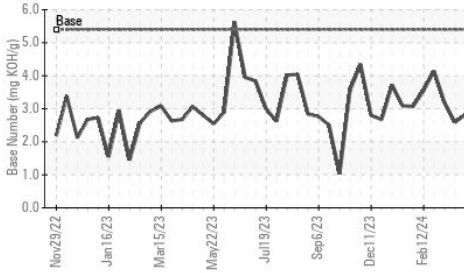

## Viscosity @ 100°C

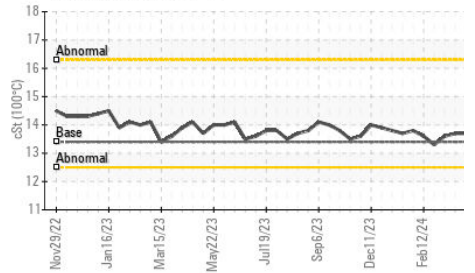


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.7	13.6

## GRAPHS


### ▲ Iron (ppm)

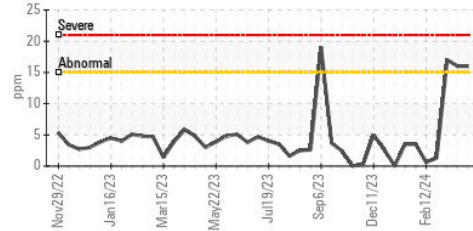


### Aluminum (ppm)

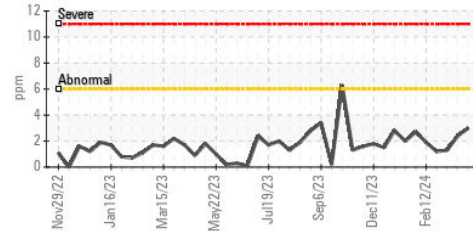


### ▲ Copper (ppm)

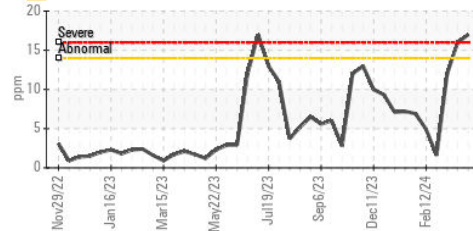


### Viscosity @ 100°C

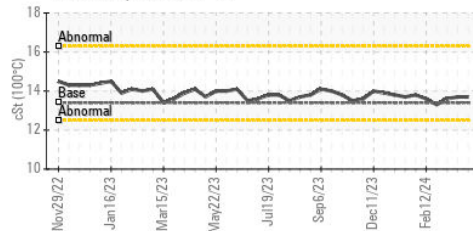


### Lead (ppm)

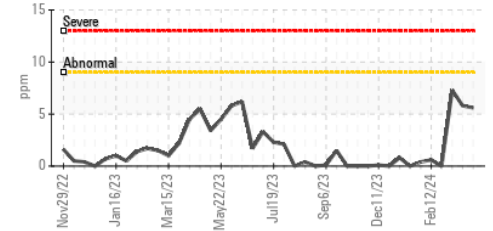


### Chromium (ppm)

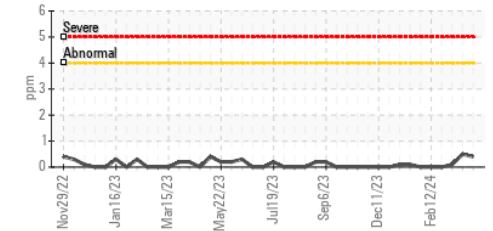

### Silicon (ppm)

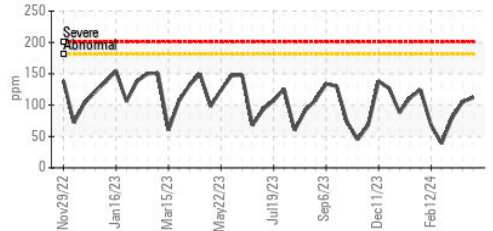

### Base Number

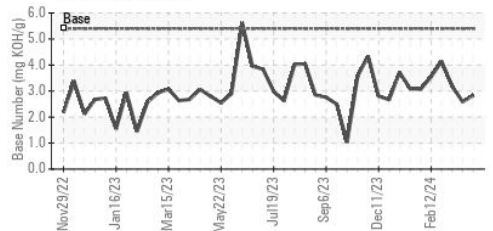

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0905729  
 Lab Number : 06125106  
 Unique Number : 10939257  
 Test Package : MOB 2

Received : 21 Mar 2024  
 Tested : 25 Mar 2024  
 Diagnosed : 25 Mar 2024 - Sean Felton

**EDL NA Recips-Grand Blanc**  
 Grand Blanc Powerstation, 2361 West Grand Blanc Road  
 Grand Blanc, MI  
 US 48439

Contact: Tony Saint Marie  
 tony.saintmarie@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: