




OIL ANALYSIS REPORT

Sample Rating Trend

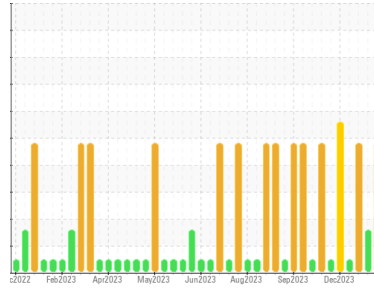

DIRT



Machine Id
ZOKM02BE (S/N GZJ00540)
 Component
Biogas Engine
 Fluid
SHELL MYSELLA S5 S (160 GAL)

DIAGNOSIS

▲ Recommendation
 Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Wear
 All component wear rates are normal.

▲ Contamination
 Elemental level of silicon (Si) above normal.

Fluid Condition
 The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The oil is no longer serviceable due to the presence of contaminants.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0775206	WC0675547	WC0675545
Sample Date	Client Info		11 Mar 2024	14 Feb 2024	10 Jan 2024
Machine Age	hrs	Client Info	82287	82537	81887
Oil Age	hrs	Client Info	425	279	609
Oil Changed	Client Info		Changed	Changed	Not Changed
Sample Status			SEVERE	ABNORMAL	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>15	7	6	3
Chromium	ppm	ASTM D5185m	>4	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	<1	0	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>6	3	2	4
Lead	ppm	ASTM D5185m	>9	1	<1	0
Copper	ppm	ASTM D5185m	>6	3	2	2
Tin	ppm	ASTM D5185m	>4	4	4	4
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		4	3	0
Barium	ppm	ASTM D5185m		1	10	0
Molybdenum	ppm	ASTM D5185m		7	4	5
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m		27	19	29
Calcium	ppm	ASTM D5185m		1582	1397	1556
Phosphorus	ppm	ASTM D5185m	300	326	374	349
Zinc	ppm	ASTM D5185m		416	361	439
Sulfur	ppm	ASTM D5185m		3950	3998	3606

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>181	▲ 226	▲ 197	▲ 246
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	2	<1	0

INFRA-RED





	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0.1	0	0
Nitration	Abs/cm	*ASTM D7624	>20	4.1	3.7	4.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	21.9	21.1	24.4

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	13.2	12.0	16.3
Acid Number (AN)	mg KOH/g	ASTM D8045		1.58	1.26	2.61
Base Number (BN)	mg KOH/g	ASTM D2896	5.3	3.48	2.82	3.24











OIL ANALYSIS REPORT

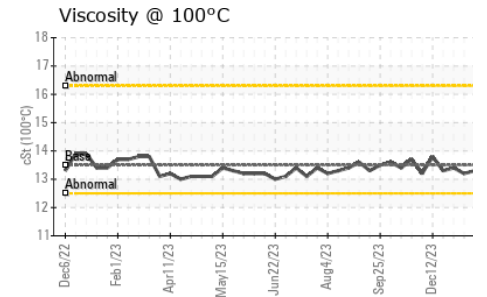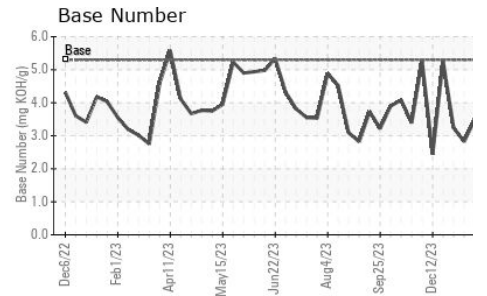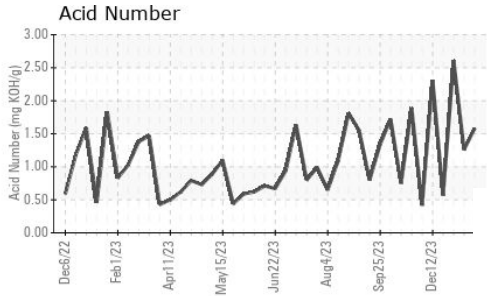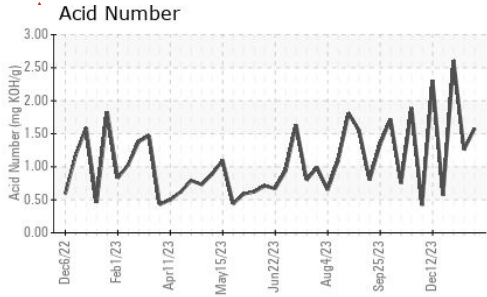

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.5	13.3	13.2

GRAPHS

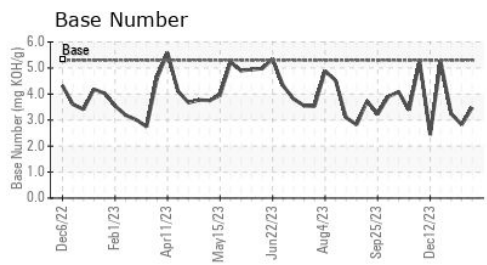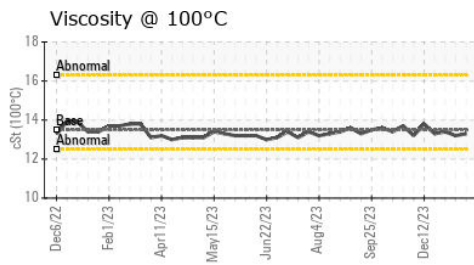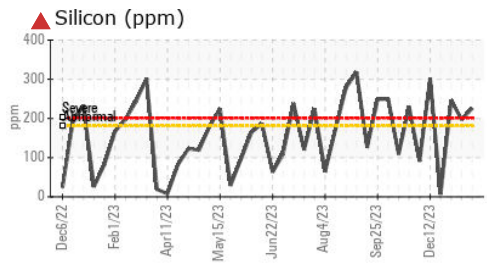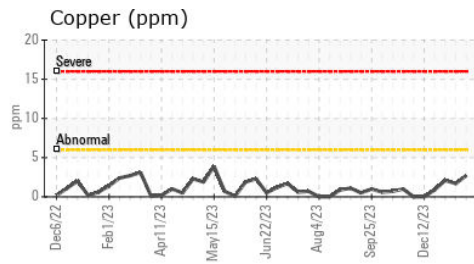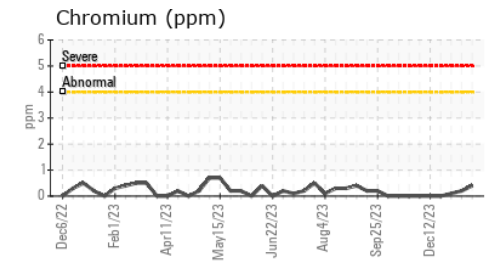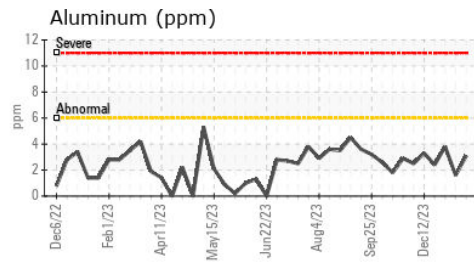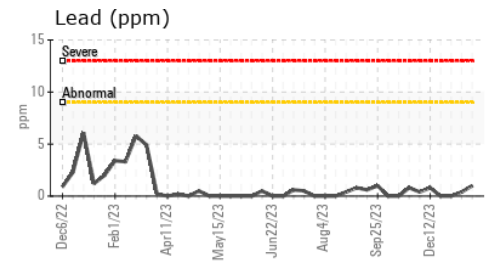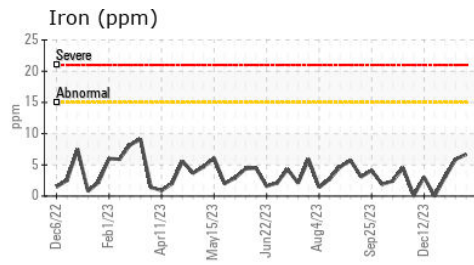

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0775206
Lab Number : 06125113
Unique Number : 10939264
Test Package : MOB 2

Received : 21 Mar 2024
Tested : 25 Mar 2024
Diagnosed : 25 Mar 2024 - Sean Felton

EDL NA Recips-Zook
 Zook Powerstation, 388 E. Main Street
 Leola, PA
 US 17540-1925
 Contact: Kevin Johnson
 kevin.johnson@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)