




# OIL ANALYSIS REPORT

Sample Rating Trend

DIRT



Machine Id  
**JENBACHER GM02 (S/N 1144713)**  
 Component  
**Biogas Engine**  
 Fluid  
**MAHLER Q8 Mahler G8 SAE 40 (--- GAL)**

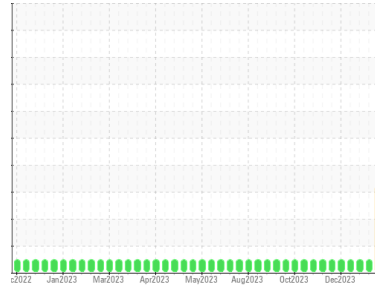

## DIAGNOSIS

### ▲ Recommendation

Resample at the next service interval to monitor.

### ▲ Wear

The iron level is abnormal. The tin level is abnormal.

### ▲ Contamination

Elemental level of silicon (Si) above normal.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0880421</b>	WC0880418	WC0880408
Sample Date	Client Info		<b>20 Mar 2024</b>	14 Mar 2024	24 Jan 2024
Machine Age	hrs	Client Info	<b>49678</b>	49541	49223
Oil Age	hrs	Client Info	<b>7658</b>	7521	7203
Oil Changed	Client Info		<b>N/A</b>	N/A	Not Changd
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>▲ 20</b>	13	8
Chromium	ppm	ASTM D5185m >5	<b>2</b>	1	<1
Nickel	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >15	<b>10</b>	6	5
Lead	ppm	ASTM D5185m >20	<b>2</b>	<1	2
Copper	ppm	ASTM D5185m >15	<b>12</b>	7	3
Tin	ppm	ASTM D5185m >5	<b>▲ 10</b>	6	7
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>1</b>	0	<1
Barium	ppm	ASTM D5185m	<b>2</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>3</b>	2	2
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>15</b>	10	0
Calcium	ppm	ASTM D5185m	<b>3891</b>	2437	2373
Phosphorus	ppm	ASTM D5185m	<b>638</b>	440	420
Zinc	ppm	ASTM D5185m	<b>815</b>	535	504
Sulfur	ppm	ASTM D5185m	<b>4734</b>	2993	2616

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >200	<b>▲ 221</b>	160	131
Sodium	ppm	ASTM D5185m >20	<b>26</b>	16	18
Potassium	ppm	ASTM D5185m >20	<b>19</b>	11	10

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >2	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>8.5</b>	8.6	8.8
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>20.3</b>	20.5	21.5


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>14.7</b>	14.7	16.0
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>1.24</b>	1.16	3.5
Base Number (BN)	mg KOH/g	ASTM D2896 8.0	<b>6.21</b>	6.16	6.05




# OIL ANALYSIS REPORT


## ▲ Non-ferrous Metals

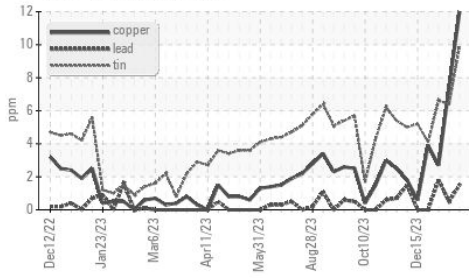


## ▲ Ferrous Alloys

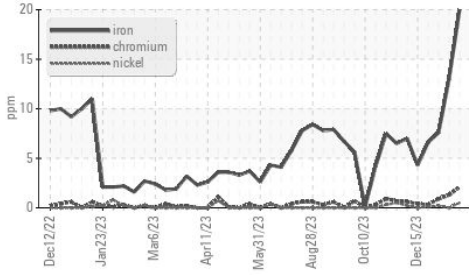


## ● Acid Number

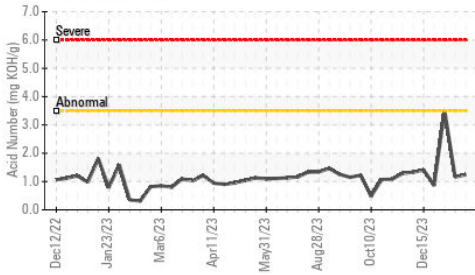

## ● Acid Number

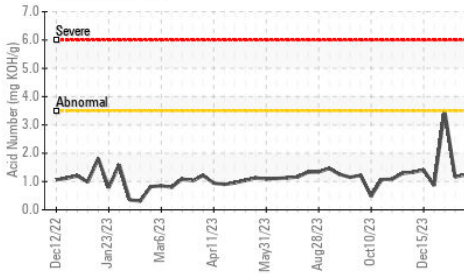

## ● Base Number

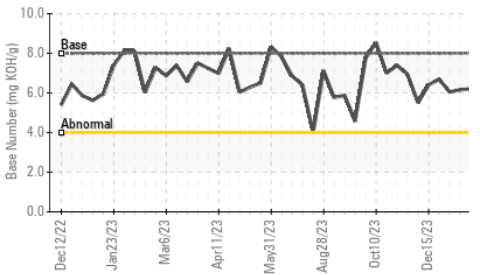


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.2	14.1	13.9

## GRAPHS


### ▲ Iron (ppm)

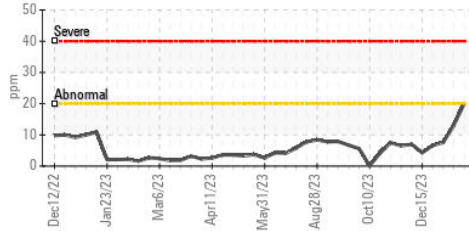


### Aluminum (ppm)

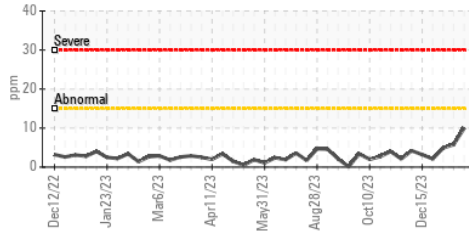


### Copper (ppm)

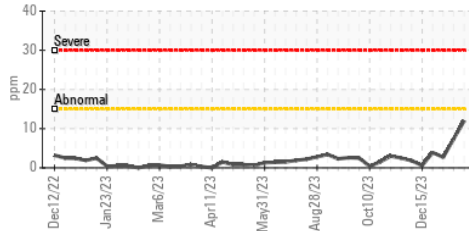


### Viscosity @ 100°C

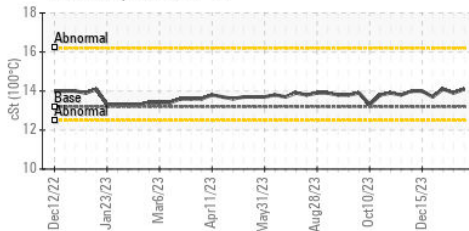


### Lead (ppm)

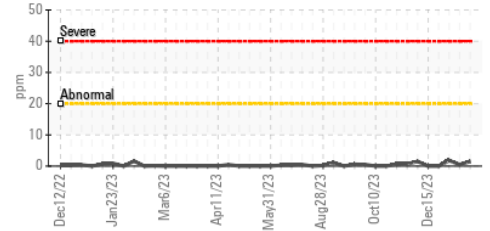


### Chromium (ppm)

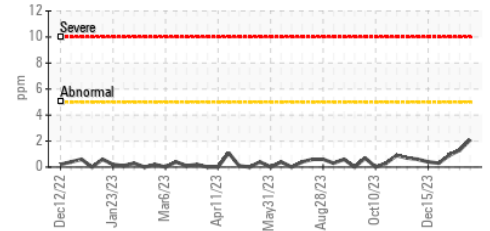

### ▲ Silicon (ppm)

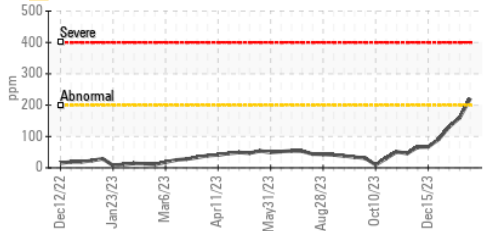

### Base Number

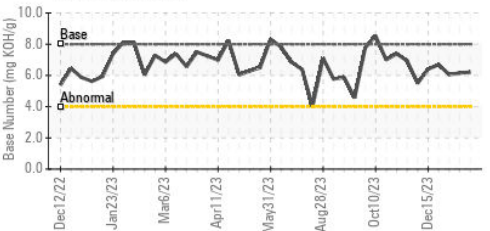

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0880421

Lab Number : 06125118

Unique Number : 10939269

Test Package : MOB 2

Received : 21 Mar 2024

Tested : 26 Mar 2024

Diagnosed : 26 Mar 2024 - Jonathan Hester

PINE RIDGE

105 BAILEY JESTER RD

GRIFFIN, GA

US 30224

Contact: STEPHEN SAVAGE

stephen.savage@cubedistrictenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)