



# OIL ANALYSIS REPORT

Sample Rating Trend

ADDITIVES

Area  
**MAGENTA NTX [200007685]**  
 Machine Id  
**02WEA91148**  
 Component  
**Hydraulic System**  
 Fluid  
**SHELL TELLUS S4 VX 32 (--- LTR)**



## DIAGNOSIS

- Recommendation**  
No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**  
All component wear rates are normal.
- Contamination**  
There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.
- Fluid Condition**  
Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>NX012241</b>	---	---
Sample Date	Client Info		<b>09 Feb 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ATTENTION</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>13</b>	---	---
Iron	ppm	ASTM D5185m >20	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >20	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m >20	<b>11</b>	---	---
Tin	ppm	ASTM D5185m >20	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>6</b>	---	---
Calcium	ppm	ASTM D5185m	<b>22</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>366</b>	---	---
Zinc	ppm	ASTM D5185m	<b>189</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>6206</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<b>1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Water	%	ASTM D6304 >0.05	<b>0.002</b>	---	---
ppm Water	ppm	ASTM D6304 >500	<b>25</b>	---	---

## FLUID CLEANLINESS




	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>9683</b>	---	---
Particles >6µm	ASTM D7647 >1300		<b>2047</b>	---	---
Particles >14µm	ASTM D7647 >160		<b>148</b>	---	---
Particles >21µm	ASTM D7647 >40		<b>36</b>	---	---
Particles >38µm	ASTM D7647 >10		<b>3</b>	---	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c) >17/14		<b>18/14</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.34</b>	---	---



# OIL ANALYSIS REPORT

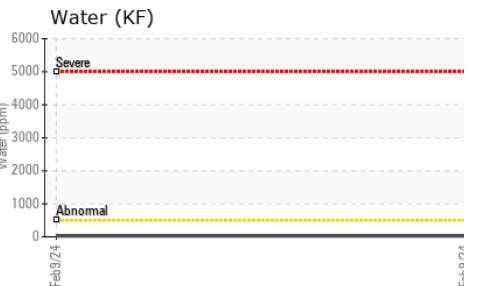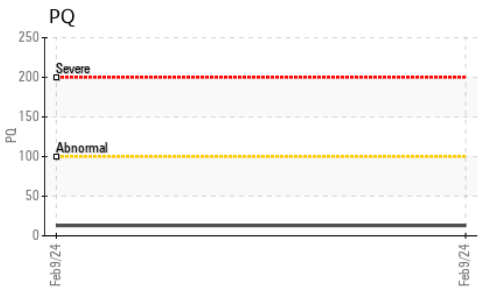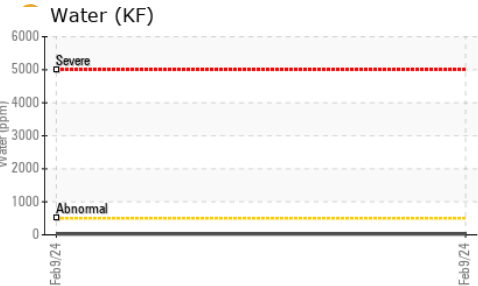





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	33.8	29.3	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

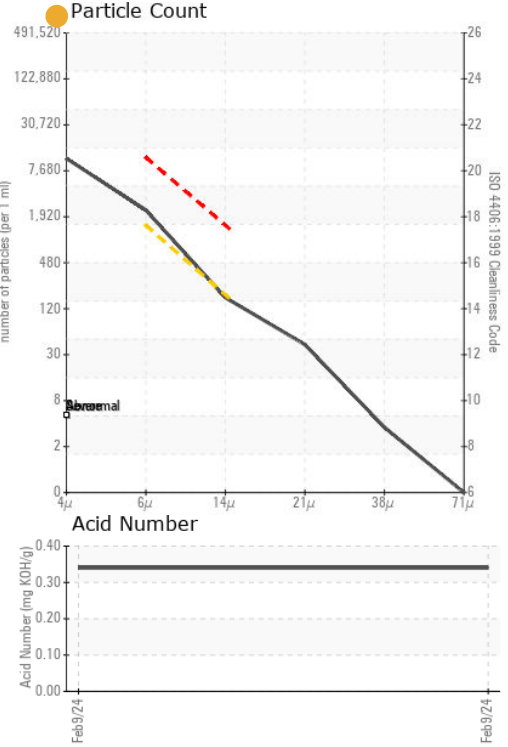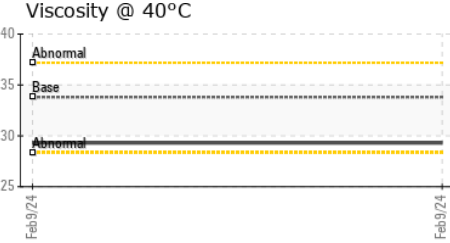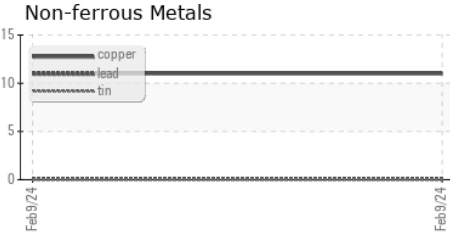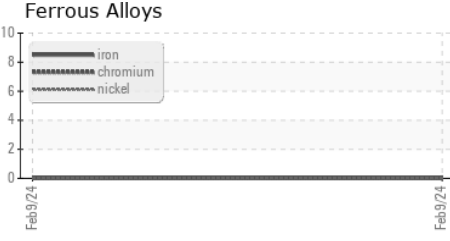

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : NX012241 **Received** : 21 Mar 2024  
**Lab Number** : **06125647** **Tested** : 22 Mar 2024  
**Unique Number** : 10939798 **Diagnosed** : 25 Mar 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PQ )

**NORDEX USA - Chicago**  
 300 SOUTH WACKER DRIVE, SUITE 1500  
 CHICAGO, IL  
 US 60606  
 Contact: DEVIN LINEHAN  
 DLinehan@nordex-online.com  
 T: (312)386-4124  
 F: (312)386-7102

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)