




# OIL ANALYSIS REPORT

Sample Rating Trend

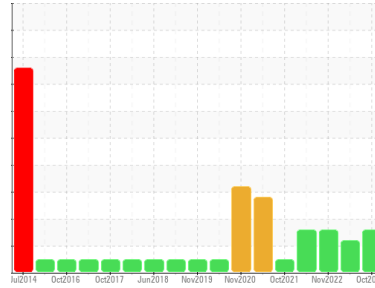

ISO



Machine Id  
**KAESER ASD 25T 4101564 (S/N 1006)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA007529</b>	KCPA003455	KCP47875D
Sample Date	Client Info		<b>16 Oct 2023</b>	12 Jun 2023	18 Nov 2022
Machine Age	hrs	Client Info	<b>51820</b>	50185	47738
Oil Age	hrs	Client Info	<b>0</b>	0	3123
Oil Changed	Client Info		<b>N/A</b>	N/A	Changed
Sample Status			<b>ATTENTION</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	2	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>2</b>	1	2
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	6	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>62</b>	61	74
Calcium	ppm	ASTM D5185m 2	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	3
Zinc	ppm	ASTM D5185m	<b>0</b>	6	3
Sulfur	ppm	ASTM D5185m	<b>21323</b>	18573	20764

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>22</b>	16	14
Potassium	ppm	ASTM D5185m >20	<b>4</b>	3	8
Water	%	ASTM D6304 >0.05	<b>0.017</b>	0.025	0.027
ppm Water	ppm	ASTM D6304 >500	<b>174</b>	251.8	272.1






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>6351</b>	16228	4152
Particles >6µm	ASTM D7647 >1300		<b>1648</b>	3276	1652
Particles >14µm	ASTM D7647 >80		<b>113</b>	121	195
Particles >21µm	ASTM D7647 >20		<b>25</b>	19	55
Particles >38µm	ASTM D7647 >4		<b>0</b>	0	4
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>20/18/14</b>	21/19/14	19/18/15

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.37</b>	0.36	0.33


# OIL ANALYSIS REPORT

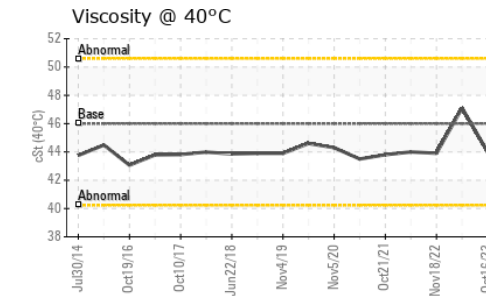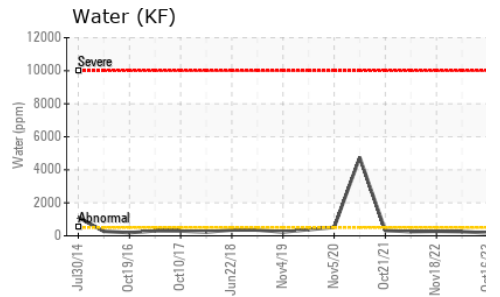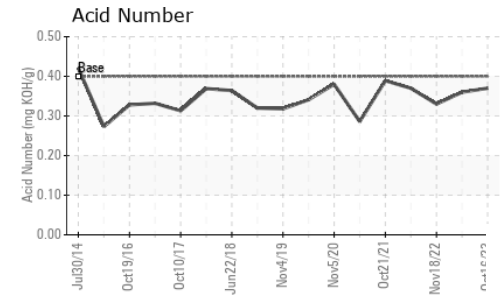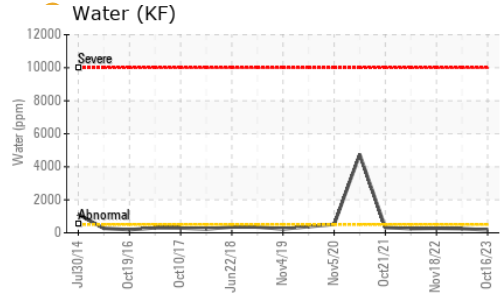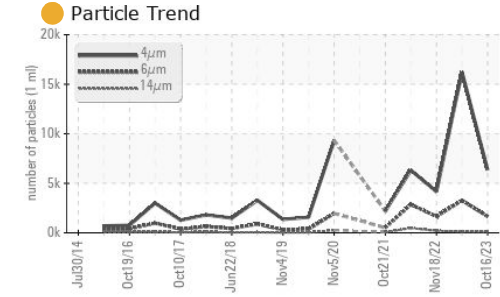





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.0	47.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

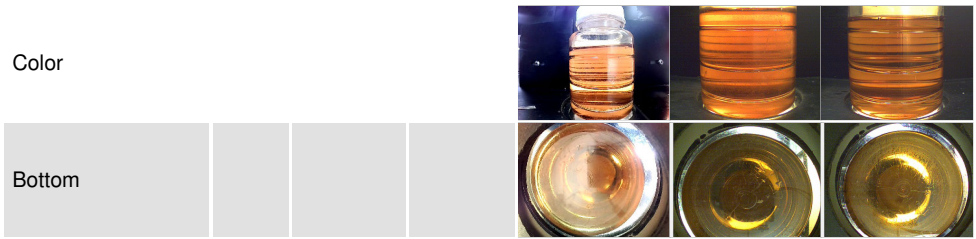

## GRAPHS

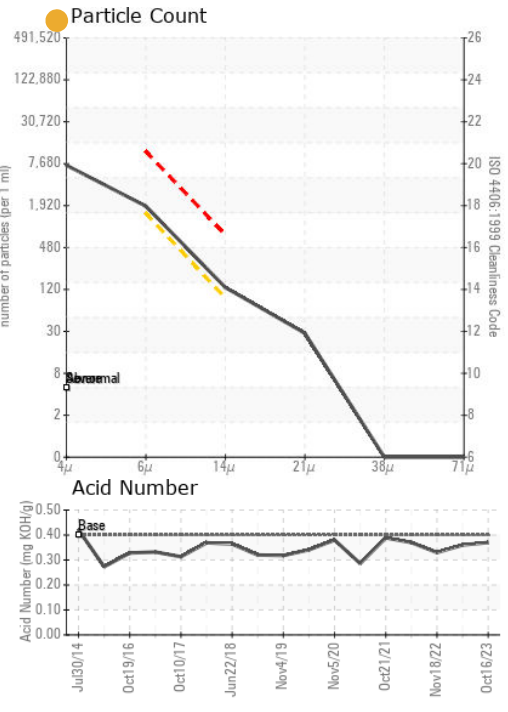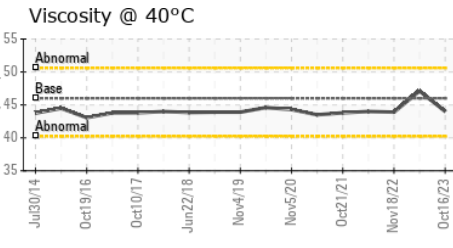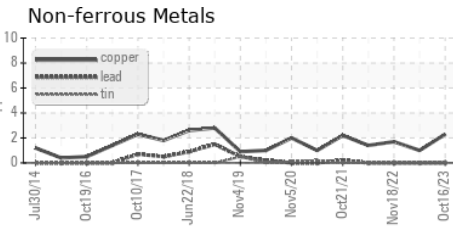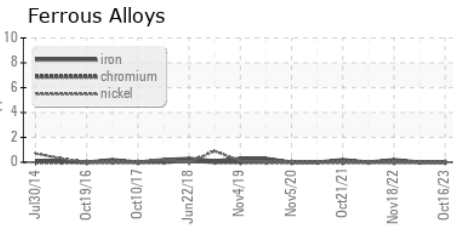

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA007529  
**Lab Number** : 06125683  
**Unique Number** : 10939834  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON**  
 1515 LAUDERDALE MEMORIAL HWY  
 CHARLESTON, TN  
 US 37310  
 Contact: CURTIS  
 curtisdu@amazon.com

**Received** : 21 Mar 2024  
**Tested** : 22 Mar 2024  
**Diagnosed** : 25 Mar 2024 - Don Baldrige

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)