

# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



# KAESER CSD 75 4480966 (S/N 1100)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Jan2015 No	2015 May2018 May2019	May2020 Jul2021 May2022 Jan202	3 Aug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA002956	KCP49210	KCP59215
Sample Date		Client Info		18 Aug 2023	17 Jan 2023	25 May 2022
Machine Age	hrs	Client Info		68580	67647	64137
Oil Age	hrs	Client Info		0	3330	10720
Oil Changed		Client Info		N/A	Not Changd	Changed
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	<1
Aluminum	ppm	ASTM D5185m	>10	0	1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	3	8
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	0	45	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	90	20	56	0
Calcium	ppm	ASTM D5185m	2	0	<1	0
Phosphorus	ppm	ASTM D5185m		0	10	5
Zinc	ppm	ASTM D5185m		0	4	0
Sulfur	ppm	ASTM D5185m		20488	17467	12734
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	0
Sodium	ppm	ASTM D5185m		3	3	<1
Potassium	ppm	ASTM D5185m	>20	0	1	0
Water	%	ASTM D6304	>0.05	0.015	0.019	0.005
ppm Water	ppm	ASTM D6304	>500	153	190.6	53.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1066	11015	
Particles >6µm		ASTM D7647	>1300	317	<u>4130</u>	
Particles >14µm		ASTM D7647	>80	20	<u>434</u>	
Particles >21µm		ASTM D7647	>20	6	<u></u> 107	
Particles >38μm		ASTM D7647	>4	0	5	
Particles >71µm		ASTM D7647	>3	0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/11	<u>^</u> 21/19/16	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	та КОЦ/а	VCTM DOUVE	0.4	0.20	0.25	0.25

Acid Number (AN)

0.35



## **OIL ANALYSIS REPORT**

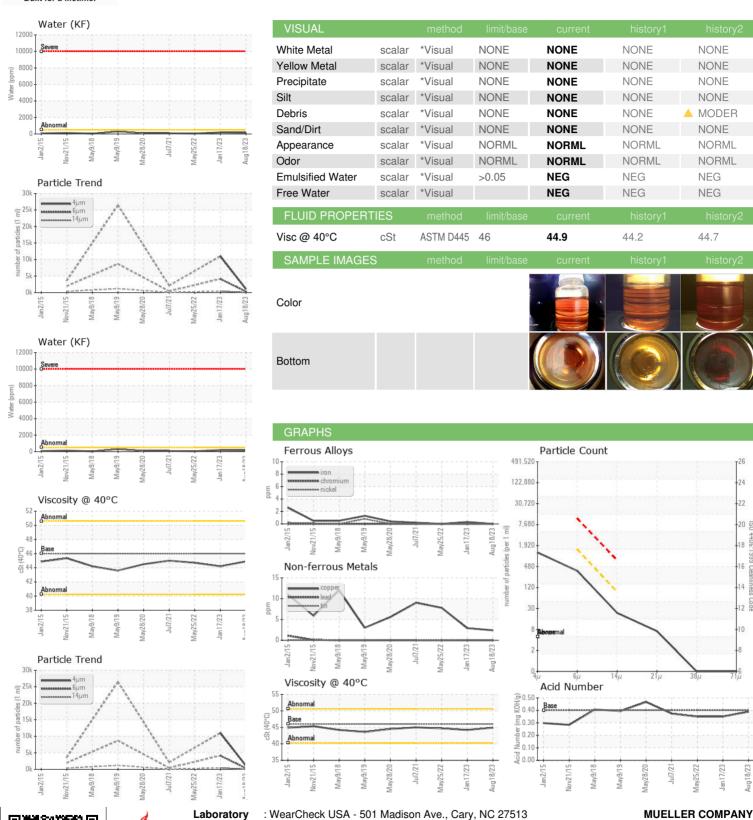





Laboratory Sample No. Lab Number

: KCPA002956 : 06125684

Unique Number: 10939835

Diagnosed

Test Package: IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: 21 Mar 2024

: 22 Mar 2024

: 25 Mar 2024 - Don Baldridge

Received

**Tested** 

US 37406

Contact:

T: F:

1401 MUELLER DR

CHATTANOOGA, TN