




OIL ANALYSIS REPORT

Sample Rating Trend

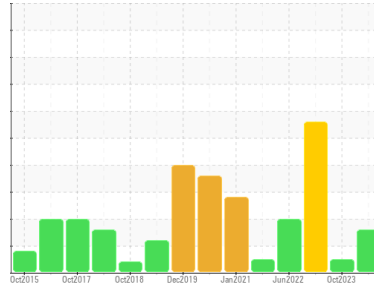

ISO



Machine Id
KAESER SX 5 5351313 (S/N 1392)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA013926	KCPA003760	KCP54854
Sample Date	Client Info		13 Mar 2024	12 Oct 2023	27 Jan 2023
Machine Age	hrs	Client Info	65230	65218	59030
Oil Age	hrs	Client Info	12	0	19
Oil Changed	Client Info		Changed	N/A	Not Changd
Sample Status			ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	<1	9	5
Tin	ppm	ASTM D5185m >10	0	<1	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	46	0	2
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 100	67	3	43
Calcium	ppm	ASTM D5185m 0	2	1	<1
Phosphorus	ppm	ASTM D5185m 0	0	2	9
Zinc	ppm	ASTM D5185m 0	4	6	29
Sulfur	ppm	ASTM D5185m 23500	22661	18445	20903

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	<1	<1
Sodium	ppm	ASTM D5185m	9	2	2
Potassium	ppm	ASTM D5185m >20	0	0	0
Water	%	ASTM D6304 >0.05	0.014	0.004	▲ 0.150
ppm Water	ppm	ASTM D6304 >500	145	45.2	▲ 1500






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		24185	2640	15216
Particles >6µm	ASTM D7647	>1300	▲ 6132	616	▲ 4037
Particles >14µm	ASTM D7647	>80	▲ 335	37	▲ 220
Particles >21µm	ASTM D7647	>20	▲ 61	11	▲ 52
Particles >38µm	ASTM D7647	>4	0	0	2
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/16	19/16/12	▲ 21/19/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.642	0.37	0.373

OIL ANALYSIS REPORT

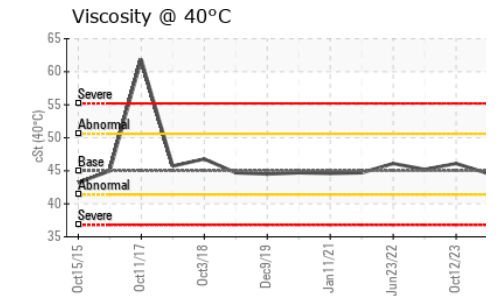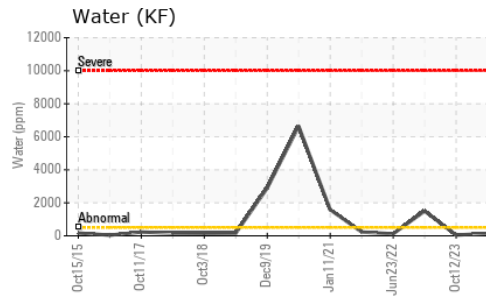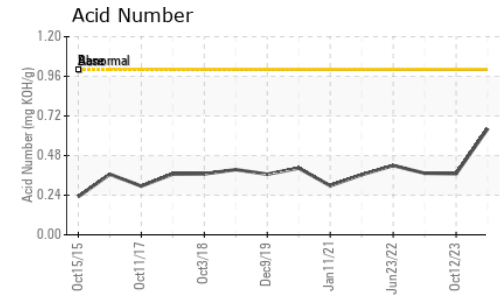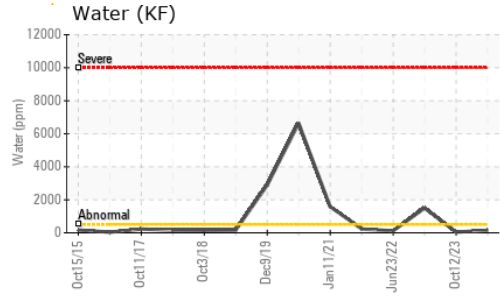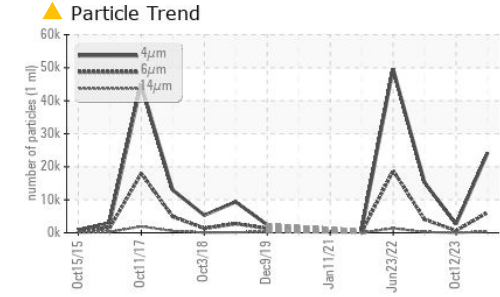






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	>10%

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	44.6	46.1	45.2

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

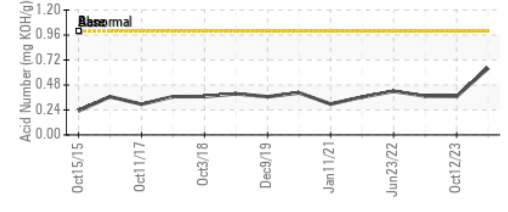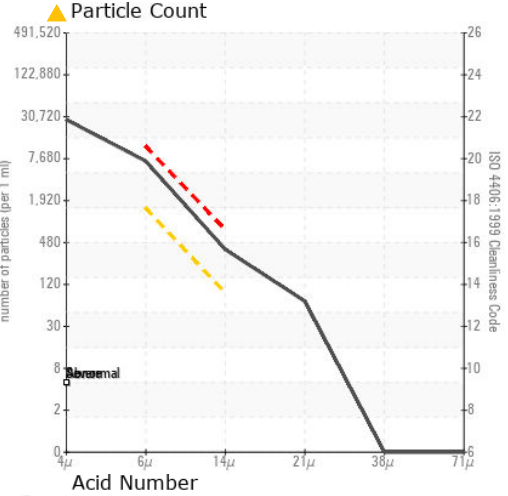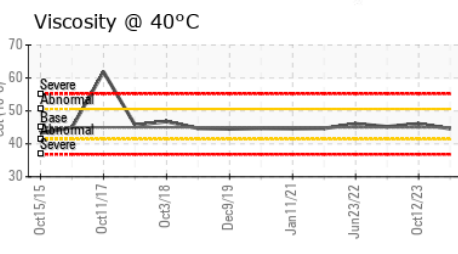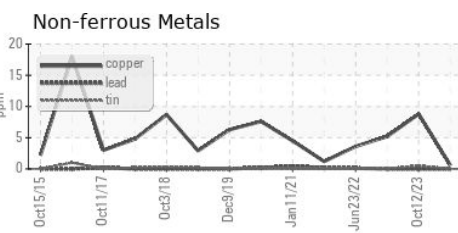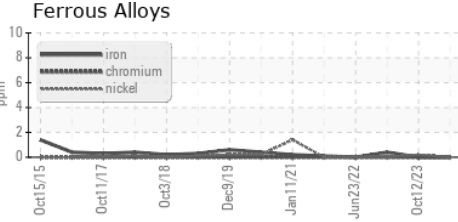

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA013926 **Received** : 21 Mar 2024
Lab Number : 06125689 **Tested** : 25 Mar 2024
Unique Number : 10939840 **Diagnosed** : 25 Mar 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

FINE LINE GRAPHICS INC
 8229 MELROSE DR
 LENEXA, KS
 US 66214
 Contact: M. DECKER
 mdecker@flgcorp.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)