


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

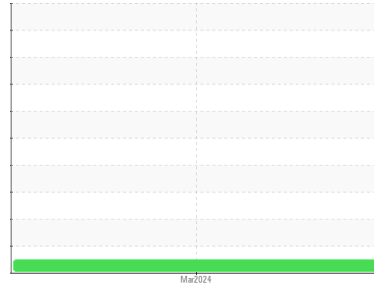

Area  
**ROTO XTEND [418071]**  
 Machine Id  
**ATLAS COPCO API333920**  
 Component  
**Compressor**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>UCH06125757</b>	---	---
Sample Date	Client Info	<b>21 Mar 2024</b>	---	---
Machine Age	hrs Client Info	<b>39357</b>	---	---
Oil Age	hrs Client Info	<b>10933</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>NORMAL</b>	---	---

**CONTAMINATION** method limit/base current history1 history2

Water	WC Method	>0.1	<b>NEG</b>	---	---
-------	-----------	------	------------	-----	-----

**WEAR METALS** method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>65	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>65	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

**ADDITIVES** method limit/base current history1 history2

Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	---	---
Calcium	ppm	ASTM D5185m		<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>20</b>	---	---
Zinc	ppm	ASTM D5185m		<b>47</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>40</b>	---	---


**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>35	<b>1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>3</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---

**FLUID DEGRADATION** method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	<b>0.28</b>	---	---
------------------	----------	------------	------	-------------	-----	-----

# OIL ANALYSIS REPORT

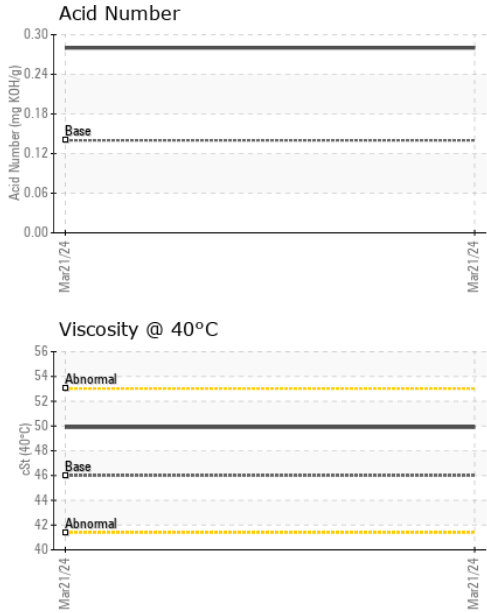




VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>49.9</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

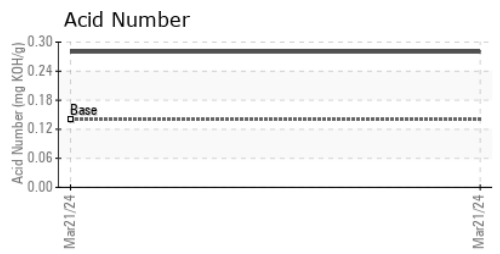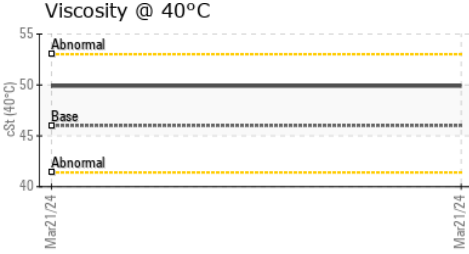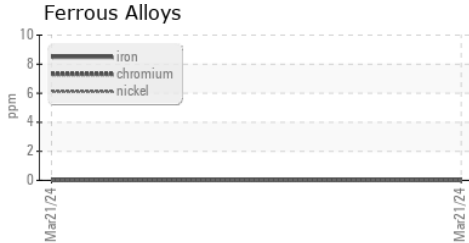

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06125757 **Received** : 21 Mar 2024  
**Lab Number** : **06125757** **Tested** : 25 Mar 2024  
**Unique Number** : 10939908 **Diagnosed** : 25 Mar 2024 - Don Baldrige  
**Test Package** : IND 2

**AIRMATIC COMPRESSOR SYSTEMS**  
 700 WASHINGTON AVE  
 CARLSTADT, NJ  
 US 07072  
 Contact: ELVIN DIAZ  
 ediaz@airmaticcompressor.com; canastasio@wearcheckusa.com  
 T: (800)864-7621  
 F: (201)342-6241

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)