

# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**HD ROTO FLUID [418208]**  
Machine Id  
**ATLAS COPCO WUX583056**  
Component  
**Compressor**

## DIAGNOSIS

### Recommendation

We suspect abnormal contamination may be due to sampling method. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH06125763</b>	---	---
Sample Date	Client Info			<b>21 Mar 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---




WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>65	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>65	<b>0</b>	---	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	6	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	750	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	60	<b>113</b>	---	---
Zinc	ppm	ASTM D5185m	50	<b>42</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>1156</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m		<b>4</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Water	%	ASTM D6304	>0.1	<b>0.030</b>	---	---
ppm Water	ppm	ASTM D6304	>1000	<b>300</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.12	<b>0.086</b>	---	---

# OIL ANALYSIS REPORT

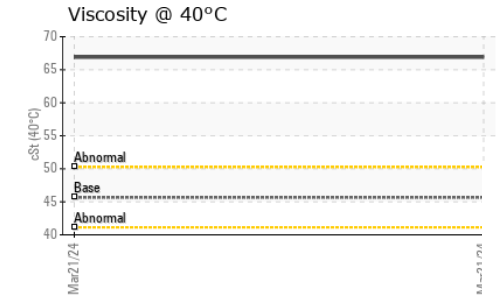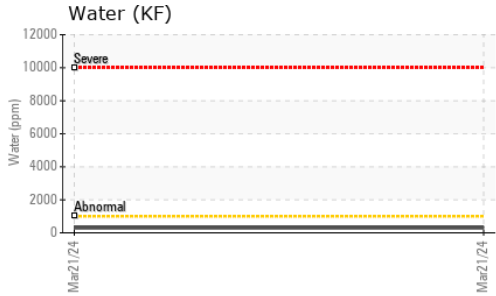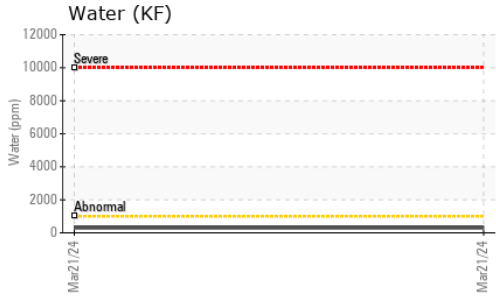





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---
Debris	scalar	*Visual	NONE	<b>MODER</b>	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---
Emulsified Water	scalar	*Visual	>0.1	<b>0.2%</b>	---
Free Water	scalar	*Visual		<b>NEG</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.65	<b>66.9</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

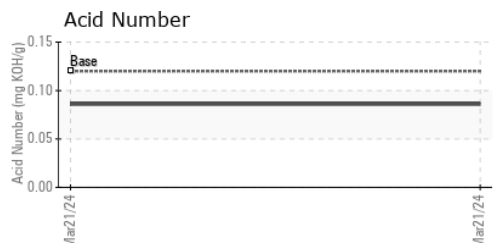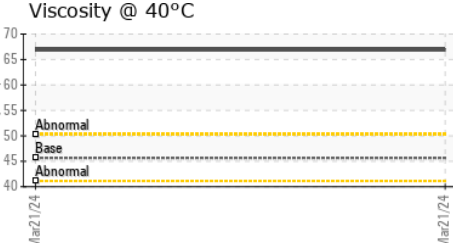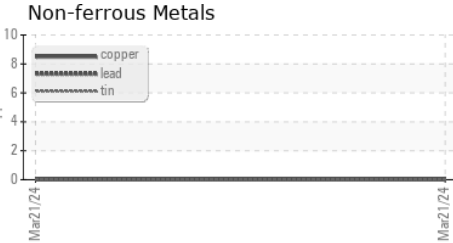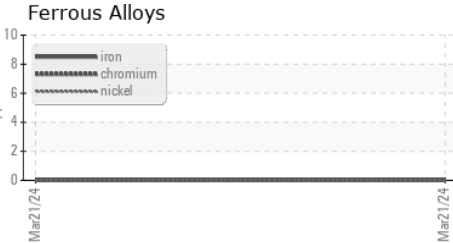

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06125763 **Received** : 21 Mar 2024  
**Lab Number** : **06125763** **Tested** : 26 Mar 2024  
**Unique Number** : 10939914 **Diagnosed** : 26 Mar 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AIRMATIC COMPRESSOR SYSTEMS**  
 700 WASHINGTON AVE  
 CARLSTADT, NJ  
 US 07072  
 Contact: ELVIN DIAZ  
 ediaz@airmaticcompressor.com; canastasio@wearcheckusa.com  
 T: (800)864-7621  
 F: (201)342-6241

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)