


# **OIL ANALYSIS REPORT**

# ROTO Z ATLAS COPCO API251956 - SHISEIDO (S/N APF251956)

Compressor





### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06125786		
Sample Date		Client Info		21 Mar 2024		
Machine Age	hrs	Client Info		7609		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	0		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		486		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		739		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	2		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.29		




## **OIL ANALYSIS REPORT**

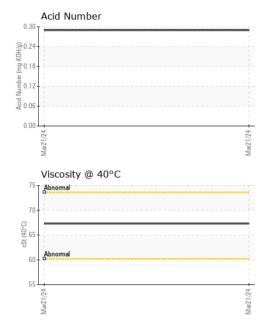


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
<b>Emulsified Water</b>	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	TIES	method	limit/base	current	history1	history2


VISC @ 40°C	CSI	ASTIVI D445	67.3		
SAMPLE IMAGES		method			history2
Color				no image	no image
Bottom				no image	no image

### **GRAPHS**



	Non-ferrous Metals
1	T
	copper
	energonation till
mdd	
_	1
	2+
	, 724
	Mar21/24
	M
	Viscosity @ 40°C









Certificate L2367

Laboratory Sample No.

: UCH06125786 Lab Number : 06125786

Unique Number: 10939937 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 21 Mar 2024 **Tested** 

: 25 Mar 2024 Diagnosed : 25 Mar 2024 - Angela Borella

**AIRMATIC COMPRESSOR SYSTEMS** 

700 WASHINGTON AVE CARLSTADT, NJ

US 07072 Contact: ELVIN DIAZ

To discuss this sample report, contact Customer Service at 1-800-237-1369.

ediaz@airmaticcompressor.com;canastasio@wearcheckusa.com T: (800)864-7621

Contact/Location: ELVIN DIAZ - UCAIRCAR

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (201)342-6241