


# OIL ANALYSIS REPORT

Area  
**TURBO 68**  
Machine Id  
**KOBELCO 15H6116178 - COLGATE**  
Component  
**Compressor**

Sample Rating Trend

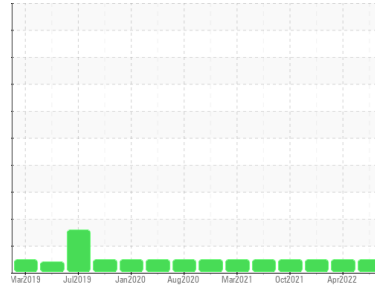

**NORMAL**



## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06125794</b>	UCH05536432	UCH05492671
Sample Date	Client Info		<b>21 Mar 2024</b>	20 Apr 2022	25 Jan 2022
Machine Age	hrs	Client Info	<b>37459</b>	29185	28263
Oil Age	hrs	Client Info	<b>0</b>	3319	2397
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	2
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >25	<b>0</b>	3	3
Copper	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>3</b>	1	<1
Phosphorus	ppm	ASTM D5185m	<b>127</b>	160	163
Zinc	ppm	ASTM D5185m	<b>17</b>	47	54
Sulfur	ppm	ASTM D5185m	<b>5290</b>	289	286


## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>1</b>	1	1
Sodium	ppm	ASTM D5185m	<b>2</b>	3	2
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	1

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.09</b>	0.09	0.116


# OIL ANALYSIS REPORT

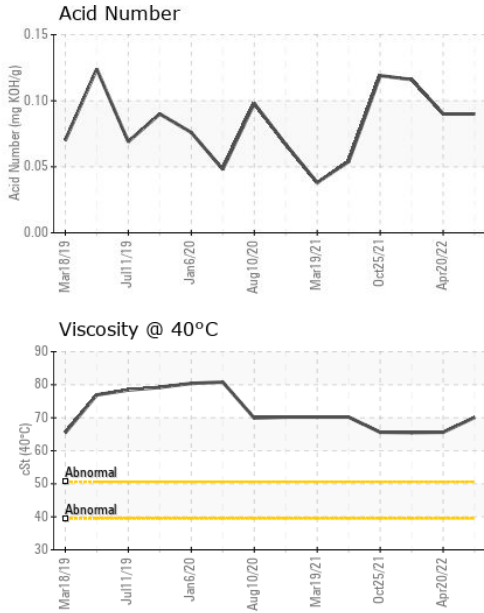





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	70.1	65.6	65.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

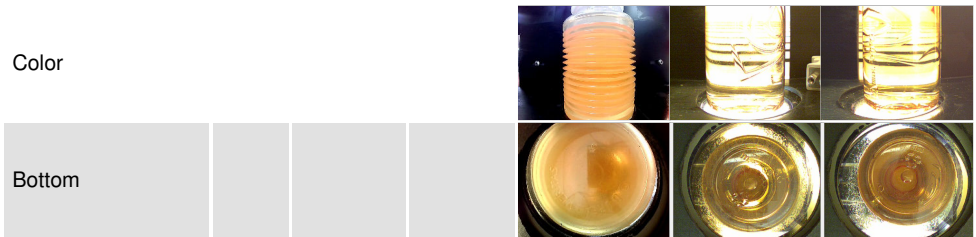

## GRAPHS

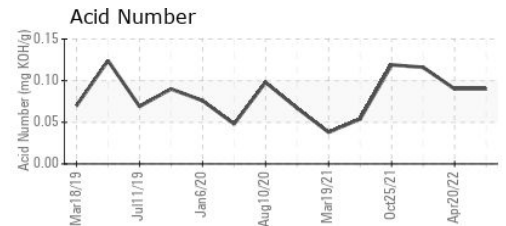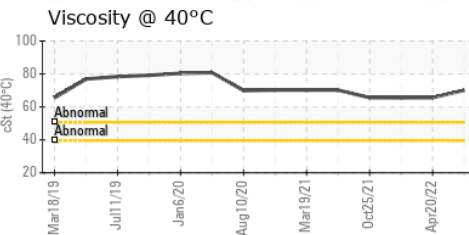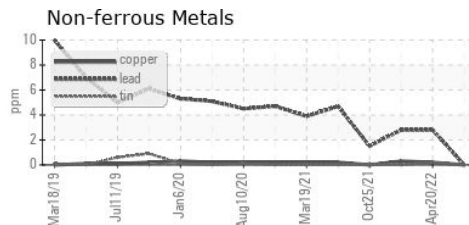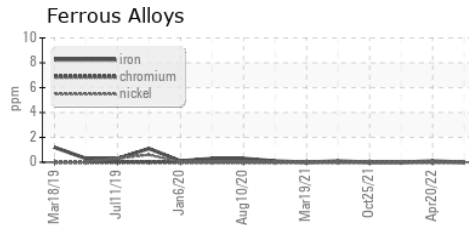

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06125794  
**Lab Number** : 06125794  
**Unique Number** : 10939945  
**Test Package** : IND 2

**Received** : 21 Mar 2024  
**Tested** : 25 Mar 2024  
**Diagnosed** : 25 Mar 2024 - Angela Borella

**AIRMATIC COMPRESSOR SYSTEMS**  
 700 WASHINGTON AVE  
 CARLSTADT, NJ  
 US 07072

Contact: ELVIN DIAZ  
 ediaz@airmaticcompressor.com; canastasio@wearcheckusa.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (800)864-7621  
 F: (201)342-6241