


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

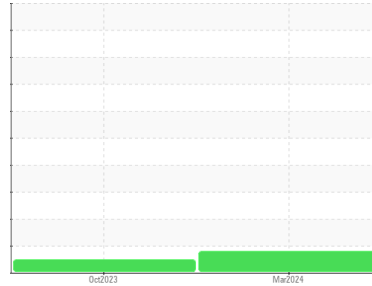

Machine Id  
**8999066 (S/N 2780)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

**DIAGNOSIS**

● **Recommendation**

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

● **Contamination**

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC125858</b>	KC123124	---
Sample Date	Client Info			<b>18 Mar 2024</b>	18 Oct 2023	---
Machine Age	hrs	Client Info		<b>751</b>	267	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>ATTENTION</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	90	<b>0</b>	2	---
Calcium	ppm	ASTM D5185m	2	<b>0</b>	<1	---
Phosphorus	ppm	ASTM D5185m		<b>39</b>	48	---
Zinc	ppm	ASTM D5185m		<b>0</b>	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Water	%	ASTM D6304	>0.05	<b>0.002</b>	0.003	---
ppm Water	ppm	ASTM D6304	>500	<b>19</b>	30.0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>15583</b>	1226	---
Particles >6µm		ASTM D7647	>1300	● <b>1767</b>	368	---
Particles >14µm		ASTM D7647	>80	<b>39</b>	9	---
Particles >21µm		ASTM D7647	>20	<b>10</b>	2	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	● <b>21/18/12</b>	17/16/10	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.23</b>	0.202	---


# OIL ANALYSIS REPORT

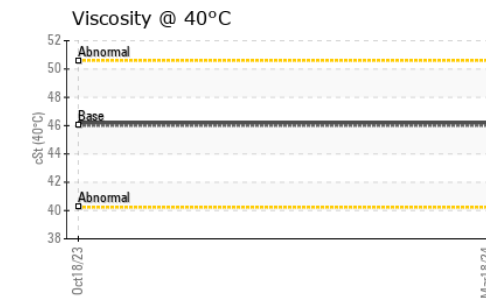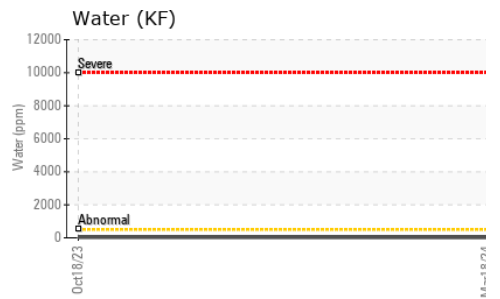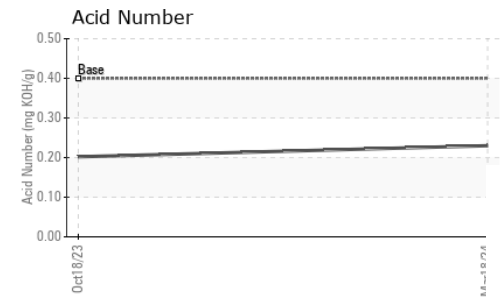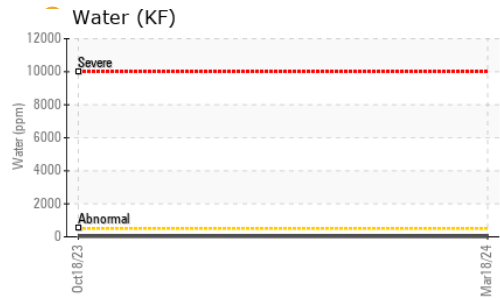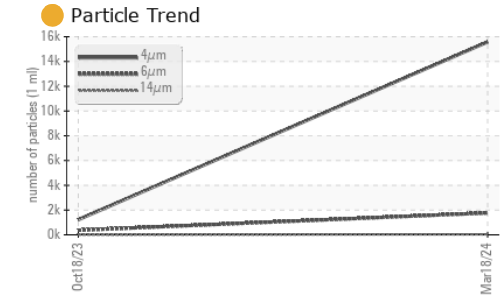




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.2	46.2	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

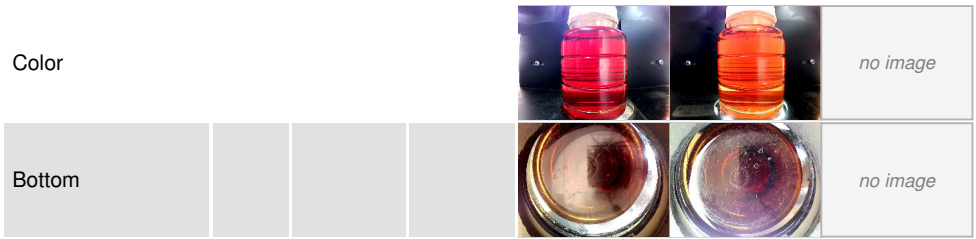

## GRAPHS

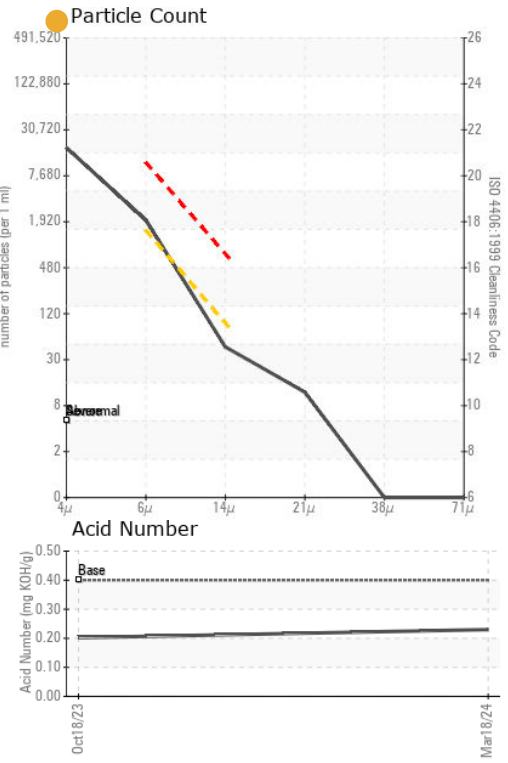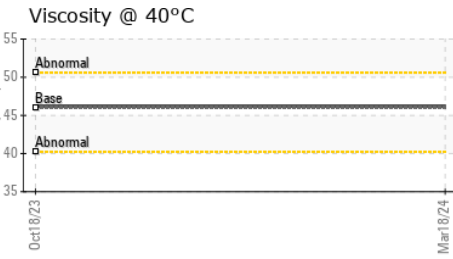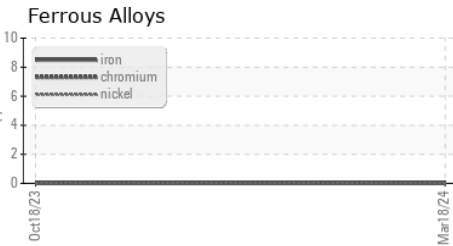

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC125858 **Received** : 27 Mar 2024  
**Lab Number** : 06130603 **Tested** : 28 Mar 2024  
**Unique Number** : 10950068 **Diagnosed** : 30 Mar 2024 - Don Baldrige  
**Test Package** : IND 2

**KENAMETAL**  
6865 COCHRAN RD  
SOLON, OH  
US 44139  
Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)