


# **OIL ANALYSIS REPORT**

Sample Rating Trend

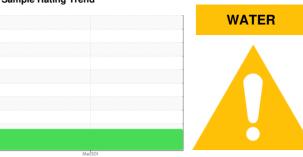

Machine Id

# 8450024 (S/N 1506)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

## **DIAGNOSIS**

#### Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

#### Wear

All component wear rates are normal.

## Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA014269		
Sample Date		Client Info		05 Mar 2024		
Machine Age	hrs	Client Info		406		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	16		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		24		
Sulfur	ppm	ASTM D5185m		20878		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		13		
Potassium	ppm	ASTM D5185m	>20	8		
Water	%	ASTM D6304	>0.05	<u> </u>		
opm Water	ppm	ASTM D6304	>500	<u>^</u> 2130		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		861		
Particles >6µm		ASTM D7647	>1300	469		
Particles >14µm		ASTM D7647	>80	80		
Particles >21µm		ASTM D7647	>20	27		
Particles >38µm		ASTM D7647	>4	4		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/13		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.24		



# **OIL ANALYSIS REPORT**

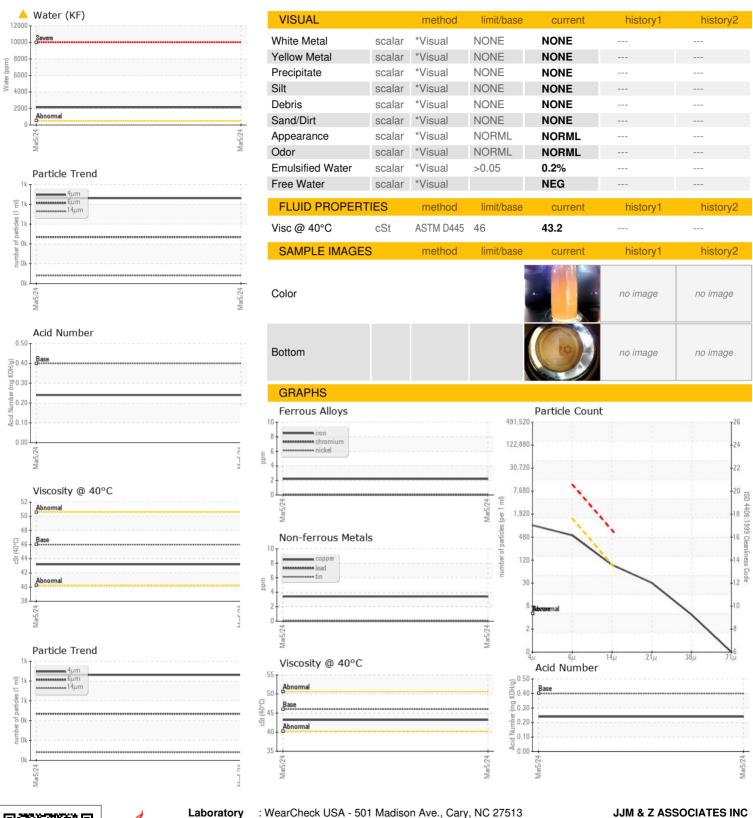



Sample No.

Laboratory

Lab Number : 06130616

: KCPA014269 Unique Number : 10950081

Received **Tested** 

: 27 Mar 2024 : 04 Apr 2024 Diagnosed

: 04 Apr 2024 - Jonathan Hester

Contact: Service Manager

4101 GARLAND DR

FORT WORTH, TX

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - JJMFORTX

US 76117

T:

F: