




OIL ANALYSIS REPORT

Sample Rating Trend

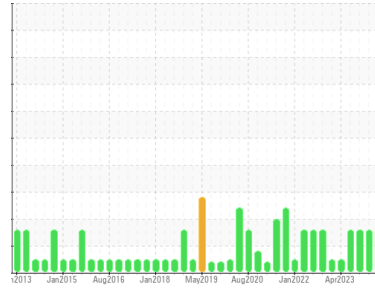

WATER



Area
EG10/LYOS [3096880]
 Machine Id
14AR03
 Component
Refrigeration Compressor
 Fluid
CPI SOLEST 68 (4 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0907794	WC0871237	WC0840227
Sample Date	Client Info		25 Mar 2024	21 Dec 2023	06 Oct 2023
Machine Age	mths	Client Info	0	0	0
Oil Age	mths	Client Info	0	0	0
Oil Changed	Client Info		Not Chngd	N/A	Not Chngd
Sample Status			MARGINAL	MARGINAL	MARGINAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	18	11	11
Chromium	ppm	ASTM D5185m >2	0	0	0
Nickel	ppm	ASTM D5185m	0	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >3	1	<1	0
Lead	ppm	ASTM D5185m >2	0	2	<1
Copper	ppm	ASTM D5185m >8	64	43	41
Tin	ppm	ASTM D5185m >4	<1	1	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	0
Manganese	ppm	ASTM D5185m	0	2	0
Magnesium	ppm	ASTM D5185m	<1	<1	<1
Calcium	ppm	ASTM D5185m	7	<1	0
Phosphorus	ppm	ASTM D5185m	3	10	3
Zinc	ppm	ASTM D5185m	12	4	4
Sulfur	ppm	ASTM D5185m	0	0	38

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	3	2	2
Sodium	ppm	ASTM D5185m	1	2	0
Potassium	ppm	ASTM D5185m >20	<1	3	<1
Water	%	ASTM D6304 >0.01	▲ 0.021	▲ 0.010	▲ 0.015
ppm Water	ppm	ASTM D6304 >100	▲ 212	▲ 101	▲ 153.8

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	1102	2197	1589
Particles >6µm	ASTM D7647	>2500	152	816	267
Particles >14µm	ASTM D7647	>320	6	70	17
Particles >21µm	ASTM D7647	>80	1	16	5
Particles >38µm	ASTM D7647	>20	0	1	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	17/14/10	18/17/13	18/15/11

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.042	0.029	0.039




OIL ANALYSIS REPORT

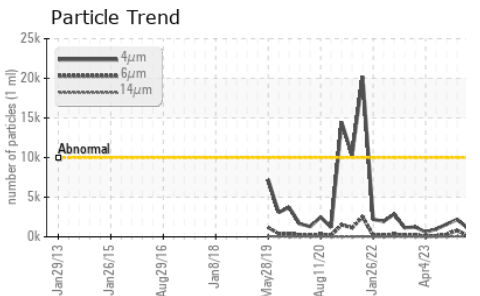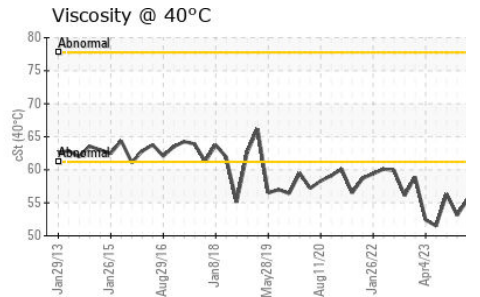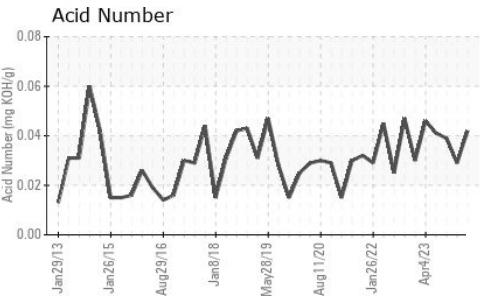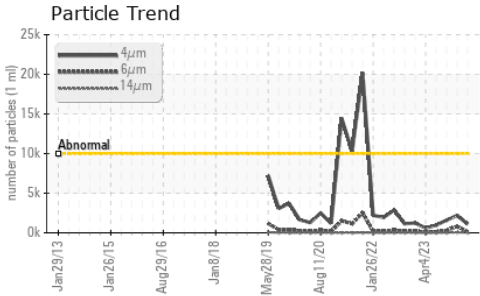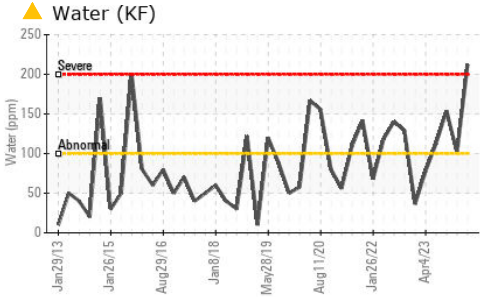






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	55.5	53.1	56.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

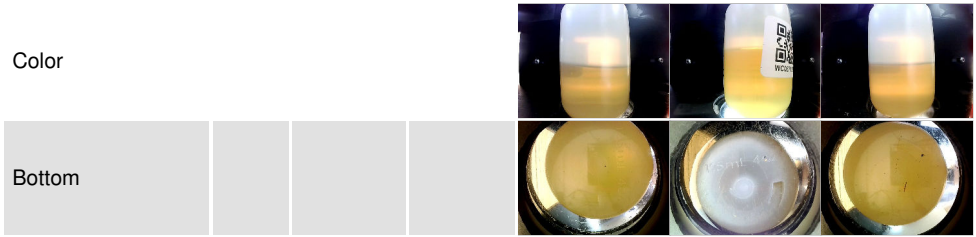

GRAPHS

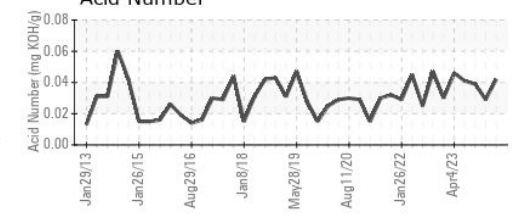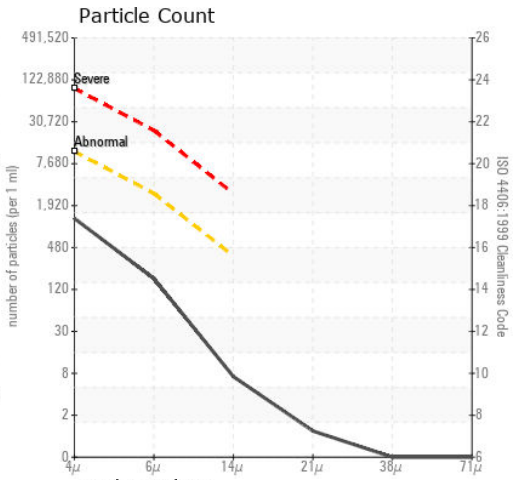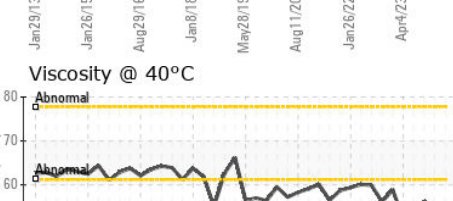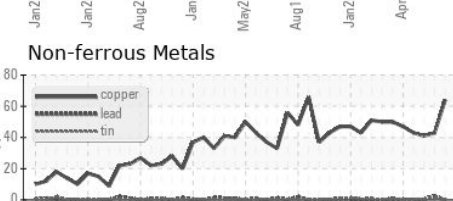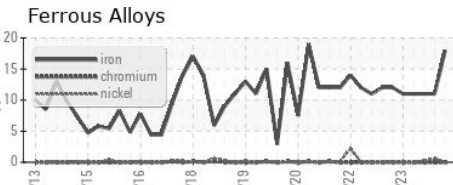

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0907794 **Received** : 27 Mar 2024
Lab Number : 06130687 **Tested** : 28 Mar 2024
Unique Number : 10950152 **Diagnosed** : 30 Mar 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

GRIFOLS TALECRIS PHARMACEUTICAL
 8368 US 70 WEST
 CLAYTON, NC
 US 27520
 Contact: KEN TERRY
 kenneth.terry@grifols.com
 T: (919)359-4362
 F: (919)359-4767

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)