







PROBLEM SUMMARY

Sample Rating Trend

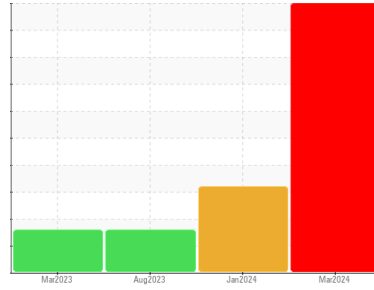

Machine Id
PRESS 2 (S/N 420-280)
 Component
Northeast Roller Bearing
 Fluid
ROYAL PURPLE THERMYL-GLYDE 1500 (--- GAL)

COMPONENT CONDITION SUMMARY

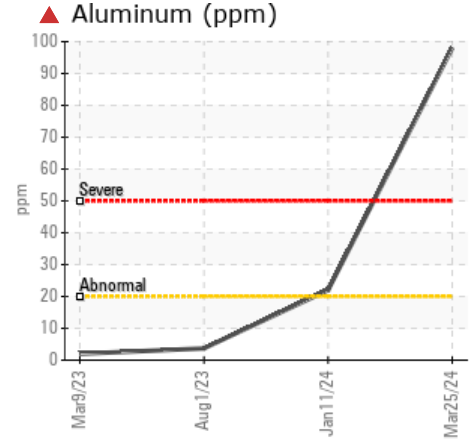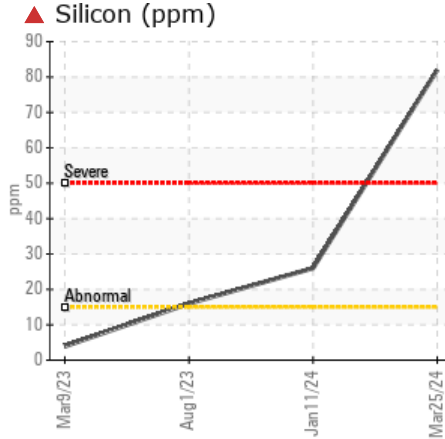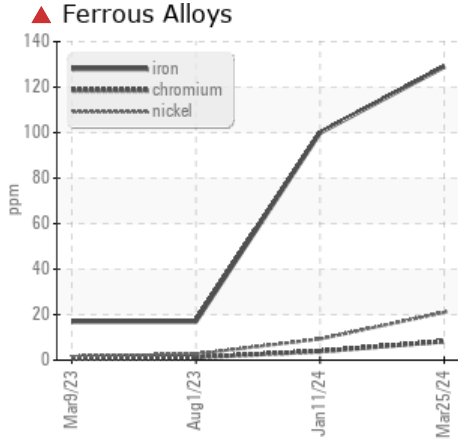

RECOMMENDATION

We advise that you check all areas where dirt can enter the system. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	ABNORMAL	ABNORMAL
Iron	ppm	ASTM D5185m	>20	▲ 129	▲ 100	17
Nickel	ppm	ASTM D5185m	>20	▲ 21	9	3
Aluminum	ppm	ASTM D5185m	>20	▲ 98	▲ 22	4
Silicon	ppm	ASTM D5185m	>15	▲ 82	▲ 26	▲ 16

Customer Id: WEYNEW
 Sample No.: WC0432394
 Lab Number: 06130716
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Inspect Wear Source	---	---	?	We advise that you inspect for the source(s) of wear.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check Dirt Access	---	---	?	We advise that you check all areas where dirt can enter the system.

HISTORICAL DIAGNOSIS

11 Jan 2024 Diag: Jonathan Hester

DIRT



No corrective action is recommended at this time. We recommend an early resample to monitor this condition. The iron level is abnormal. The aluminum level is abnormal. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



01 Aug 2023 Diag: Don Baldrige

DIRT



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. Elemental level of silicon (Si) above normal. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



09 Mar 2023 Diag: Don Baldrige

WATER



We advise that you check for the source of water entry. We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor. All component wear rates are normal. Free water present. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

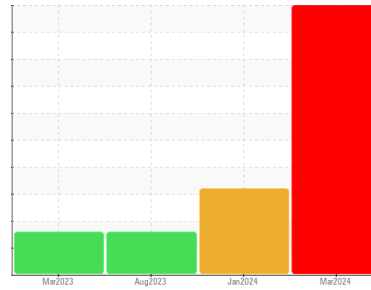

WEAR



Machine Id
PRESS 2 (S/N 420-280)

Component
Northeast Roller Bearing

Fluid
ROYAL PURPLE THERMYL-GLYDE 1500 (--- GAL)

DIAGNOSIS

▲ Recommendation

We advise that you check all areas where dirt can enter the system. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

▲ Wear

The iron level is severe. The aluminum level is severe. The nickel level is abnormal.

▲ Contamination

Elemental levels of silicon (Si) and aluminum (Al) indicate alumina-silicate (coarse dirt) ingress. The water content is negligible.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0432394	WC0432490	WC0432483
Sample Date	Client Info		25 Mar 2024	11 Jan 2024	01 Aug 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	▲ 129	▲ 100	17
Chromium	ppm	ASTM D5185m >20	8	4	1
Nickel	ppm	ASTM D5185m >20	▲ 21	9	3
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	▲ 98	▲ 22	4
Lead	ppm	ASTM D5185m >20	0	0	0
Copper	ppm	ASTM D5185m >20	<1	0	<1
Tin	ppm	ASTM D5185m >20	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	1	1	<1
Magnesium	ppm	ASTM D5185m	6	<1	2
Calcium	ppm	ASTM D5185m	37	35	53
Phosphorus	ppm	ASTM D5185m	400	383	123
Zinc	ppm	ASTM D5185m	37	32	7
Sulfur	ppm	ASTM D5185m	17096	19014	25909

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	▲ 82	▲ 26	▲ 16
Sodium	ppm	ASTM D5185m	44	40	29
Potassium	ppm	ASTM D5185m >20	4	<1	1
Water	%	ASTM D6304 >2	0.120	0.107	0.202
ppm Water	ppm	ASTM D6304	1200	1070	2020

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.74	0.50	0.24




OIL ANALYSIS REPORT

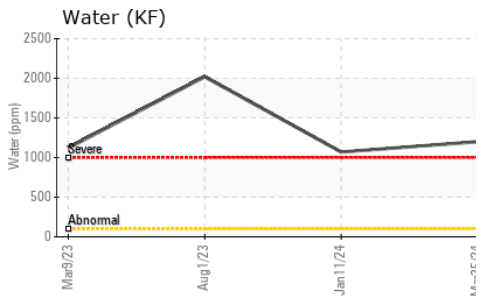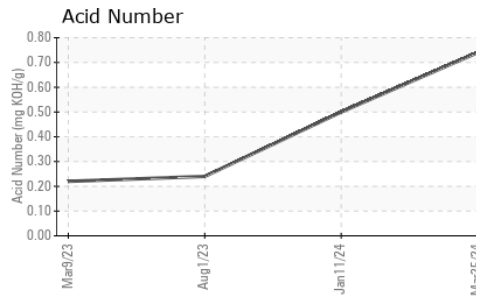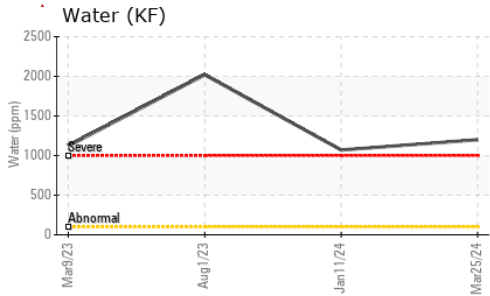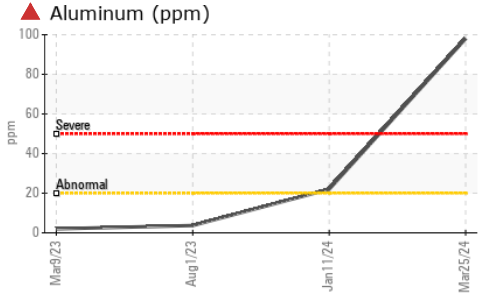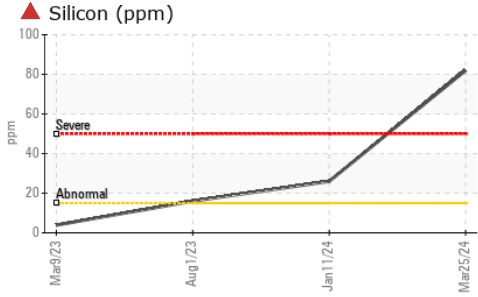





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	0.2%	0.2%
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	1500	1493	1477

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

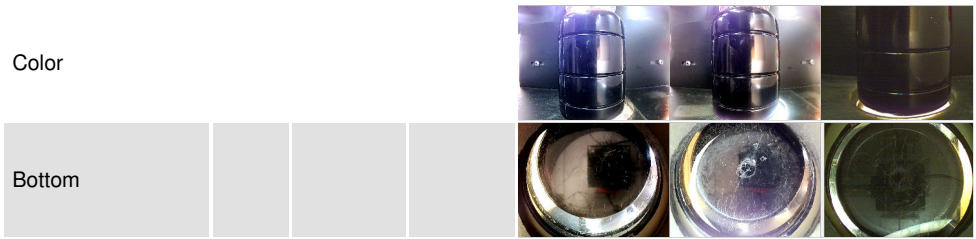

GRAPHS

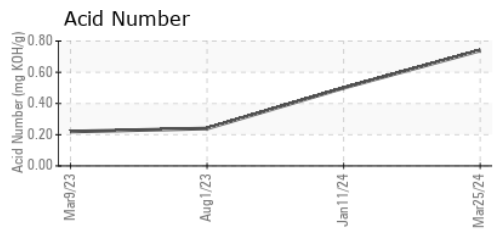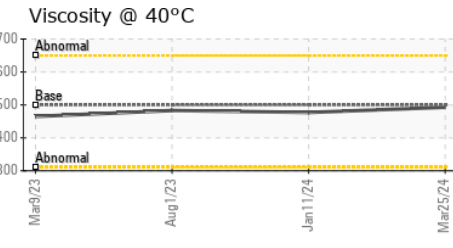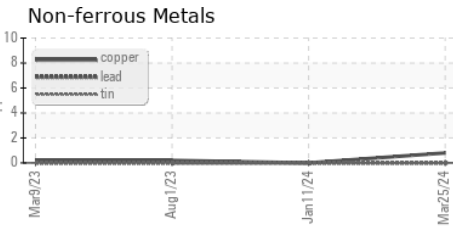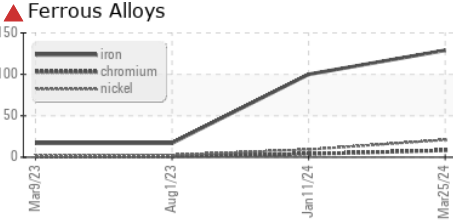

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0432394 **Received** : 27 Mar 2024
Lab Number : 06130716 **Tested** : 28 Mar 2024
Unique Number : 10950181 **Diagnosed** : 01 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF)

INTERNATIONAL PAPER
 1785 Weyerhaeuser Road
 VANCEBORO, NC
 US 28586

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: DOUG WEIR
 Doug.Weir@paper.com;jon.fazenbaker@wearcheck.com
 T: (252)633-7350
 F: (252)633-7761