




OIL ANALYSIS REPORT

Sample Rating Trend

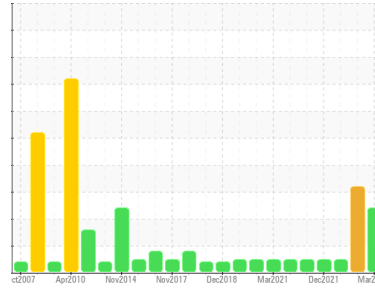

DIRT



Machine Id
402-126-03 NORTH BEARING STMG VESSEL (S/N NB02110-402.XX126.03)

Component
Bearing

Fluid
ROYAL PURPLE THERMYL-GLYDE 1500 (--- QTS)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The iron level is abnormal. All other component wear rates are normal.

▲ Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0892370	RP0008384	RP0008424
Sample Date	Client Info		25 Mar 2024	25 Jan 2024	26 May 2022
Machine Age	mths	Client Info	0	0	0
Oil Age	mths	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	▲ 47	▲ 37	20
Chromium	ppm	ASTM D5185m >20	0	<1	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	<1	<1	0
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >20	2	1	<1
Lead	ppm	ASTM D5185m >20	0	0	0
Copper	ppm	ASTM D5185m >20	18	▲ 27	2
Tin	ppm	ASTM D5185m >20	0	0	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	2
Barium	ppm	ASTM D5185m	184	251	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	2	0	0
Calcium	ppm	ASTM D5185m	181	173	17
Phosphorus	ppm	ASTM D5185m	130	119	78
Zinc	ppm	ASTM D5185m	29	23	0
Sulfur	ppm	ASTM D5185m	22336	20387	13003

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	▲ 17	▲ 25	10
Sodium	ppm	ASTM D5185m	3	2	3
Potassium	ppm	ASTM D5185m >20	2	0	0
Water	%	ASTM D6304 >2	0.001	0.131	0.00
ppm Water	ppm	ASTM D6304	8	1310	0.00


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.10	0.08	0.26




OIL ANALYSIS REPORT


▲ Silicon (ppm)

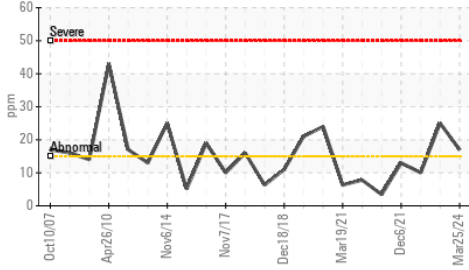


Water (KF)

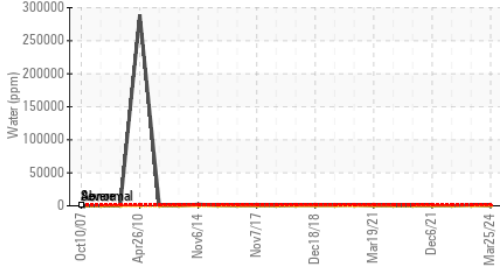


Acid Number

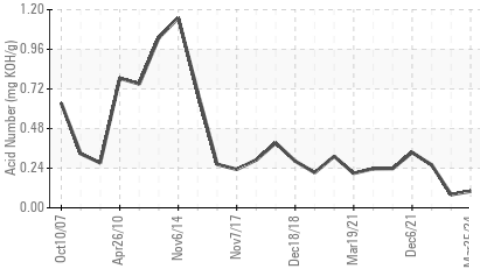

Water (KF)

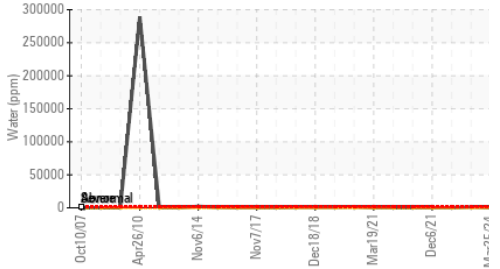

Viscosity @ 40°C

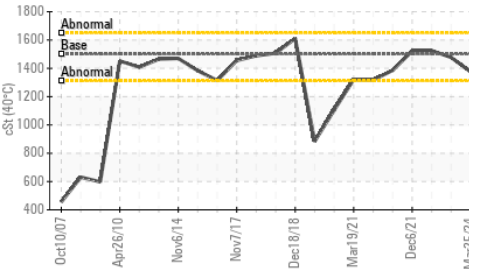

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	1500	1376	1477

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


▲ Ferrous Alloys

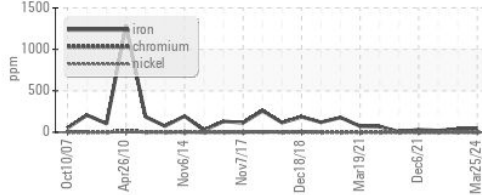


Non-ferrous Metals

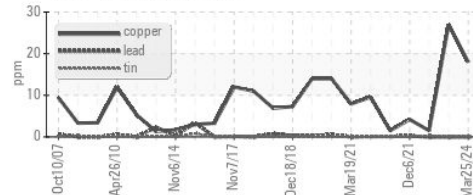

Viscosity @ 40°C

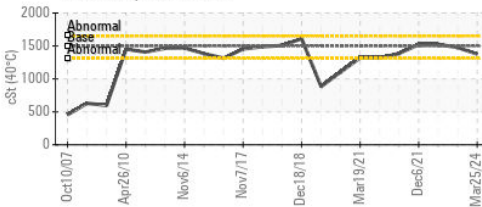

Acid Number

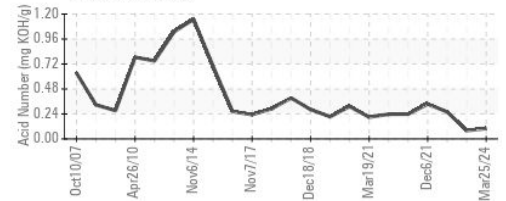

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0892370

Lab Number : 06130740

Unique Number : 10950205

Test Package : IND 2 (Additional Tests: KF)

Received : 27 Mar 2024

Tested : 28 Mar 2024

Diagnosed : 30 Mar 2024 - Don Baldrige

INTERNATIONAL PAPER

1785 Weyerhaeuser Road

VANCEBORO, NC

US 28586

Contact: DOUG WEIR

Doug.Weir@paper.com;jon.fazenbaker@wearcheck.com

T: (252)633-7350

F: (252)633-7761

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)