




# OIL ANALYSIS REPORT

Sample Rating Trend

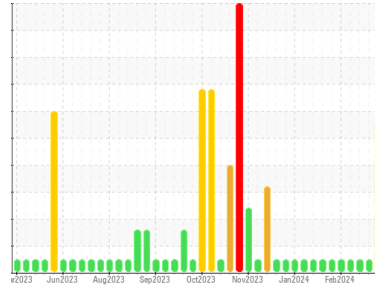

DEGRADATION



Machine Id  
**Byron Center CAT 1 BYCM01BE**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

We recommend that you drain the oil and perform a filter service on this component if not already done. Resample at the next service interval to monitor. Please note that this is a corrected copy for diagnostic comment updates.

### ▲ Wear

The tin level is abnormal. All other component wear rates are normal.

### ▲ Contamination

Elemental level of silicon (Si) above normal.

### ▲ Fluid Condition

The BN level is low. The oil is no longer serviceable.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0877088</b>	WC0877090	WC0877092
Sample Date	Client Info		<b>25 Mar 2024</b>	15 Mar 2024	07 Mar 2024
Machine Age	hrs	Client Info	<b>86858</b>	86629	86438
Oil Age	hrs	Client Info	<b>645</b>	416	225
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>SEVERE</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.11	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<b>6</b>	2	2
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >6	<b>3</b>	2	1
Lead	ppm	ASTM D5185m >9	<b>0</b>	1	<1
Copper	ppm	ASTM D5185m >6	<b>2</b>	1	<1
Tin	ppm	ASTM D5185m >4	<b>▲ 4</b>	3	3
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>2</b>	3	2
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>2</b>	1	2
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>31</b>	19	21
Calcium	ppm	ASTM D5185m	<b>1901</b>	1830	1676
Phosphorus	ppm	ASTM D5185m	<b>316</b>	272	265
Zinc	ppm	ASTM D5185m	<b>388</b>	319	318
Sulfur	ppm	ASTM D5185m	<b>3767</b>	3549	3137

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	<b>▲ 194</b>	138	105
Sodium	ppm	ASTM D5185m >21	<b>&lt;1</b>	1	<1
Potassium	ppm	ASTM D5185m >20	<b>2</b>	0	0

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	0	0
Nitration	Abs/cm	*ASTM D7624	<b>6.1</b>	5.8	5.6
Sulfation	Abs/.1mm	*ASTM D7415	<b>26.0</b>	23.3	20.6


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	<b>17.3</b>	14.6	12.1
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>2.08</b>	1.57	1.18
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	<b>▲ 2.61</b>	2.79	3.33




# OIL ANALYSIS REPORT


## Non-ferrous Metals

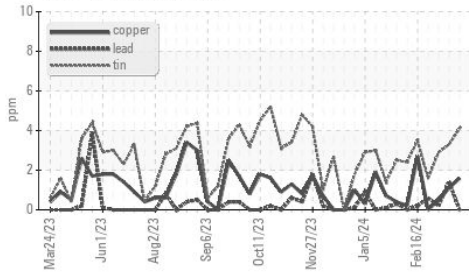


## Acid Number

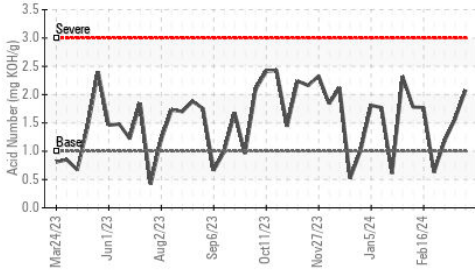


## Silicon (ppm)

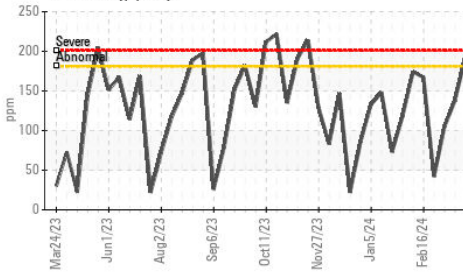

## Acid Number

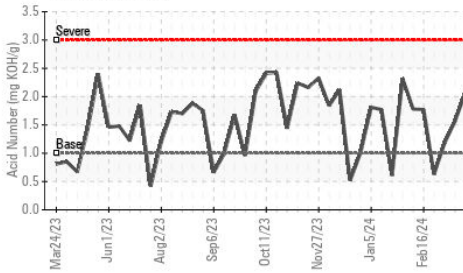

## Viscosity @ 100°C

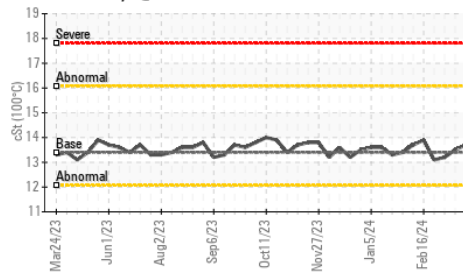


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.11	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.7	13.5

## GRAPHS


### Iron (ppm)

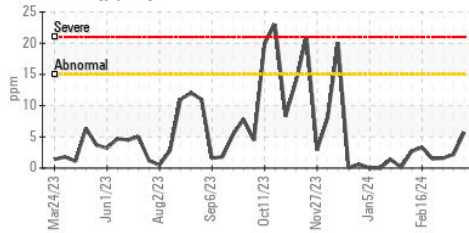


### Aluminum (ppm)

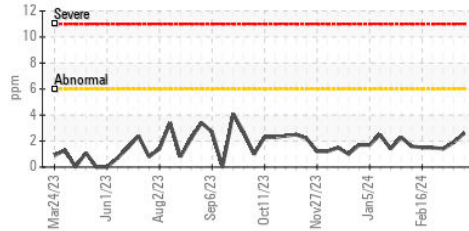


### Copper (ppm)

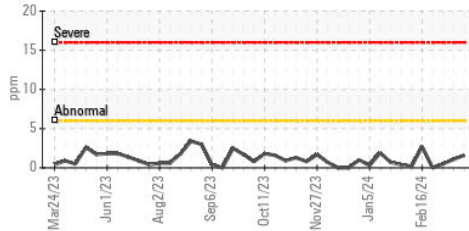


### Viscosity @ 100°C

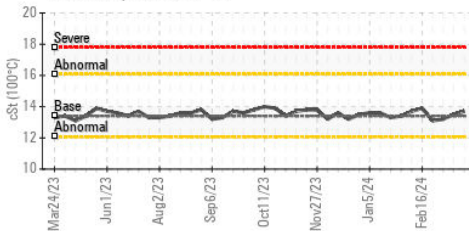


### Lead (ppm)

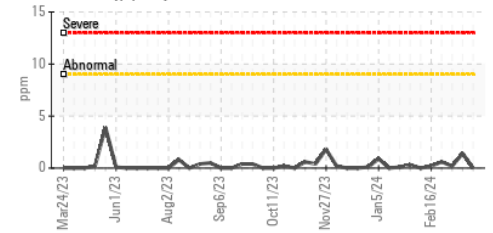


### Chromium (ppm)

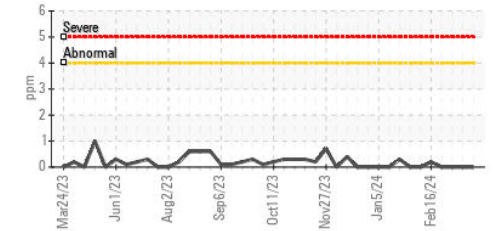

### Silicon (ppm)

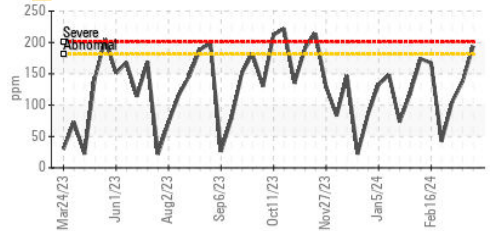

### Base Number

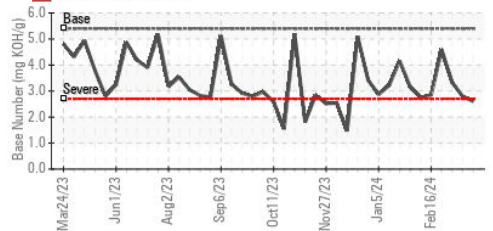

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0877088

Lab Number : 06130795

Unique Number : 10950260

Test Package : MOB 2

Received : 27 Mar 2024

Tested : 28 Mar 2024

Diagnosed : 01 Apr 2024 - Doug Bogart

EDL NA Recips-Byron Center

Byron Center Powerstation, 10310 South Kent Road

Byron Center, MI

US 49315

Contact: Jake Ripke

Jake.Ripke@edlenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)