




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

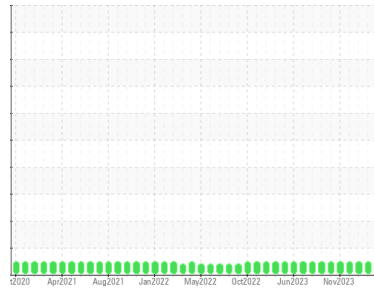

Area  
**Patoka**  
 Machine Id  
**[Patoka] Oil - Starboard Genset**  
 Component  
**Starboard Genset**  
 Fluid  
**NOT GIVEN (35 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. ( Customer Sample Comment: J. Harvey )

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0859906</b>	WC0805571	WC0859898
Sample Date	Client Info		<b>09 Mar 2024</b>	26 Feb 2024	18 Feb 2024
Machine Age	hrs	Client Info	<b>3264</b>	0	0
Oil Age	hrs	Client Info	<b>3264</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>17</b>	13	14
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>2</b>	1	1
Lead	ppm	ASTM D5185m	>17	<b>4</b>	4	4
Copper	ppm	ASTM D5185m	>70	<b>6</b>	3	5
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	1	1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>11</b>	13	11
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>64</b>	64	61
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	1	1
Magnesium	ppm	ASTM D5185m		<b>1359</b>	1384	1366
Calcium	ppm	ASTM D5185m		<b>1286</b>	1365	1288
Phosphorus	ppm	ASTM D5185m		<b>1047</b>	1103	1036
Zinc	ppm	ASTM D5185m		<b>1312</b>	1418	1343
Sulfur	ppm	ASTM D5185m		<b>2952</b>	3390	3054

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>6</b>	4	28
Sodium	ppm	ASTM D5185m		<b>12</b>	6	8
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	0
Water	%	ASTM D6304	>0.1	<b>NEG</b>	NEG	NEG

## INFRA-RED




	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		<b>0.2</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>11.2</b>	8.3	10.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>22.3</b>	19.7	21.0

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>23.3</b>	16.8	20.4
Base Number (BN)	mg KOH/g	ASTM D2896		<b>11.25</b>	12.25	10.45







# OIL ANALYSIS REPORT

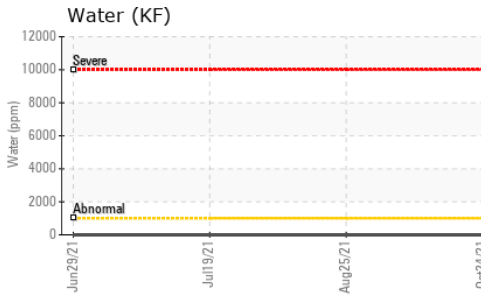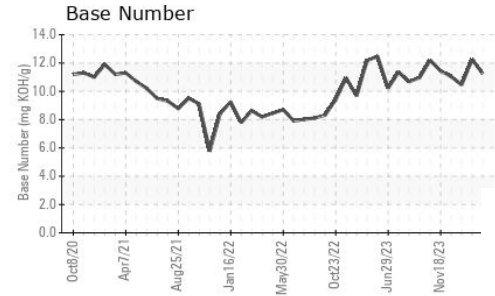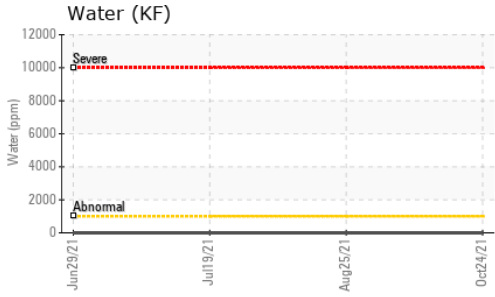

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>14.8</b>	14.4	14.4

## GRAPHS

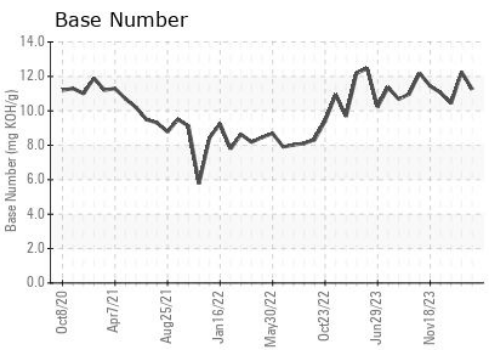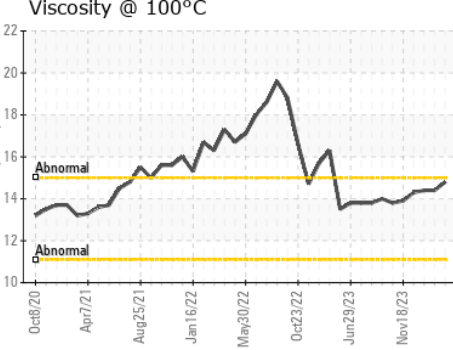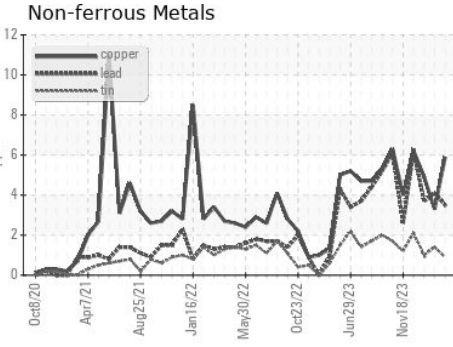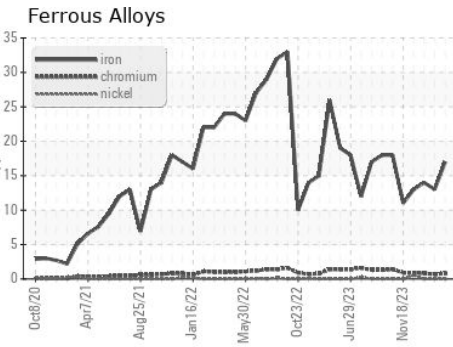

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0859906  
**Lab Number** : **06130820**  
**Unique Number** : 10950285  
**Test Package** : IND 2 ( Additional Tests: KF )

**Received** : 27 Mar 2024  
**Tested** : 01 Apr 2024  
**Diagnosed** : 01 Apr 2024 - Jonathan Hester

**MARATHON PETROLEUM CO.**  
 101 12TH ST  
 CATLETTSBURG, KY  
 US 41169

Contact: CORY GUMBERT  
 cagumbert@marathonpetroleum.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (606)585-3950

F: x: