




FUEL REPORT

Sample Rating Trend

NORMAL



Area
UTILITIES
 Machine Id
FUEL STATION 3 UNITED RENTALS
 Component
Tank Diesel Fuel
 Fluid
{not provided} (2000 GAL)

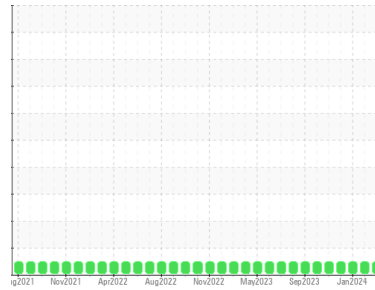

DIAGNOSIS

Recommendation

No corrective action is recommended at this time.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.

Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			RP0042680	RP0038044	RP0039266
Sample Date	Client Info			26 Mar 2024	29 Feb 2024	29 Jan 2024
Machine Age	mls	Client Info		0	0	0
Sample Status				NORMAL	NORMAL	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		3.34	3.15	3.01

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1	<1	0
Sodium	ppm	ASTM D5185m	<0.1	2	<1	0
Potassium	ppm	ASTM D5185m	<0.1	<1	0	<1
Water	%	ASTM D6304	<0.05	0.001	0.003	0.005
ppm Water	ppm	ASTM D6304	<500	11	27	60





HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	0	2
Nickel	ppm	ASTM D5185m	<0.1	0	0	0
Lead	ppm	ASTM D5185m	<0.1	0	0	0
Vanadium	ppm	ASTM D5185m	<0.1	<1	0	0
Iron	ppm	ASTM D5185m	<0.1	0	0	0
Calcium	ppm	ASTM D5185m	<0.1	0	0	0
Magnesium	ppm	ASTM D5185m	<0.1	0	0	0
Phosphorus	ppm	ASTM D5185m	<0.1	0	0	0
Zinc	ppm	ASTM D5185m	<0.1	0	0	0

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

FUEL REPORT

GRAPHS

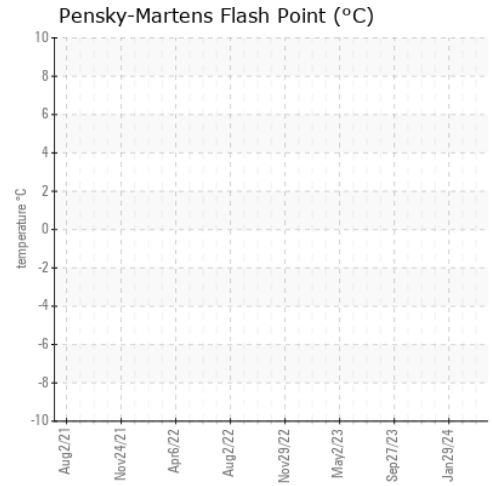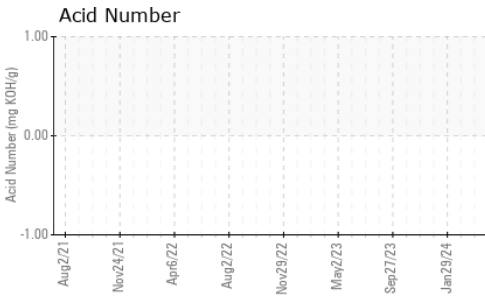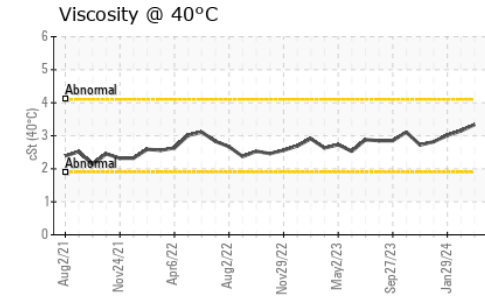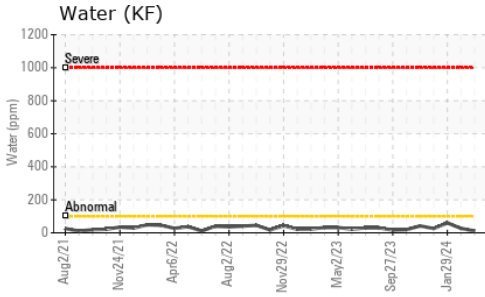

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0042680
Lab Number : 06131259
Unique Number : 10950724
Test Package : IND 2
Received : 27 Mar 2024
Tested : 02 Apr 2024
Diagnosed : 02 Apr 2024 - Jonathan Hester

OUTOKUMPU STAINLESS USA
 HWY 43 N
 CALVERT, AL
 US 36513
 Contact: MARIO JOHNSON
 Mario.johnson@outokumpu.com
 T: (251)321-4105
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)