




OIL ANALYSIS REPORT

Sample Rating Trend

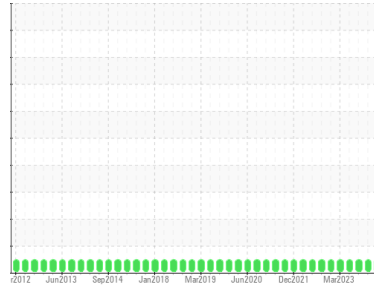

NORMAL



Machine Id
K-1501B Booster Compressor
Component
Tank Lube System
Fluid
PHILLIPS 66 Diamond Class® Turbine Oil AW 32 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		HLC0003079	HLC0003089	HLC0002657
Sample Date	Client Info		22 Mar 2024	03 Jan 2024	12 Oct 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0	0
Chromium	ppm	ASTM D5185m	>20	<1	<1
Nickel	ppm	ASTM D5185m	>20	1	0
Titanium	ppm	ASTM D5185m		<1	<1
Silver	ppm	ASTM D5185m		<1	<1
Aluminum	ppm	ASTM D5185m	>20	2	2
Lead	ppm	ASTM D5185m	>20	1	<1
Copper	ppm	ASTM D5185m	>20	<1	<1
Tin	ppm	ASTM D5185m	>20	<1	<1
Vanadium	ppm	ASTM D5185m		<1	<1
Cadmium	ppm	ASTM D5185m		<1	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0
Barium	ppm	ASTM D5185m		0	0
Molybdenum	ppm	ASTM D5185m		<1	<1
Manganese	ppm	ASTM D5185m		<1	<1
Magnesium	ppm	ASTM D5185m		<1	<1
Calcium	ppm	ASTM D5185m		6	4
Phosphorus	ppm	ASTM D5185m		21	18
Zinc	ppm	ASTM D5185m		7	0
Sulfur	ppm	ASTM D5185m		549	475

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1	1
Sodium	ppm	ASTM D5185m		0	0
Potassium	ppm	ASTM D5185m	>20	<1	<1

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		236	369	4385
Particles >6µm	ASTM D7647	>2500	78	141	685
Particles >14µm	ASTM D7647	>320	12	15	45
Particles >21µm	ASTM D7647	>80	3	5	13
Particles >38µm	ASTM D7647	>20	0	0	1
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/18/15	15/13/11	16/14/11	19/17/13

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.04	0.09	0.07

OIL ANALYSIS REPORT


Particle Trend

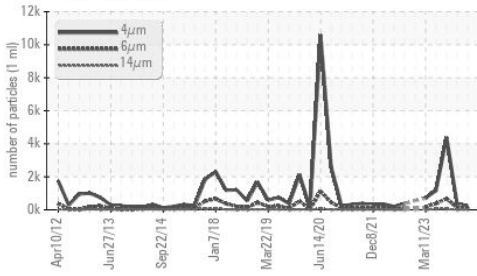


Acid Number

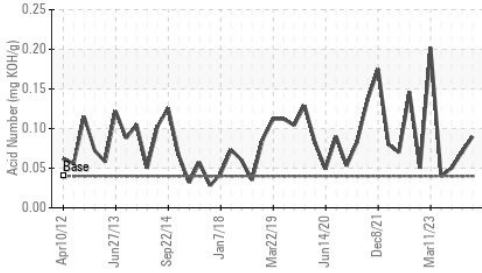

Viscosity @ 40°C

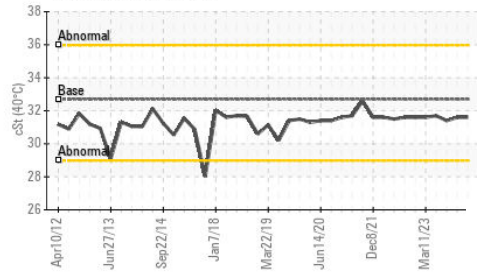

Particle Trend

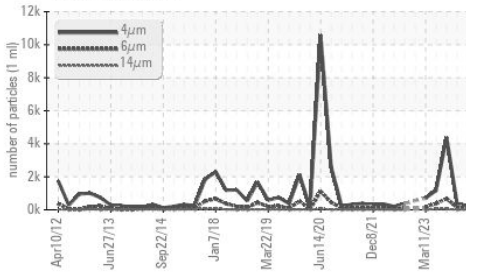


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32.7	31.6	31.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

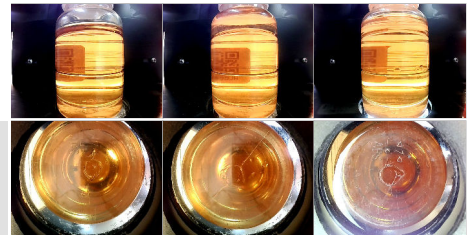


Bottom

GRAPHS


Ferrous Alloys

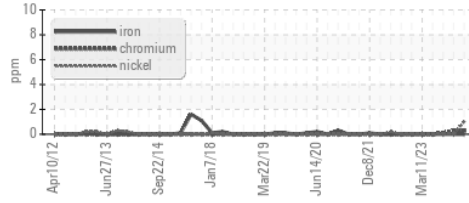


Non-ferrous Metals

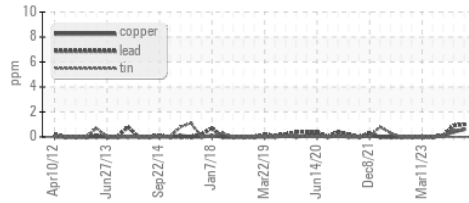


Viscosity @ 40°C

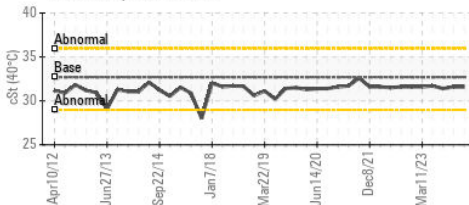

Particle Count

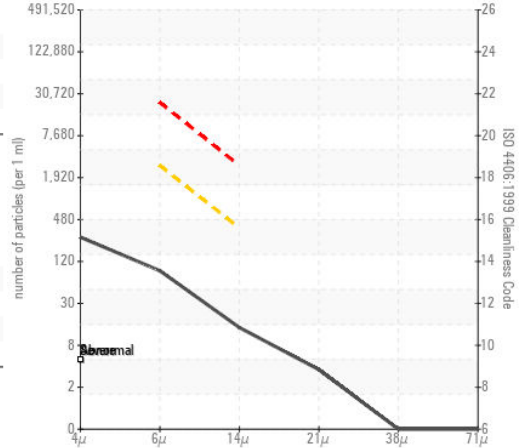

Acid Number

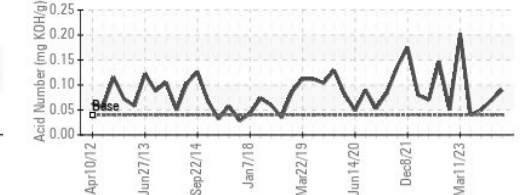

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : HLC0003079
Lab Number : 06131360
Unique Number : 10950825
Test Package : IND 2

Received : 27 Mar 2024
Tested : 28 Mar 2024
Diagnosed : 01 Apr 2024 - Don Baldrige

HILCORP ALASKA LLC - ENDICOTT
 604 WAREHOUSE ENDICOTT
 PRUDHOE BAY, AK
 US 99734
 Contact: SEAN LOWTHER
 slowther@hilcorp.com
 T: (907)659-6800
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)