


OIL ANALYSIS REPORT

Sample Rating Trend



VIS DEBRIS

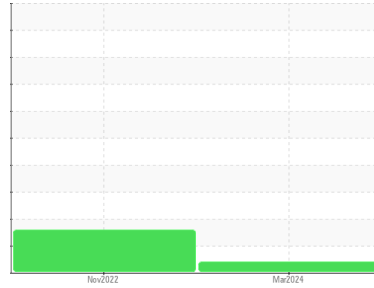

Machine Id
5481185 (S/N 1808)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA015610	KCP46472	---
Sample Date	Client Info			06 Mar 2024	21 Nov 2022	---
Machine Age	hrs	Client Info		40372	34768	---
Oil Age	hrs	Client Info		0	8302	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>3	<1	0	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	<1	0	---
Aluminum	ppm	ASTM D5185m	>10	2	<1	---
Lead	ppm	ASTM D5185m	>10	<1	0	---
Copper	ppm	ASTM D5185m	>50	30	12	---
Tin	ppm	ASTM D5185m	>10	<1	<1	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m	90	12	6	---
Calcium	ppm	ASTM D5185m	2	3	0	---
Phosphorus	ppm	ASTM D5185m		12	21	---
Zinc	ppm	ASTM D5185m		43	23	---
Sulfur	ppm	ASTM D5185m		17566	21773	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	5	6	---
Sodium	ppm	ASTM D5185m		4	2	---
Potassium	ppm	ASTM D5185m	>20	2	0	---
Water	%	ASTM D6304	>0.05	0.010	0.006	---
ppm Water	ppm	ASTM D6304	>500	106	69.2	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	7851	---
Particles >6µm		ASTM D7647	>1300	---	▲ 2061	---
Particles >14µm		ASTM D7647	>80	---	▲ 173	---
Particles >21µm		ASTM D7647	>20	---	▲ 41	---
Particles >38µm		ASTM D7647	>4	---	4	---
Particles >71µm		ASTM D7647	>3	---	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	▲ 20/18/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.37	0.37	---


OIL ANALYSIS REPORT

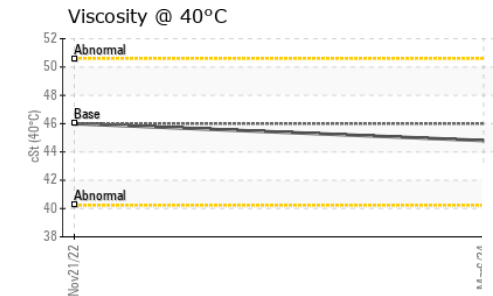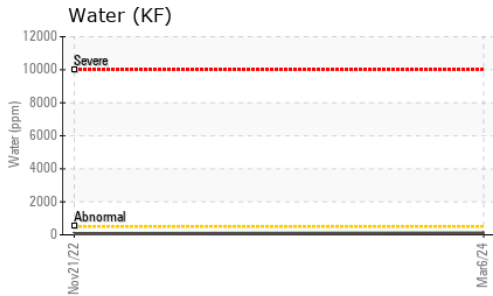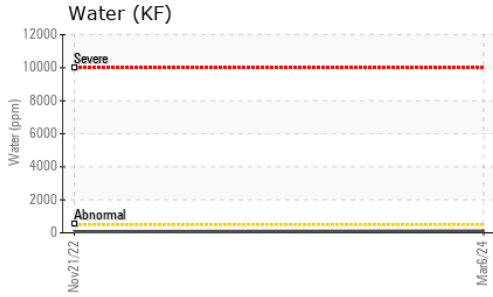





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	44.8	46.0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

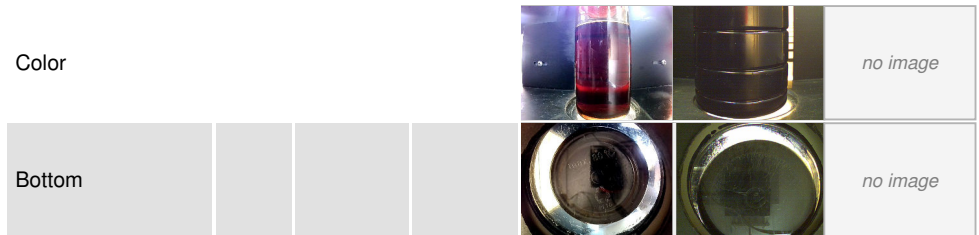

GRAPHS

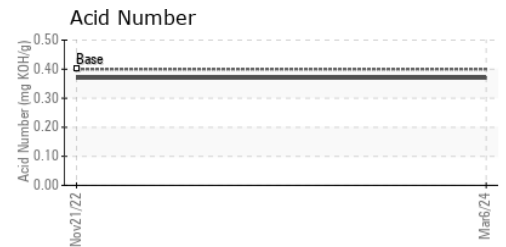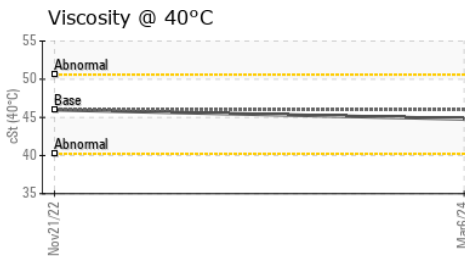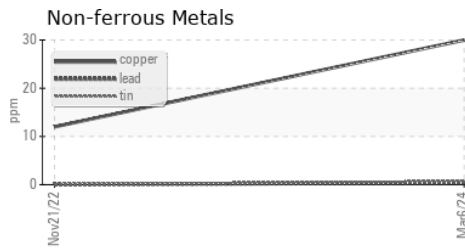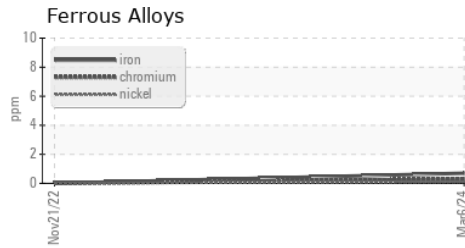

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015610 **Received** : 27 Mar 2024
Lab Number : **06131415** **Tested** : 01 Apr 2024
Unique Number : 10950880 **Diagnosed** : 01 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CAPITAL CORRUGATED
 8333 24TH AVE
 SACRAMENTO, CA
 US 95826

Contact: ZAID DAGHDONNI
 zaid.daghdonni@goldenwestpackaging.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: