




OIL ANALYSIS REPORT

Sample Rating Trend

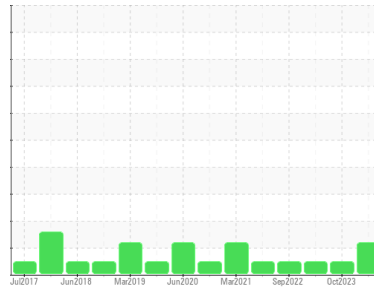

ISO



Machine Id
KAESER SM 11 2004623 (S/N 1546)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA016194	KCPA004699	KCP53046
Sample Date	Client Info			20 Mar 2024	23 Oct 2023	19 Apr 2023
Machine Age	hrs	Client Info		87412	85562	83191
Oil Age	hrs	Client Info		1850	0	2772
Oil Changed	Client Info			Changed	N/A	Not Chngd
Sample Status				ATTENTION	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	<1
Lead	ppm	ASTM D5185m	>10	<1	<1	0
Copper	ppm	ASTM D5185m	>50	4	6	4
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	11	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	34	<1	10
Calcium	ppm	ASTM D5185m	2	4	<1	0
Phosphorus	ppm	ASTM D5185m		1	1	0
Zinc	ppm	ASTM D5185m		2	0	0
Sulfur	ppm	ASTM D5185m		19540	14993	20547

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		10	0	6
Potassium	ppm	ASTM D5185m	>20	2	0	0
Water	%	ASTM D6304	>0.05	0.015	0.004	0.008
ppm Water	ppm	ASTM D6304	>500	160	49.6	85.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2788	360	682
Particles >6µm		ASTM D7647	>1300	927	61	135
Particles >14µm		ASTM D7647	>80	86	5	8
Particles >21µm		ASTM D7647	>20	25	2	1
Particles >38µm		ASTM D7647	>4	0	0	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	19/17/14	16/13/10	17/14/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36	0.31	0.33

OIL ANALYSIS REPORT

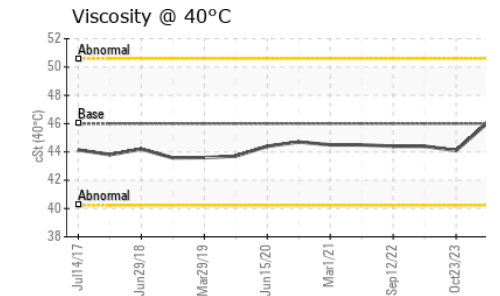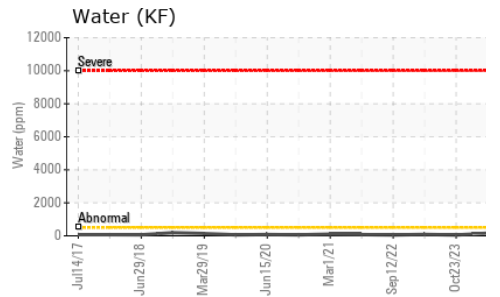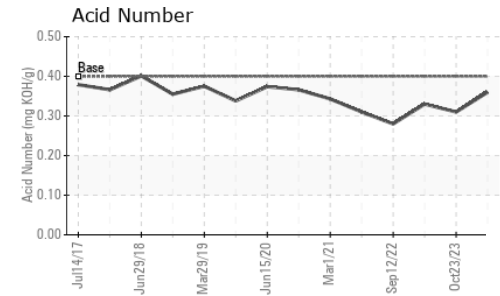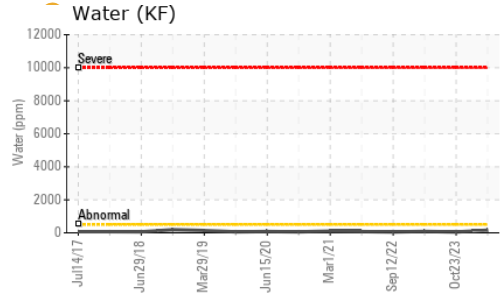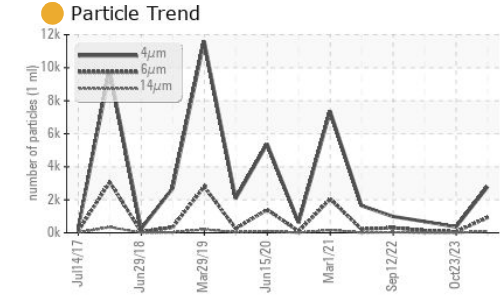





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.06	44.1	44.4

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

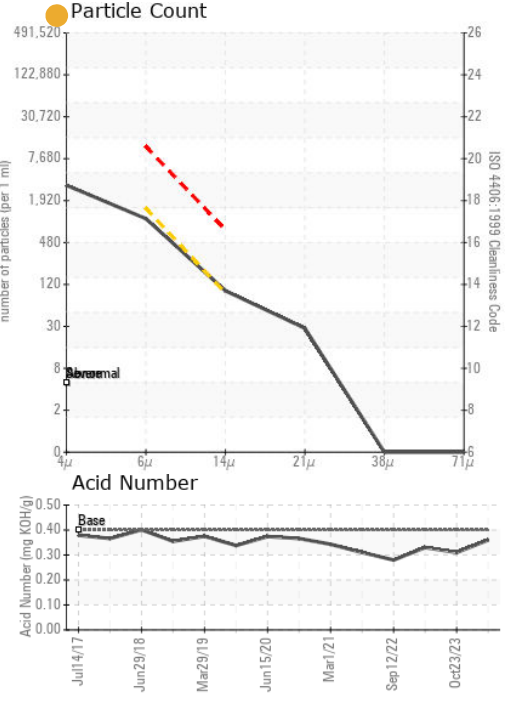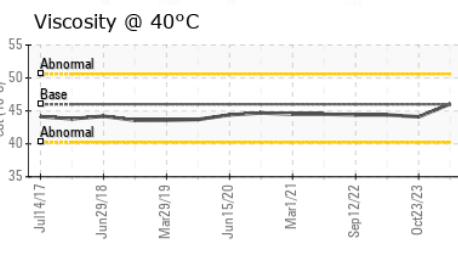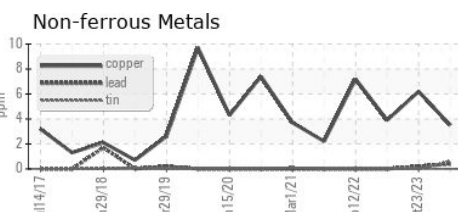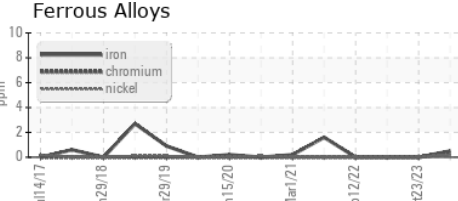

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016194 **Received** : 27 Mar 2024
Lab Number : 06131422 **Tested** : 04 Apr 2024
Unique Number : 10950887 **Diagnosed** : 04 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CENTRAL BAPTIST HOSPITAL
 1740 NICHOLASVILLE RD
 LEXINGTON, KY
 US 40503
 Contact: R. MOSHER
 rmosher@bhsi.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)