


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

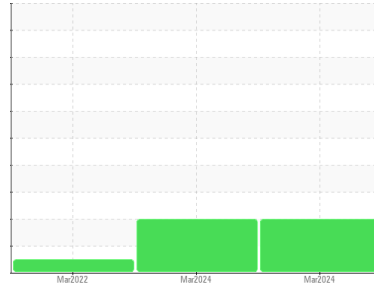

Machine Id
KAESER CSD 100 7683553 (S/N 1035)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA014966	KCPA014958	KCP42033
Sample Date	Client Info		13 Mar 2024	13 Mar 2024	11 Mar 2022
Machine Age	hrs	Client Info	10486	10486	2191
Oil Age	hrs	Client Info	0	0	2191
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	1	0	1
Chromium	ppm	ASTM D5185m >10	<1	<1	0
Nickel	ppm	ASTM D5185m >3	<1	<1	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	2	<1	<1
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	3	6	2
Tin	ppm	ASTM D5185m >10	<1	0	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	0	4	0
Molybdenum	ppm	ASTM D5185m 0	<1	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 100	26	40	67
Calcium	ppm	ASTM D5185m 0	4	0	1
Phosphorus	ppm	ASTM D5185m 0	1	0	6
Zinc	ppm	ASTM D5185m 0	14	6	6
Sulfur	ppm	ASTM D5185m 23500	25570	25303	15578

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	1	<1
Sodium	ppm	ASTM D5185m	5	13	14
Potassium	ppm	ASTM D5185m >20	1	2	4
Water	%	ASTM D6304 >0.05	0.006	0.013	0.016
ppm Water	ppm	ASTM D6304 >500	60	130	169.8






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		7773	20884	6887
Particles >6µm	ASTM D7647	>1300	▲ 2789	▲ 6566	512
Particles >14µm	ASTM D7647	>80	▲ 335	▲ 673	24
Particles >21µm	ASTM D7647	>20	▲ 107	▲ 203	7
Particles >38µm	ASTM D7647	>4	▲ 6	▲ 8	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/16	▲ 22/20/17	16/12

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.40	0.42	0.40


OIL ANALYSIS REPORT

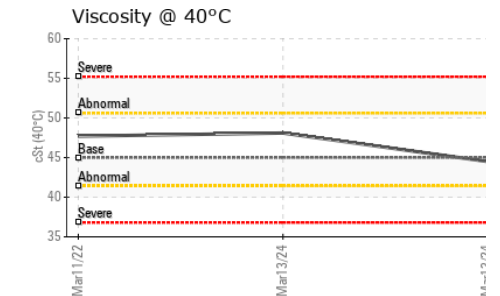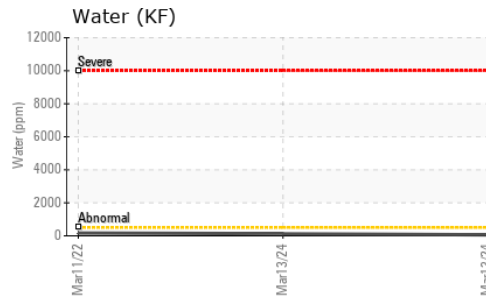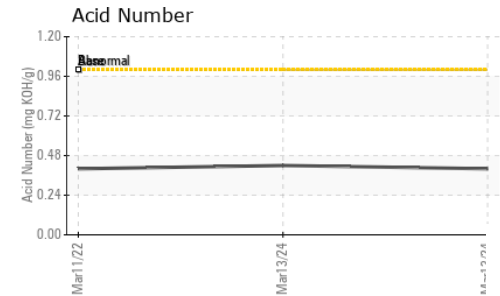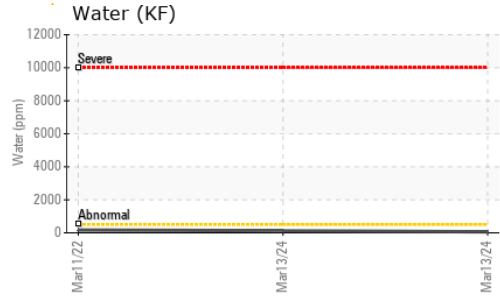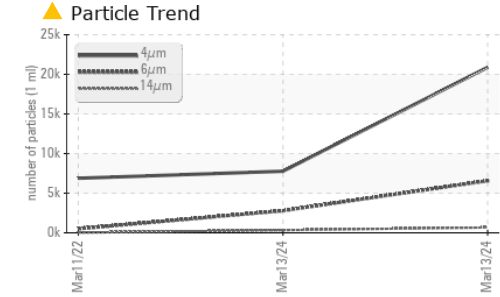





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	48.1	47.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

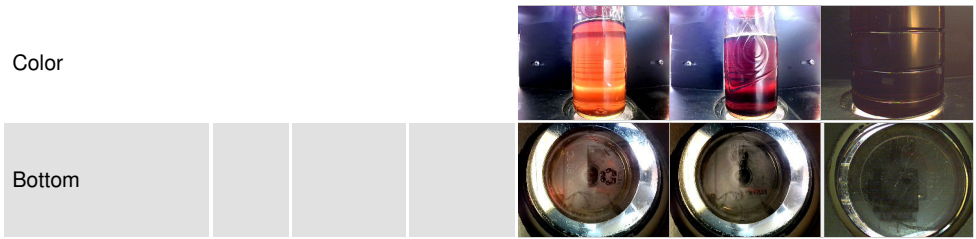

GRAPHS

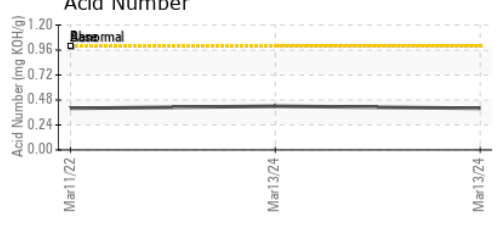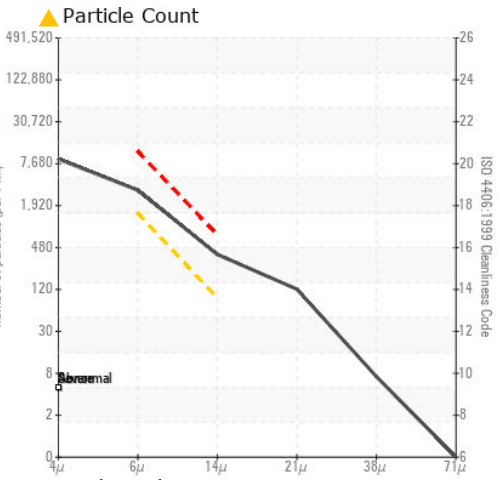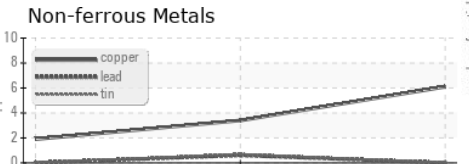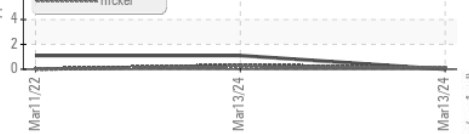

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA014966 **Received** : 27 Mar 2024
Lab Number : 06131431 **Tested** : 28 Mar 2024
Unique Number : 10950896 **Diagnosed** : 01 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

BLUE LINE TRANSFER INC
 500 E JAMIE CT
 SOUTH SAN FRANCISCO, CA
 US 94080
 Contact: G. COUTO
 gcouto@ssfscavenger.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: