

# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**FSE TURBOCOOL ISO 32**  
Machine Id  
**AC 11 (S/N C1EV2E174-1)**  
Component  
**Compressor**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**    method    limit/base    current    history1    history2

Sample Number	Client Info		<b>UCS06131457</b>	---	---
Sample Date	Client Info		<b>25 Jan 2024</b>	---	---
Machine Age	hrs	Client Info	<b>5811</b>	---	---
Oil Age	hrs	Client Info	<b>5811</b>	---	---
Oil Changed		Client Info	<b>Not Changed</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

**CONTAMINATION**    method    limit/base    current    history1    history2

Water	WC Method	>0.1	<b>NEG</b>	---	---
-------	-----------	------	------------	-----	-----

**WEAR METALS**    method    limit/base    current    history1    history2

Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---

**ADDITIVES**    method    limit/base    current    history1    history2

Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>3</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>209</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>39</b>	---	---


**CONTAMINANTS**    method    limit/base    current    history1    history2

Silicon	ppm	ASTM D5185m	>25	<b>3</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	---	---

**FLUID DEGRADATION**    method    limit/base    current    history1    history2

Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.16</b>	---	---
------------------	----------	------------	--	-------------	-----	-----

# OIL ANALYSIS REPORT

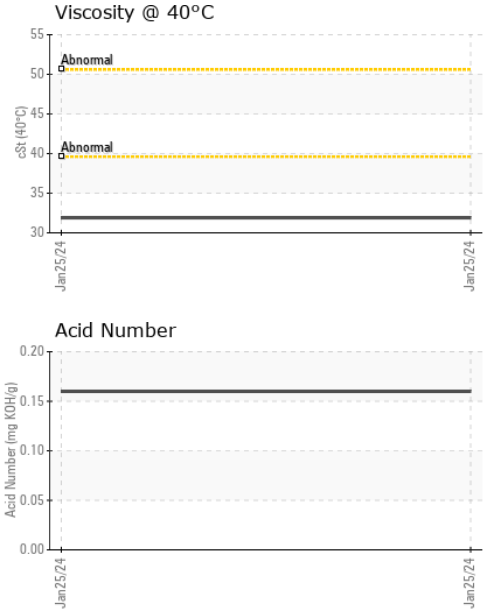





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>31.9</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

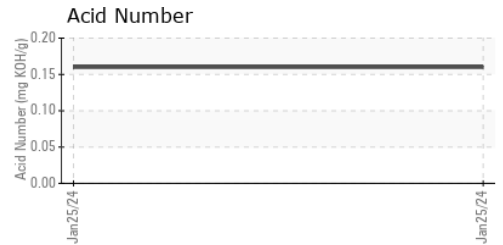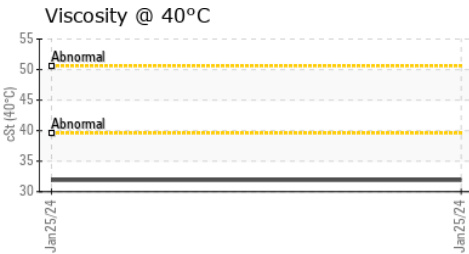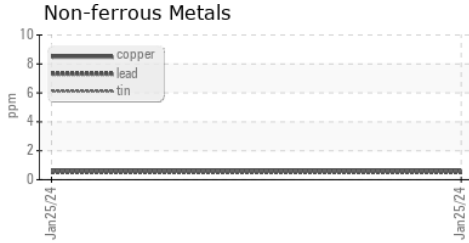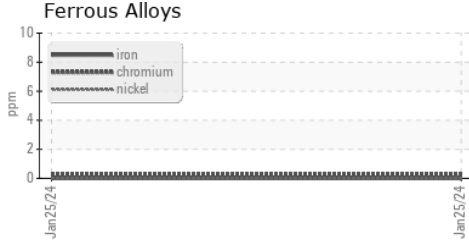

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06131457 **Received** : 27 Mar 2024  
**Lab Number** : **06131457** **Tested** : 28 Mar 2024  
**Unique Number** : 10950922 **Diagnosed** : 01 Apr 2024 - Don Baldrige  
**Test Package** : IND 2

**RASMUSSEN AIR & GAS ENERGY**  
 655 240TH STREET  
 WATERLOO, NE  
 US 68069  
 Contact: CHASE SVOBODA  
 chase.svoboda@rage-energy.com  
 T: (402)614-9926  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)