


OIL ANALYSIS REPORT

Sample Rating Trend





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


			Feb2024	Mar2024		
SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PTK0004993	PTK0004998	
Sample Date		Client Info		22 Mar 2024	15 Feb 2024	
Machine Age	hrs	Client Info		892	244	
Oil Age	hrs	Client Info		892	244	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0	0	
Chromium	ppm	ASTM D5185m	>20	0	0	
Nickel	ppm	ASTM D5185m	>20	<1	<1	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>20	<1	0	
Lead	ppm	ASTM D5185m	>20	0	0	
Copper	ppm	ASTM D5185m	>20	<1	0	
Tin	ppm	ASTM D5185m	>20	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0	0	
Barium	ppm	ASTM D5185m	5	0	0	
Molybdenum	ppm	ASTM D5185m	5	0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	5	1	0	
Calcium	ppm	ASTM D5185m	50	10	0	
Phosphorus	ppm	ASTM D5185m	175	2	70	
Zinc	ppm	ASTM D5185m	62	20	16	
Sulfur	ppm	ASTM D5185m	500	1061	866	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	
Sodium	ppm	ASTM D5185m		2	<1	
Potassium	ppm	ASTM D5185m	>20	<1	1	
Water	%	ASTM D6304	>55	NEG	NEG	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	291	259	
Particles >6µm		ASTM D7647	>1300	84	73	
Particles >14µm		ASTM D7647	>160	12	6	
Particles >21µm		ASTM D7647	>40	4	1	
Particles >38µm		ASTM D7647	>10	1	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>19/17/14	15/14/11	15/13/10	
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	3.63	0.21	0.26	
. ,						




OIL ANALYSIS REPORT







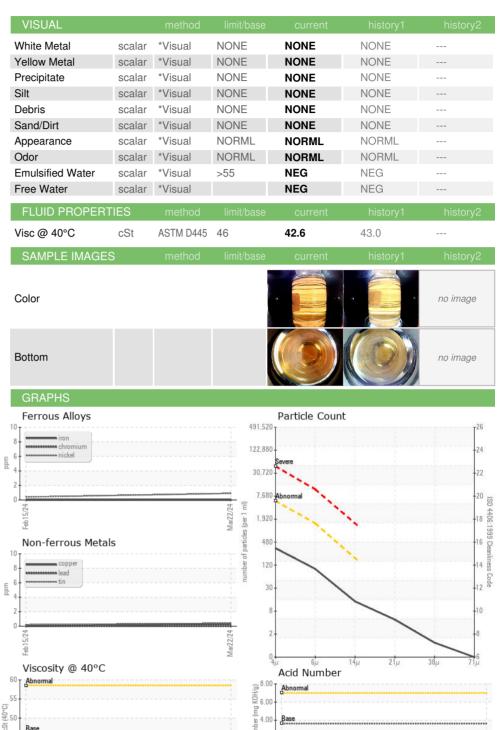

2.00 Acid

0.00

Feb15/24

Mar22/24

: 28 Mar 2024



5 21

0k Feb15/24

> Lab Number : 06131981 : 02 Apr 2024 Unique Number : 10951446 Diagnosed : 02 Apr 2024 - Jonathan Hester Test Package : MOB 2 (Additional Tests: KF, pH, ReserveAlk) Contact: JAVIER RIVERA Certificate L2367 Javirivera@niagarawater.com To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received

Tested

41

40

Laboratory

Sample No.

eb1

: PTK0004993

NIAGARA WATER BOTTLING - LANCASTER

1535 E BELTLINE RD

LANCASTER, TX

US 75146

T:

F: