




OIL ANALYSIS REPORT

Sample Rating Trend

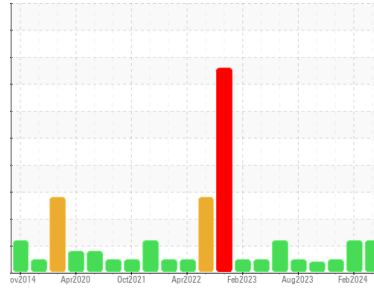

VISCOSITY



Area

GP-112

Machine Id

G3191 - PUMP VACUUM BUSCH RAU250 CIB (S/N 200000974)

Component

Vacuum Pump

Fluid

PETRO CANADA PURITY FG SYNTHETIC 100 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The oil viscosity is lower than normal. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0907937	WC0885412	WC0866755
Sample Date	Client Info		21 Mar 2024	07 Feb 2024	07 Dec 2023
Machine Age	days	Client Info	0	0	0
Oil Age	days	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ATTENTION	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>20	4	6	4
Chromium	ppm	ASTM D5185m	>20	0	0	<1
Nickel	ppm	ASTM D5185m	>20	1	0	<1
Titanium	ppm	ASTM D5185m		0	<1	<1
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	0	2
Lead	ppm	ASTM D5185m	>20	0	0	<1
Copper	ppm	ASTM D5185m	>20	<1	<1	<1
Tin	ppm	ASTM D5185m	>20	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	<1	<1
Cadmium	ppm	ASTM D5185m		0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	7
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		2	0	<1
Calcium	ppm	ASTM D5185m		<1	<1	2
Phosphorus	ppm	ASTM D5185m		326	590	689
Zinc	ppm	ASTM D5185m		13	27	17
Sulfur	ppm	ASTM D5185m		1159	1515	1781

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	10	11	10
Sodium	ppm	ASTM D5185m		3	4	4
Potassium	ppm	ASTM D5185m	>20	2	0	1

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 23481	● 17098	3227
Particles >6µm	ASTM D7647	>2500	2389	● 2675	614
Particles >14µm	ASTM D7647	>320	30	47	27
Particles >21µm	ASTM D7647	>80	4	9	5
Particles >38µm	ASTM D7647	>20	0	0	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 22/18/12	● 21/19/13	19/16/12


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	0.076	0.05	0.14




OIL ANALYSIS REPORT


▲ Particle Trend

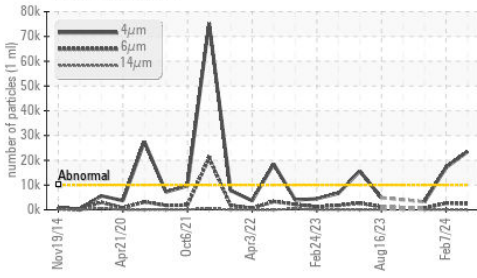


▲ Particle Trend

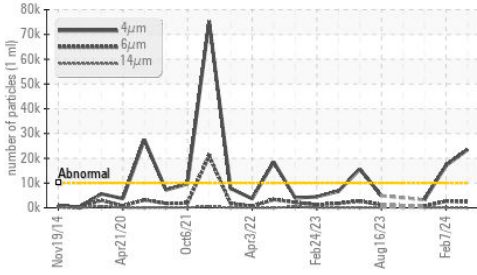

● Viscosity @ 40°C

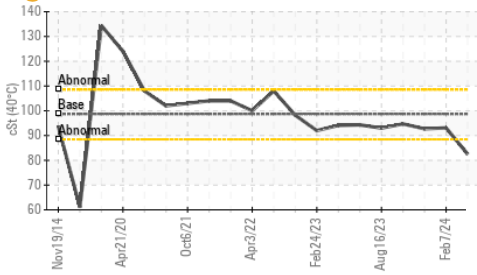

Acid Number


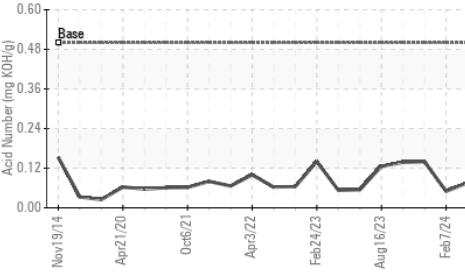


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	98.7 ● 82.5	93.1	92.7


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

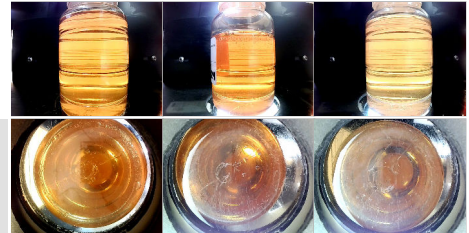


GRAPHS


Ferrous Alloys

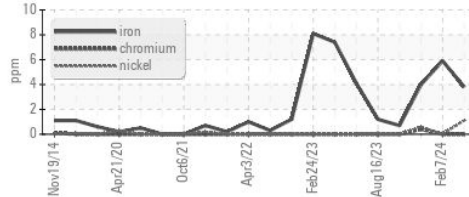


Non-ferrous Metals

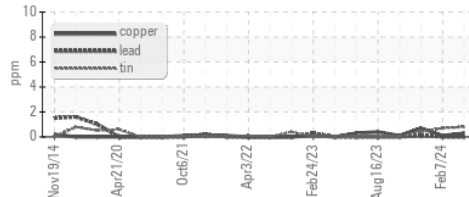


● Viscosity @ 40°C

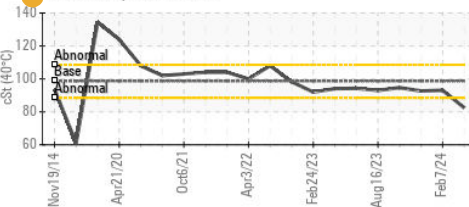

▲ Particle Count

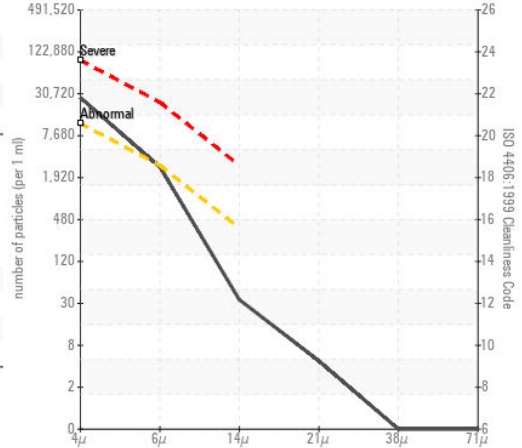

Acid Number

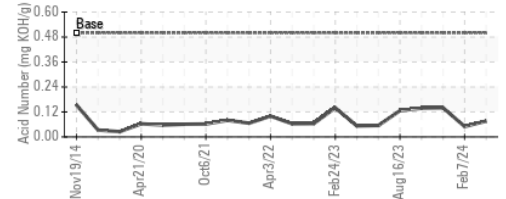

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0907937

Lab Number : 06132001

Unique Number : 10951466

Test Package : IND 2 (Additional Tests: PrtCount)

Received : 28 Mar 2024

Tested : 04 Apr 2024

Diagnosed : 04 Apr 2024 - Jonathan Hester

HORMEL FOODS - AUSTIN

1101 NORTH MAIN ST

AUSTIN, MN

US 55912

Contact: RYAN LOWE

rslowe@hormel.com

T: (507)437-5674

F: (507)437-9805

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)