




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

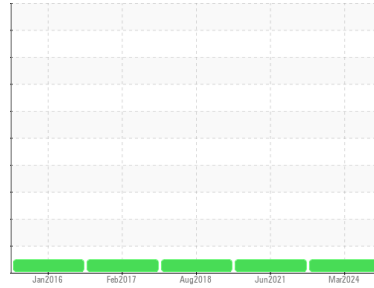

Machine Id  
**0-1825-0000**

Component  
**Turbine**  
Fluid  
**MOBIL JET OIL II (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0867034</b>	WC0549515	WCI2334181
Sample Date	Client Info		<b>27 Mar 2024</b>	01 Jun 2021	17 Aug 2018
Machine Age	hrs	Client Info	<b>4015</b>	3814	3589
Oil Age	hrs	Client Info	<b>4015</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >2	<b>1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>1</b>	0	<1
Lead	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m >5	<b>1</b>	1	<1
Tin	ppm	ASTM D5185m >5	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	1	<1
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>1</b>	0	0
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	4	0
Phosphorus	ppm	ASTM D5185m	<b>2588</b>	2767	2638
Zinc	ppm	ASTM D5185m	<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m	<b>0</b>	0	18

## CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>3</b>	2	3
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	0	1

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>1427</b>	1814	1630
Particles >6µm	ASTM D7647	>640	<b>359</b>	250	325
Particles >14µm	ASTM D7647	>80	<b>45</b>	16	41
Particles >21µm	ASTM D7647	>20	<b>14</b>	6	16
Particles >38µm	ASTM D7647	>4	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>18/16/13</b>	18/15/11	18/16/13



# OIL ANALYSIS REPORT

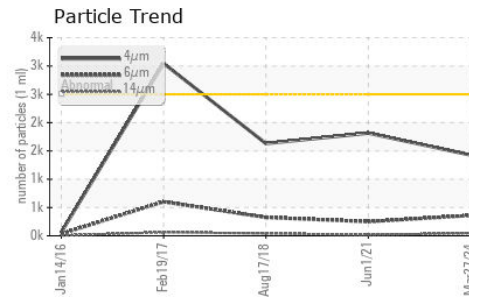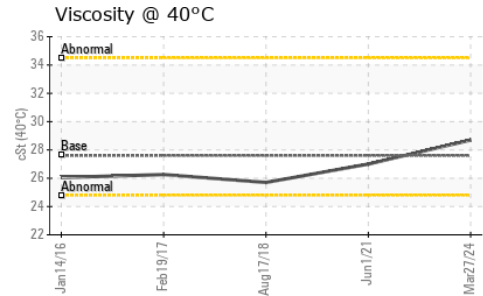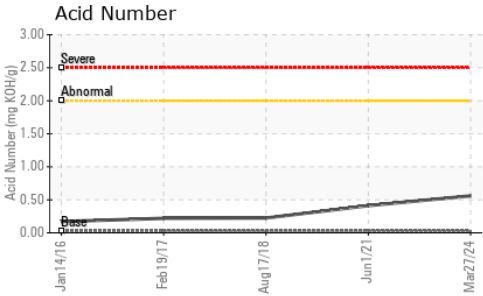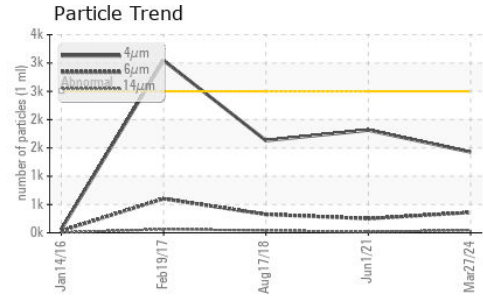

FLUID DEGRADATION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.03	<b>0.56</b>	0.412	0.224






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	27.6	<b>28.7</b>	27.0	25.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					



## GRAPHS

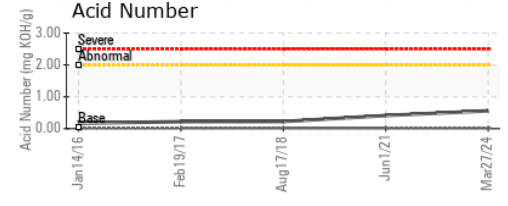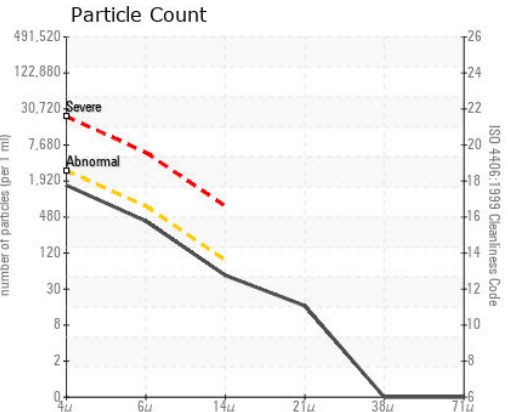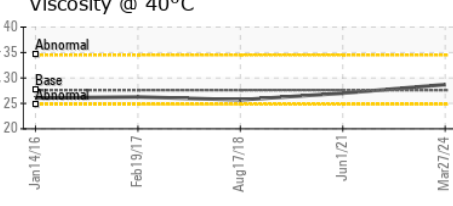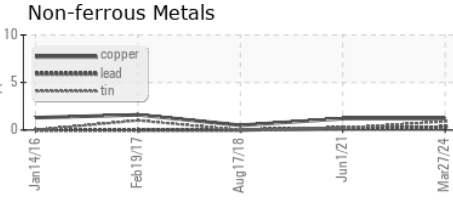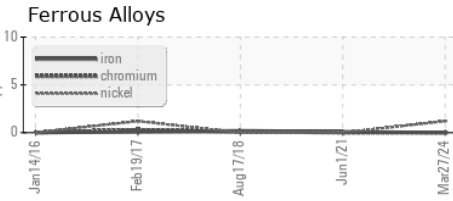

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0867034  
**Lab Number** : 06132002  
**Unique Number** : 10951467  
**Test Package** : IND 2  
**Received** : 28 Mar 2024  
**Tested** : 29 Mar 2024  
**Diagnosed** : 02 Apr 2024 - Jonathan Hester

**ALLVAC - MACHINE SHOP**  
 2020 ASHCRAFT AVE  
 MONROE, NC  
 US 28110  
 Contact: mark eilerman  
 mark.eilerman@atimaterials.com  
 T: (704)292-4051  
 F: (704)282-0665

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)