

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

LS-1 (S/N 26711-001-1-01-01)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ΛΑΤΙΟΝ	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0008309	USP0004525	
Sample Date		Client Info		25 Mar 2024	01 Jan 2024	
Machine Age	hrs	Client Info		962	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				NORMAL	NORMAL	
				-	-	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	
Chromium	ppm	ASTM D5185m	>2	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>3	0	0	
Lead	ppm	ASTM D5185m	>2	0	0	
Copper	ppm	ASTM D5185m	>8	0	<1	
Tin	ppm	ASTM D5185m	>4	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m		0	<1	
Calcium	ppm	ASTM D5185m		0	1	
Phosphorus	ppm	ASTM D5185m		0	<1	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m	50	0	0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	
Sodium	ppm	ASTM D5185m		<1	1	
Potassium	ppm	ASTM D5185m	>20	0	0	
Water	%	ASTM D6304	>0.01	0.001	0.001	
ppm Water	ppm	ASTM D6304	>100	11	15	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	457	276	
Particles >6µm		ASTM D7647	>2500	167	57	
Particles >14µm		ASTM D7647	>320	20	5	
Particles >21µm		ASTM D7647		5	1	
Particles >38µm		ASTM D7647	>20	0	0	
Particles >71µm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/15/11	15/13/10	
FLUID DEGRADA	TION_	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.041	0.014	
AGU NUMDEL (AN)	ing NOT/g	A0111 D3/4	0.000	0.041	0.014	



OIL ANALYSIS REPORT

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

cSt

White Metal

Yellow Metal

Precipitate

Silt

Debris

Odor

Color

Bottom

lan

E

70 () (40°C)

60

55

74

, LE

ŝ

Abnorma

GRAPHS

Ferrous Alloys

Non-ferrous Metals

Viscosity @ 40°C

Sand/Dirt

Appearance

Free Water

Visc @ 40°C

Emulsified Water

FLUID PROPERTIES

SAMPLE IMAGES

*Visual

*Visual

*Visua

*Visual

*Visual

*Visual

*Visual

*Visual

ASTM D445

scalar *Visual

scalar *Visual

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

>0.01

65.6

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

67.0

Particle Count

Acid Number

491,52 122,88 30.72

7.68

1.920

480

120

31

(^{0.05} (⁰/H0)

Ē 0.03

ੂੰ 0.02

0.00

FR

Acid Ni 0.01 Base

: 29 Mar 2024 - Doug Bogart

Mar25/24

: 28 Mar 2024

: 29 Mar 2024

Mar25/24

per 1

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

66.6


no image

no image


4406

:1999 Cle

14





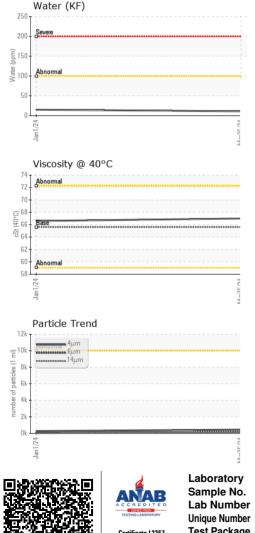

Unique Number : 10951538 Diagnosed Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: USP0008309

: 06132073

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received

Tested

21/

TYSON FOODS - RINGGOLD VA

1725 CANE CREEK PKWY

Contact: Service Manager

RINGGOLD, VA

US 24586

Page 2 of 2