


OIL ANALYSIS REPORT

ULTRA COOLANT [SVO-059805] Machine Id INGERSOLL RAND PX8106 - SYNERGETICS

Component

Compressor





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ΛΔΤΙΩΝ	method	limit/base	current	history1	history2
	717711011		IIIIIIIIIII			,
Sample Number		Client Info		UCH06132132	UCH06065766	
Sample Date	la con	Client Info		15 Mar 2024	12 Jan 2024	
Machine Age	hrs	Client Info		27816	26667	
Oil Age	hrs	Client Info		6426	5277	
Oil Changed		Client Info		Changed	Not Changd	
Sample Status				NORMAL	ABNORMAL	
CONTAMINATION	١	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	<1	0	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	1	<1	
Tin	ppm	ASTM D5185m	>15	<1	<1	
Vanadium	ppm	ASTM D5185m		0	<1	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	500	860	904	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	0	0	0	
Calcium	ppm	ASTM D5185m	0	7	7	
Phosphorus	ppm	ASTM D5185m	20	4	18	
Zinc	ppm	ASTM D5185m	0	88	127	
Sulfur	ppm	ASTM D5185m	200	487	460	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		95	95	
Potassium	ppm	ASTM D5185m	>20	6	8	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		1.58	△ 2.10	



OIL ANALYSIS REPORT

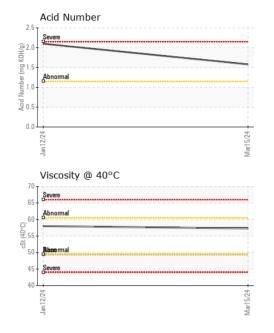



VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	
Free Water	scalar	*Visual		NEG	NEG	
FILUD DDODEDT	150		11 11 /1		111	1:
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	57.3	58.0	


Color no image **Bottom** no image


GRAPHS

SAMPLE IMAGES













Certificate L2367

Laboratory Sample No.

Test Package : IND 2

: UCH06132132 Lab Number : 06132132 Unique Number: 10951597

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 28 Mar 2024 **Tested**

: 29 Mar 2024 Diagnosed : 02 Apr 2024 - Jonathan Hester JOHN HENRY FOSTER COMPANY

4700 LEBOURGET STREET SAINT LOUIS, MO

US 63134

Contact: RACHEL VON HATTEN

rvonhatten@jhf.com

T: (314)593-1267 F: (314)874-0965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)