

# **OIL ANALYSIS REPORT**

# Area **\$-460** [8949] **KAESER 1033 - PRINT & MAILING SOLUTIONS**

Compressor



Sample Rating Trend



### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Sep2023	Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI06132157	UCH05950299	
Sample Date		Client Info		18 Mar 2024	06 Sep 2023	
Machine Age	hrs	Client Info		106061	102370	
Oil Age	hrs	Client Info		3708	6792	
Oil Changed		Client Info		Changed	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	<1	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	<1	<1	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	<1	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	88	86	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	77	90	
Calcium	ppm	ASTM D5185m	2	2	0	
Phosphorus	ppm	ASTM D5185m		0	9	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		19070	21000	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		13	17	
Potassium	ppm	ASTM D5185m	>20	0	3	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.419	0.46	




## **OIL ANALYSIS REPORT**

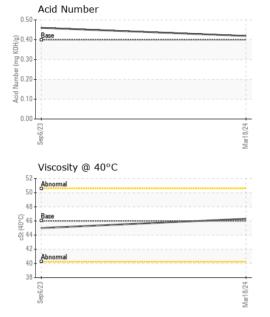



VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	LIGHT	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
<b>Emulsified Water</b>	scalar	*Visual	>0.05	NEG	NEG	
Free Water	scalar	*Visual		NEG	NEG	
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	46.3	45.0	
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					a	no image


### **GRAPHS**

**Bottom** 













Certificate L2367

Report Id: UCDELDOW [WUSCAR] 06132157 (Generated: 04/02/2024 18:36:15) Rev: 1

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

: UDI06132157 Lab Number : 06132157 Unique Number : 10951622 Test Package : IND 2

Received **Tested** Diagnosed

: 28 Mar 2024 : 29 Mar 2024 : 02 Apr 2024 - Jonathan Hester

**DELTA INDUSTRIES - DOWNERS GROVE** 2201 CURTISS STREET

DOWNERS GROVE, IL US 60515

no image

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

F: (630)960-3931