

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Area ENGINE ROOM [1940844] Machine Id RC15 (S/N 160301)

Component Refrigeration Compressor Fluid CAMCO 717 HT (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

																			11
																			11
																			-
																			1
																			1
																			11
																			н.
																			11
 	۰.	 	Ξ.		 έ.	 	 ι.	 	 Ξ.	 	 Ξ.	 	-	÷	-	-	 4		




v2012 Nov2013 0ct2014 Jan2016 Jul2017 Jun2018 Aug2019 Apr2022 0ct2023

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0903601	WC0884902	WC0857523
Sample Date		Client Info		21 Mar 2024	27 Dec 2023	07 Oct 2023
Machine Age	hrs	Client Info		27829	27762	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.01	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	1	3	<1
Chromium	ppm	ASTM D5185m	>2	0	<1	3
Nickel	ppm	ASTM D5185m		1	<1	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	<1	2	0
Lead	ppm	ASTM D5185m	>2	0	<1	0
Copper	ppm	ASTM D5185m	>8	0	<1	0
Tin	ppm	ASTM D5185m	>4	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
	ppm	ASTM D5185m		0	0	0
	ppm	ASTM D5185m		0	<1	0
•	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		<1	0	0
	ppm	ASTM D5185m		<1	2	2
	ppm	ASTM D5185m		0	22	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	1	0
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	1	1	<1
VISUAL		method	limit/base	current	history1	history2
	scalar	*Visual	NONE	NONE	NONE	LIGHT
	scalar	*Visual	NONE	NONE	NONE	NONE
	scalar	*Visual	NONE	NONE	NONE	NONE
	scalar	*Visual	NONE	NONE	NONE	NONE
	scalar	*Visual	NONE	NONE	NONE	NONE
	scalar	*Visual	NONE	NONE	NONE	NONE
	scalar	*Visual	NORML	NORML	NORML	NORML
	scalar	*Visual	NORML	NORML	NORML	NORML
	scalar	*Visual	>0.01	NEG NEG	NEG NEG	NEG
Free Water	scalar	*Visual				NEG


Contact/Location: ERIC KLINE - LEPGRE



OIL ANALYSIS REPORT



FLUID PROPE	ERTIES	method	limit/base	current	history1	history2		
Visc @ 40°C	cSt	ASTM D445 69		66.5	67.0	65.6		
SAMPLE IMAG	GES	method	limit/base	current	history1	history2		
Color				•				
Bottom								

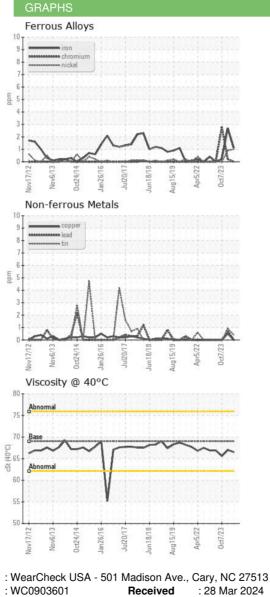

LEPRINO FOODS-GREELEY : 28 Mar 2024 1302 1ST AVE Tested : 01 Apr 2024 GREELEY, CO Diagnosed : 02 Apr 2024 - Sean Felton US 80631-5909 Contact: ERIC KLINE EKLINE@LEPRINOFOODS.COM To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (970)347-5190



Certificate L2367

Laboratory Sample No.

Lab Number : 06132572

Unique Number : 10952037

Test Package : IND 1