

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Area **ENGINE ROOM** [1940837] Machine Id **RC07** (S/N 160335) Component

Refrigeration Compressor Fluid CAMCO 717 HT (120 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

																							11
																							ц.
																							11
																							1
																							4
																							11
																							н.
1	÷	1	1	1	1	1.	١.	١.	1						 				١.	١.	2.	1	




r2012 Feb2013 Feb2014 Jan2015 Jan2016 Jul2017 Jun2018 Dec2021 Jul2023

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0903595	WC0884895	WC0857514
Sample Date		Client Info		21 Mar 2024	27 Dec 2023	07 Oct 2023
Machine Age	hrs	Client Info		69818	68056	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATIO		method	limit/base	-	history1	history2
Water	N	WC Method		current	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	6	4	6
Chromium	ppm	ASTM D5185m	>2	0	<1	3
Nickel	ppm	ASTM D5185m		1	<1	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m		<1	2	0
Lead	ppm	ASTM D5185m	>2	0	<1	0
Copper	ppm	ASTM D5185m	>8	<1	<1	0
Tin	ppm	ASTM D5185m	>4	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		1	0	0
Calcium	ppm	ASTM D5185m		<1	<1	2
Phosphorus	ppm	ASTM D5185m		0	21	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	1	<1
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	<1	1	<1
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
6:18:39) Rev: 1				Contact/L	ocation: ERIC K	LINE - LEPGRE


Contact/Location: ERIC KLINE - LEPGRE



OIL ANALYSIS REPORT



FLUID PROPE	ERTIES	method	limit/base	current	history1	history2		
Visc @ 40°C	cSt	ASTM D445	69	67.0	66.5	66.5		
SAMPLE IMAG	GES	method	limit/base	current	history1	history2		
Color				•	•			
Bottom								

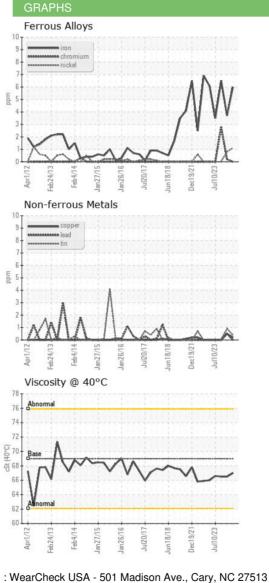

Cary, NC 27513 : 28 Mar 2024 : 01 Apr 2024 : 02 Apr 2024 - Sean Felton 1369. creditation. LEPRINO FOODS-GREELEY I 302 1ST AVE GREELEY, CO US 80631-5909 Contact: ERIC KLINE EKLINE@LEPRINOFOODS.COM T:



Lab Number : 06132574

: WC0903595

Laboratory Sample No.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (970)347-5190

Received

Tested

Page 2 of 2