


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

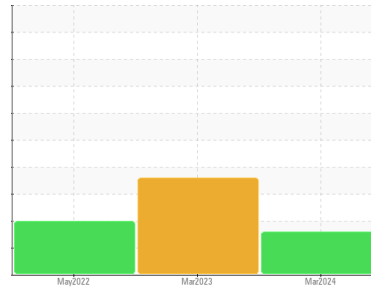

Machine Id
5863713 (S/N 1029)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. The water content is negligible.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA013617	KCPA002619	KCP48088
Sample Date	Client Info		15 Mar 2024	31 Mar 2023	05 May 2022
Machine Age	hrs	Client Info	17142	15198	13055
Oil Age	hrs	Client Info	3125	0	1240
Oil Changed	Client Info		Changed	N/A	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	0	0	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	9	17	10
Tin	ppm	ASTM D5185m >10	0	0	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	<1
Barium	ppm	ASTM D5185m 90	0	0	21
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 100	0	3	49
Calcium	ppm	ASTM D5185m 0	0	0	2
Phosphorus	ppm	ASTM D5185m 0	0	13	5
Zinc	ppm	ASTM D5185m 0	35	45	28
Sulfur	ppm	ASTM D5185m 23500	17507	17930	16296

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	1	<1
Sodium	ppm	ASTM D5185m	2	<1	14
Potassium	ppm	ASTM D5185m >20	0	<1	<1
Water	%	ASTM D6304 >0.05	0.009	▲ 0.116	0.019
ppm Water	ppm	ASTM D6304 >500	98	▲ 1160	192.2






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		31615	---	30703
Particles >6µm	ASTM D7647	>1300	▲ 6651	---	▲ 9408
Particles >14µm	ASTM D7647	>80	▲ 308	---	▲ 992
Particles >21µm	ASTM D7647	>20	▲ 52	---	▲ 212
Particles >38µm	ASTM D7647	>4	0	---	▲ 12
Particles >71µm	ASTM D7647	>3	0	---	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/15	---	▲ 22/20/17

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.527	0.41	0.39


OIL ANALYSIS REPORT

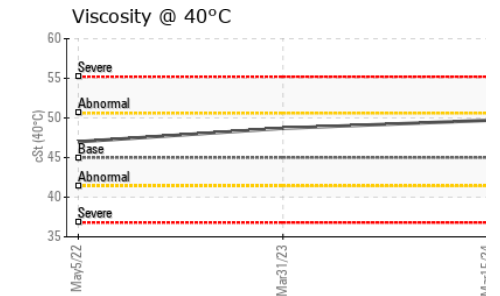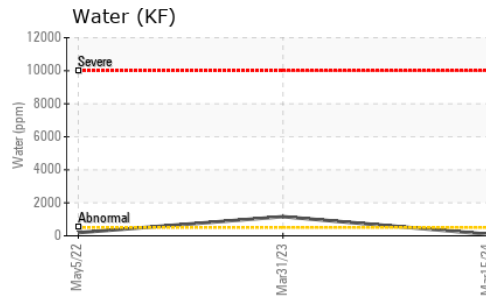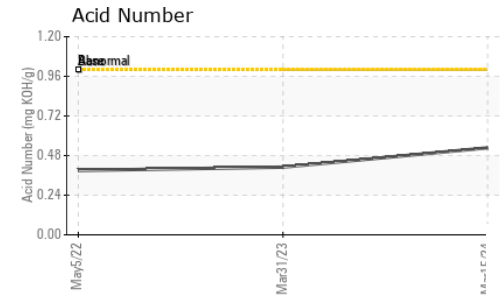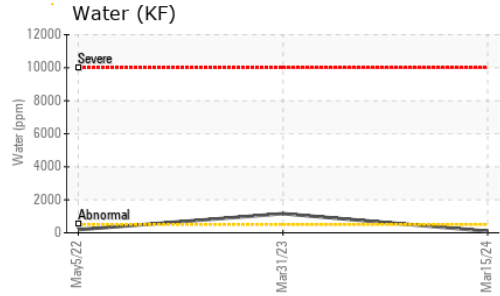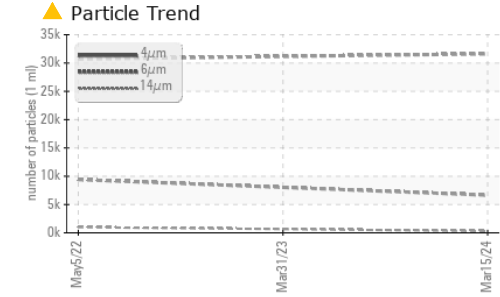




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	● 10.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.7	48.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

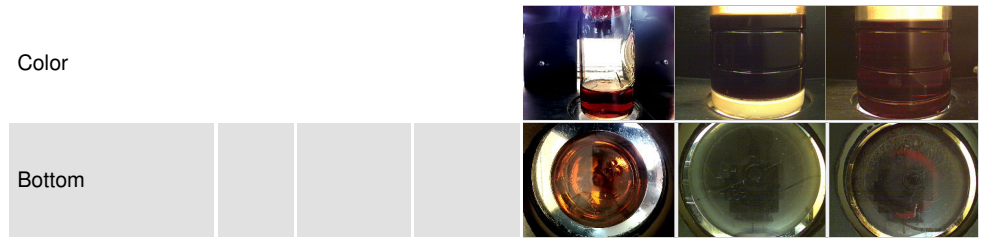

GRAPHS

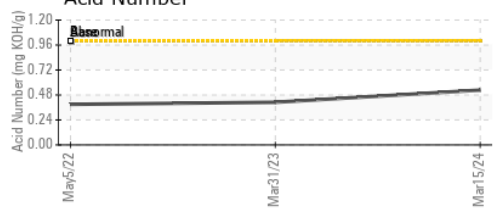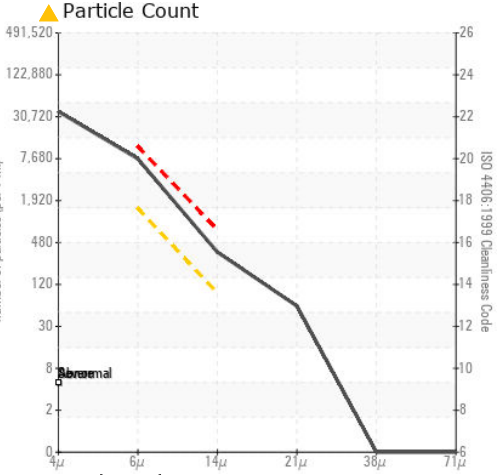

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : KCPA013617
 Lab Number : 06132739
 Unique Number : 10952204
 Test Package : IND 2 (Additional Tests: KF, PrtCount)
 Received : 28 Mar 2024
 Tested : 01 Apr 2024
 Diagnosed : 02 Apr 2024 - Don Baldrige

CLEAN PRODUCTS LLC
 661 QUEQUECHAN ST
 FALL RIVER, MA
 US 02721
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)