


OIL ANALYSIS REPORT

Area CS-46 [PMG-2808109]

SULLAIR 37219070627 - BLUE DIAMOND

Component

Compressor





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMA	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06132761	UCH05934910	
Sample Date		Client Info		18 Mar 2024	11 Aug 2023	
Machine Age	hrs	Client Info		5467	5184	
Oil Age	hrs	Client Info		283	4773	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				NORMAL	NORMAL	
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	3	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	0	0	
Lead	ppm	ASTM D5185m	>25	0	<1	
Copper	ppm	ASTM D5185m	>50	<1	14	
Tin	ppm	ASTM D5185m	>15	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1.5	0	0	
Barium	ppm	ASTM D5185m	0	0	404	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m	0.3	0	0	
Magnesium	ppm	ASTM D5185m	0	0	1	
Calcium	ppm	ASTM D5185m	0	0	15	
Phosphorus	ppm	ASTM D5185m	406	152	6	
Zinc	ppm	ASTM D5185m	0	10	89	
Sulfur	ppm	ASTM D5185m	1283	1041	366	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	8	
Sodium	ppm	ASTM D5185m		3	132	
Potassium	ppm	ASTM D5185m	>20	1	21	
FLUID DEGRADAT	ION	method	limit/base	current	history1	history2


Acid Number (AN) mg KOH/g ASTM D8045 0.463

0.24

0.083



OIL ANALYSIS REPORT

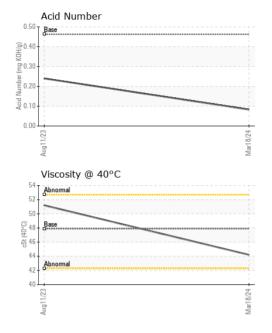



VISUAL		method				history2	
White Metal	scalar	*Visual	NONE	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG		
Free Water	scalar	*Visual		NEG	NEG		
FLUID PROPERTIES method limit/base current history1 history2							
T EOID T HOT EITH	ILO	method	IIIIII Dasc	Carrent	Thistory	1113101 yz	
Visc @ 40°C	cSt	ASTM D445	47.9	44.2	51.2		
SAMPLE IMAGES	3	method	limit/base	current	history1	history2	


GRAPHS


Bottom

Color













Certificate L2367

Laboratory Sample No.

Lab Number : 06132761 Unique Number: 10952226

: UCH06132761

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 28 Mar 2024 **Tested** : 01 Apr 2024

Diagnosed : 02 Apr 2024 - Don Baldridge **CISCO AIR SYSTEMS** 214 27TH ST SACRAMENTO, CA US 95816

Contact: BARRY FRKOVICH barryfrkovich@ciscoair.com

T: (916)444-2525 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

no image

no image