

## FUEL REPORT

ppm Water

% Gasoline

% Biodiesel

ppm

%

%

ASTM D6304 <500

\*In-House <0.50

\*In-House <20.0

### Area VA Ann Arbor Healthcare System [8007 UST] [VA Ann Arbor Healthcare System] TANK 500 KW BLDG 32 UST **Diesel Fuel**

Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (3000 GAL)

#### DIAGNOSIS

#### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 diesel fuel.

#### Corrosion


All metal levels are normal indicating no corrosion in the system.

#### Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

#### **Fuel Condition**

Sulfur value derived by ASTM D5453 method for ULSD validation.





SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC06132849		
Sample Date		Client Info		14 Mar 2024		
Machine Age	hrs	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	0.839	0.853		
Fuel Color	text	*Visual Screen	Yllow	Red		
ASTM Color	scalar	*ASTM D1500		L5.0		
Visc @ 40°C	cSt	ASTM D445	3.0	2.5		
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	72		
SULFUR CONTER	NT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	1859		
Sulfur (UVF)	ppm	ASTM D5453		1532		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	181		
5% Distillation Point	°C	ASTM D86		203		
10% Distill Point	°C	ASTM D86	201	212		
15% Distillation Point	°C	ASTM D86		219		
20% Distill Point	°C	ASTM D86	216	227		
30% Distill Point	°C	ASTM D86	230	239		
40% Distill Point	°C	ASTM D86	243	250		
50% Distill Point	°C	ASTM D86	255	261		
60% Distill Point	°C	ASTM D86	267	271		
70% Distill Point	°C	ASTM D86	280	283		
80% Distill Point	°C	ASTM D86	295	295		
85% Distillation Point	°C	ASTM D86		302		
90% Distill Point	°C	ASTM D86	310	311		
95% Distillation Point	°C	ASTM D86		325		
Final Boiling Point	°C	ASTM D86	341	336		
Distillation Residue	%	ASTM D86	3.0	1.4		
Distillation Loss	%	ASTM D86	3.0	0.5		
IGNITION QUALIT	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	34.4		
Cetane Index		ASTM D4737	<40.0	42.3		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	<1		
Potassium	ppm	ASTM D5185m	<0.1	0		
Water	%	ASTM D6304	<0.05	0.004		


45

0.0

0.0



# FUEL REPORT

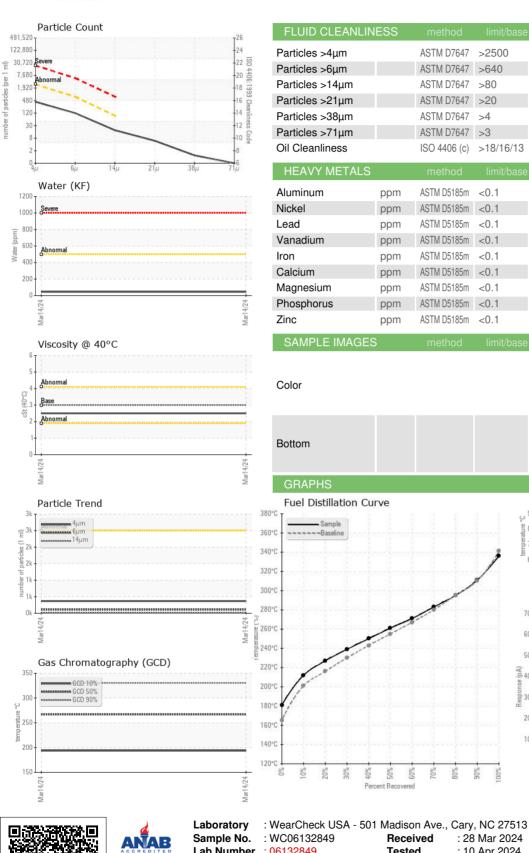

FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
articles >4µm		ASTM D7647	>2500	367		
articles >6µm		ASTM D7647	>640	106		
articles >14µm		ASTM D7647	>80	16		
articles >21µm		ASTM D7647	>20	5		
articles >38µm		ASTM D7647	>4	1		
articles >71µm		ASTM D7647	>3	0		
l Cleanliness		ISO 4406 (c)	>18/16/13	16/14/11		
HEAVY METALS		method	limit/base	current	history1	history2
uminum	ppm	ASTM D5185m	<0.1	0		
ckel	ppm	ASTM D5185m	<0.1	<1		
ad	ppm	ASTM D5185m	<0.1	0		
anadium	ppm	ASTM D5185m	<0.1	0		
n	ppm	ASTM D5185m	<0.1	0		
alcium	ppm	ASTM D5185m	<0.1	0		
agnesium	ppm	ASTM D5185m	<0.1	0		
iosphorus	ppm	ASTM D5185m	<0.1	0		
าด	ppm	ASTM D5185m	<0.1	0		
SAMPLE IMAGE	S	method	limit/base	current	history1	history2
blor					no image	no image
ottom					no image	no image
GRAPHS						
uel Distillation Cu	urve			Pensky-Marten	s Flash Point (	°C)
Sample			temperature °C	90		
Baseline			erature	30		
			temp	Base		
			/	50 <b>Dase</b>		74 -
		/	ø	Mar14		Mar14
		1		 GCD Spectrum		-
	1		70			
	1.		60	00 -		
1			50			
1			(PA) Besponse (pA)	- 00		
1			Lodg 31	0		
(			20			
			10			

100

%00

80% 90%



PETROLEUM RECOVERY SERVICES : WC06132849 Received : 28 Mar 2024 210 POWELL DR Lab Number : 06132849 Tested : 10 Apr 2024 SUMMERVILLE, SC Unique Number : 10952314 Diagnosed : 10 Apr 2024 - Doug Bogart US 29483 Test Package : DF-2 (Additional Tests: Fuel, Screen) Contact: AJAY EL Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. Ajay@prsfuel.com \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (843)225-1777 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Percent Recovered

10%

30% 40% 20% %09 %0L

20%

Report Id: PETSUM [WUSCAR] 06132849 (Generated: 05/27/2024 14:35:25) Rev: 1

Contact/Location: AJAY EL - PETSUM

2

F: